**Solar ESS Co. Ltd.**
53 Moo 2 Tambon Nanglae, Amphoe Muang, Chiang Rai 57100
Tel 063 151 6694, 089 429 6832
www.solaress.org · LINE solaress1

# October 2026 · DeyeCloud · Monthly fleet review

All 18 plants Solar ESS installed and monitors on DeyeCloud. Daily data for the full month 1-31 October 2026 and 5-minute profiles for 30 October. Total production 13,158 kWh from the 15 plants with data. All site names removed.

## Fleet overview


| Plant | kWp | kWh | kWh/kWp | Solar share | Status | Top issue |
|---|---|---|---|---|---|---|
| Apartment building, Trang | 12 | 2,630.1 | 219 | 69% | Action | Battery charged from the grid at 04:00 every night |
| Villa B, Koh Samui | 20 | 1,670.7 | 84 | 76% | Action | Battery held at 50% all night while grid supplies ~1.8 kW |
| Home B (5 kWp) | 5 | 241.5 | 48 | 31% | Action | Battery charged from grid at night and kept at 100%; panels throttled |
| Home D, Chiang Mai | 10 | 884.5 | 88 | 75% | Check | No grid purchase at all since 20 Oct - grid input off or not measured |
| Residence, Chiang Mai | 6.4 | 821.9 | 128 | 74% | Check | Settings changed 25 Oct gave no measurable gain; SOC reads 8% at night |
| Commercial building, Songkhla | 5 | 748.2 | 150 | 32% | Check | Load far larger than the 5 kWp array: solar covers 32% |
| Office (5 kWp) | 5 | 672.1 | 134 | 75% | Check | Export stopped as planned; battery reads 0% and is not used |
| Villa A, Koh Samui | 20 | 499.7 | 25 | 77% | Check | 25 Oct change helped on occupied days; meter shows night export when empty |
| Ecolodge | 10 | 402.6 | 40 | 77% | Check | Battery idle at 40% before dawn; meter readings inconsistent |
| Poultry farm, Chiang Rai | 20 | 1,497.6 | 75 | 77% | OK | On-grid zero export, follows the load |
| Garden home, Myanmar | 10 | 1,124.8 | 112 | 100% | OK | Off-grid, healthy: 100% solar |
| Hybrid home (5 kWp) | 5 | 706.7 | 141 | 60% | OK | 24 Oct change working: grid purchase halved |
| On-grid building, Chiang Rai | 5 | 559.9 | 112 | – | OK | Healthy; no consumption meter on the platform |
| Off-grid café, Chiang Rai | 10 | 345.2 | 35 | 100% | OK | Off-grid, healthy; spare solar most afternoons |
| Villa C (5 kWp) | 5 | 319.5 | 64 | 76% | OK | Healthy; guests 15-27 Oct |
| Retreat centre (8 kWp) | 8 | 33.5 | 4 | 100% | Offline | Offline since 24 Oct 13:29 |
| Home E (5.5 kWp) | 5.5 | – | – | – | Offline | Offline since 24 May 2025 |
| Warehouse (5 kWp) | 5 | – | – | – | Offline | No data on the platform |

Figures that could not be read are shown as – and are not estimated. Solar share = 1 - grid purchase / consumption.

SOLAR ESS www.solaress.org

**Solar ESS Co. Ltd.**
53 Moo 2 Tambon Nanglae, Amphoe Muang, Chiang Rai 57100
Tel 063 151 6694, 089 429 6832
www.solaress.org · LINE solaress1

## Production per kWp

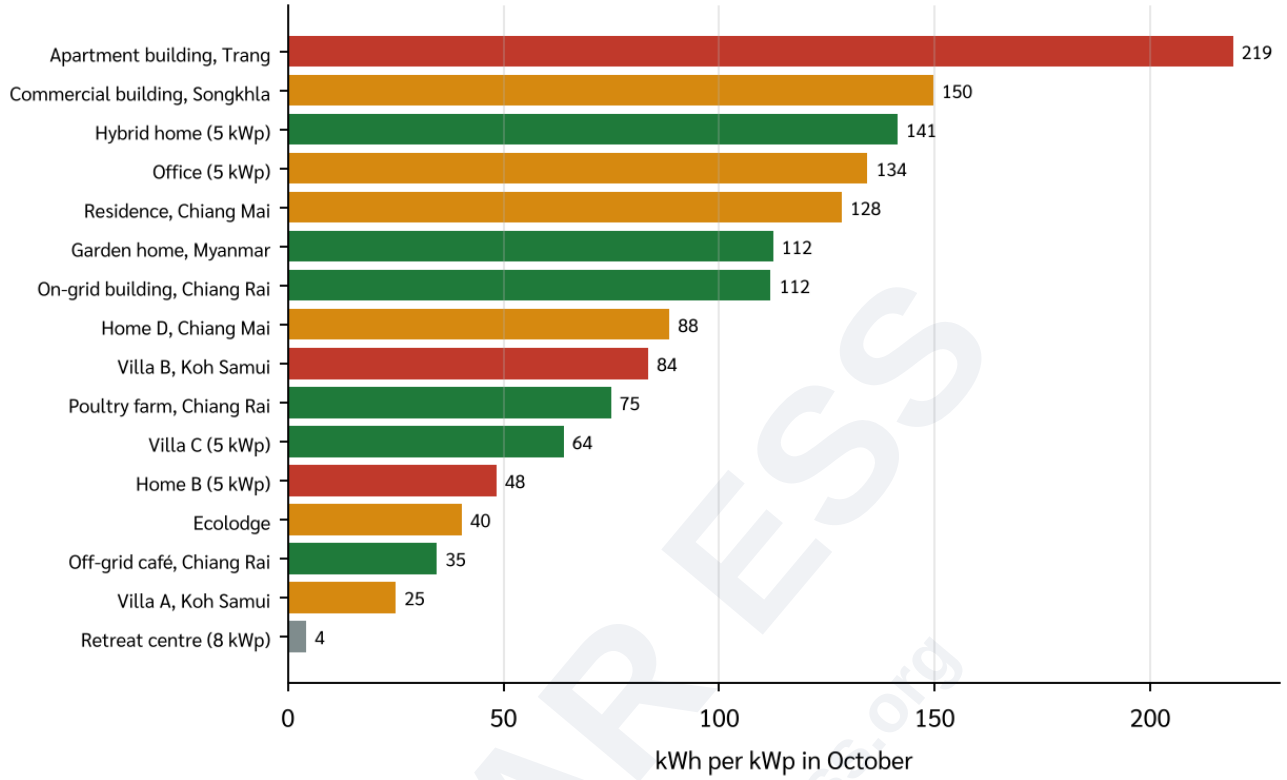


A low value does not always mean a fault: without paid export a system only produces what it can use or store, and throttles the panels once the battery is full (empty villas, off-grid sites). Values above about 140 kWh/kWp suggest the capacity entered on the platform is lower than the real array.

SOLAR ESS
www.solaress.org

## Plants needing action first

**1. Apartment building, Trang** - Battery charged from the grid at 04:00 every night (About 8 kWh/night less grid energy into the battery; the battery is then filled by solar in the morning instead.)

**2. Villa B, Koh Samui** - Battery held at 50% all night while grid supplies ~1.8 kW (Battery supplies ~30% more of its capacity every night; expected grid purchase reduction of several kWh per occupied night.)

**3. Home B (5 kWp)** - Battery charged from grid at night and kept at 100%; panels throttled (Battery covers the evening and night instead of the grid, and the panels are no longer throttled at midday: expected +3 to +5 kWh solar used per day.)

**4. Home D, Chiang Mai** - No grid purchase at all since 20 Oct - grid input off or not measured (Confirms the house is safe on cloudy days and the figures are right.)

**5. Residence, Chiang Mai** - Settings changed 25 Oct gave no measurable gain; SOC reads 8% at night (Confirms whether the 25 Oct change is still in force; explains the 8% reading.)

**6. Commercial building, Songkhla** - Load far larger than the 5 kWp array: solar covers 32% (More PV would cut the 1,500 kWh/month grid purchase.)

**7. Office (5 kWp)** - Export stopped as planned; battery reads 0% and is not used (A working battery would store the midday surplus that is now throttled (about 10-15 kWh on sunny weekdays).)

**8. Villa A, Koh Samui** - 25 Oct change helped on occupied days; meter shows night export when empty (Correct load and export figures; stops ~2 kWh/day of unpaid night export if it is real.)

**9. Ecolodge** - Battery idle at 40% before dawn; meter readings inconsistent (Battery covers the pre-dawn hours; export and load figures become reliable.)

**10. Retreat centre (8 kWp)** - Offline since 24 Oct 13:29 (Monitoring restored.)

**11. Home E (5.5 kWp)** - Offline since 24 May 2025

**12. Warehouse (5 kWp)** - No data on the platform

## Results of the October setting changes

**Hybrid home (5 kWp)**: 24 Oct 2026: Batt Shutdown 15%, Batt Low 20%, all TOU slots 20%. Expected: battery covers the evening. Result (checked 1 Nov): grid purchase 17.0 -> 8.6 kWh/day, battery discharge 8.9 -> 12.0 kWh/day. **Worked.** Open: DC2 for WindTurbine still to be disabled.

**Office (5 kWp)**: 25 Oct 2026: Solar Sell Enable -> Disable. Expected: no unpaid export. Result (checked 1 Nov): export 11.2 -> 0 kWh/day. **Worked.** Side effect: with no working battery the surplus is now throttled.

**Villa A, Koh Samui**: 25 Oct 2026: Max A Charge 40->150 A, Max A Discharge 80->150 A, Batt Low 35->20%, Restart 35->40%, Grid Charge Disable, Energy Pattern Load First, TOU slots 50->20%. Expected: battery covers the night when occupied. Result (checked 1 Nov): occupied days 25-26 Oct bought 4.7 and 0.6 kWh (19-20 Oct: 29.6 and 35.2 kWh); 28 kWh discharged on 25 Oct. **Worked on occupied days**; villa empty since 28 Oct, so the sample is short.

**Residence, Chiang Mai**: 25 Oct 2026: Batt Shutdown 20->15%, Batt Low 35->20%, TOU slots -> all 20%, TOU grid-charge ticks off. Expected: more battery use, less grid. Result (checked 1 Nov): grid purchase 8.5 -> 10.3 kWh/day, discharge 12.0 -> 11.8 kWh/day. **No measurable gain yet**; SOC reads 8% at night - read-back and BMS check needed.


## Issues seen at several plants

- Battery held up by a Time-of-Use slot SOC (50% and 40%), so the grid supplies the night while the battery still has energy (Villa B, ecolodge).
- Battery charged from the grid at night (Home B, apartment building): it is full by morning, so the panels are throttled at midday.
- Meter/CT readings that cannot be right: negative load, or export with no PV (Villa A, ecolodge).
- Battery not working or SOC drifting (office, Chiang Mai residence).
- Three plants offline: no data, so nothing is estimated.

Inverter settings could not be read this run (the desktop link dropped after the data was collected). Values marked 'seen in data' come from the 5-minute profile and must be confirmed with Read before any change.

## Plant by plant


**Apartment building, Trang** · 12 kWp · Action · 2,630.1 kWh · 219 kWh/kWp

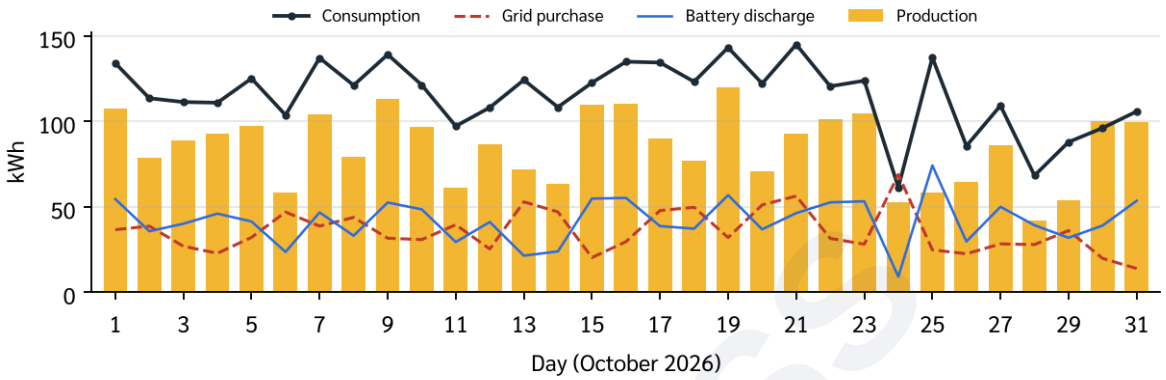


- Production 2,630.1 kWh (219 kWh/kWp on the 12 kWp entered on the platform - far above any other plant, so the capacity entered is probably too low).
- Grid purchase 1,099.1 kWh; solar covered 69% of use. Export 54.8 kWh.
- 30 Oct profile: at 04:00-05:00 the grid supplies ~6 kW and the battery charges at ~8 kW, lifting SOC from 20% to 30%. That is about 8 kWh of grid energy put into the battery every night.
- 24 Oct: grid purchase 68.8 kWh with 60 kWh battery charge - a full grid charge that day.

  **Main recommendation:** System Work Mode → Time of Use - Grid charge tick on the slot starting ~04:00: off (unless the building is on a TOU tariff and this is intended)


**Villa B, Koh Samui** · 20 kWp · Action · 1,670.7 kWh · 84 kWh/kWp

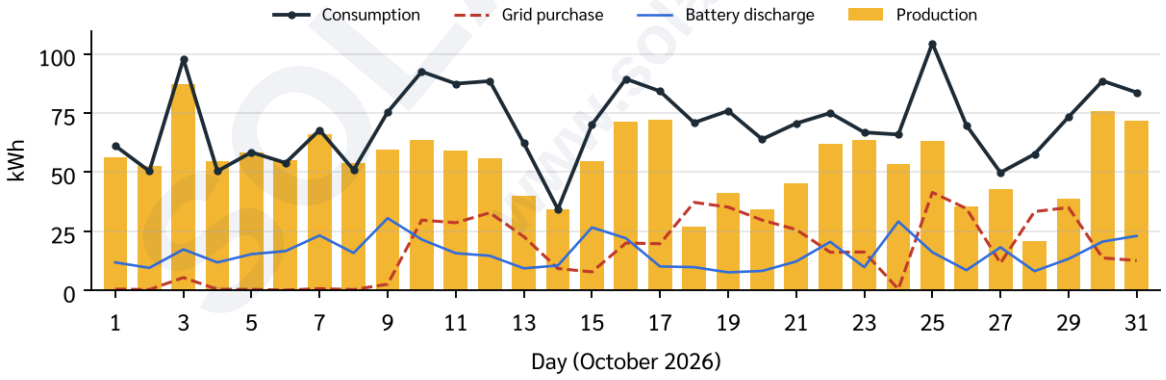


- Production 1,670.7 kWh (83.5 kWh/kWp), almost 3x September (572.4 kWh) because the villa was occupied all month.
- Grid purchase 523.9 kWh; solar covered 76% of use. Export only 0.4 kWh (zero export works).
- 30 Oct profile: SOC stays flat at 50% from 00:00 to 07:00 while the grid supplies 1.7-2.0 kW. The battery never goes below 50% - a Time-of-Use slot SOC of 50% (the same pattern found and fixed at Villa A on 25 Oct).
- About 30% of the battery is never used; at night that energy is bought from the grid instead (roughly 13 kWh between 00:00 and 07:00 on 30 Oct).

  **Main recommendation:** System Work Mode → Time of Use - SOC of all 6 slots: 20%


**Home B (5 kWp)** · 5 kWp · Action · 241.5 kWh · 48 kWh/kWp

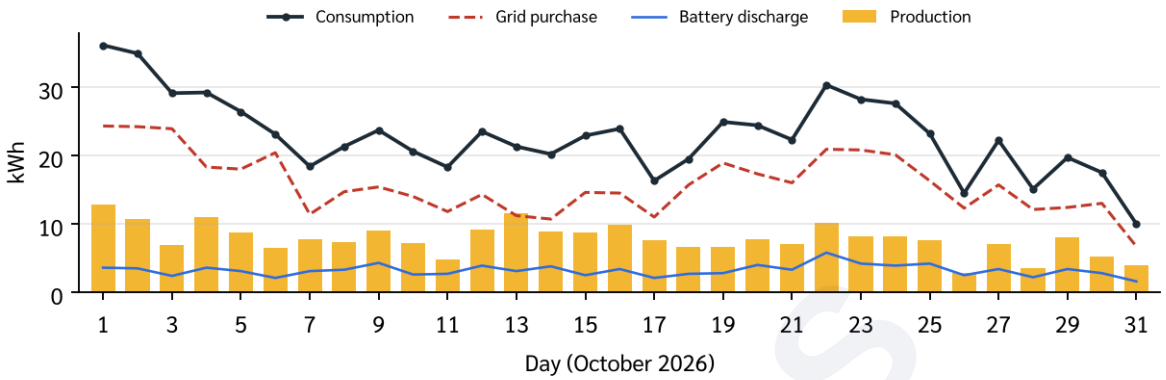


- Production 241.5 kWh - only 48.3 kWh/kWp, the lowest of the working grid-connected plants, and 16% less than September (287.4 kWh).
- Grid purchase 490.9 kWh; solar covered only 31% of use.
- 30 Oct profile: SOC is 100% from 00:00 to 08:00 and the grid supplies the whole house (~350 W). From 19:00 the battery is charged from the grid (up to 1.5 kW at 22:00) back to 100%.
- Because the battery is always full, the inverter throttles the panels at midday (155 W at 13:00-16:00 on a 5 kWp array).

  **Main recommendation:** Battery Setting → Grid Charge: Disable


**Home D, Chiang Mai** · 10 kWp · Check · 884.5 kWh · 88 kWh/kWp

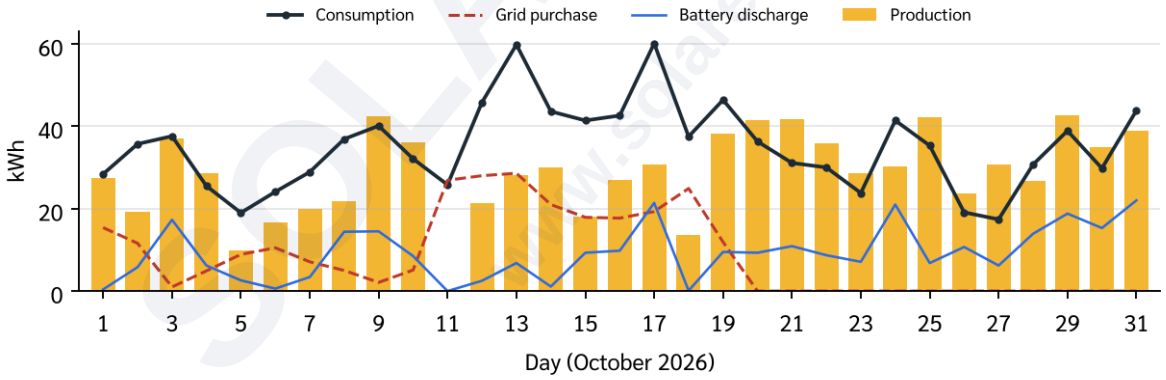


- Production 884.5 kWh (88 kWh/kWp), 73% more than September (512.7 kWh).
- Grid purchase 267.8 kWh, all of it from 1 to 19 Oct (15-28 kWh/day). From 20 to 31 Oct the grid purchase is exactly 0 every day.
- 30 Oct profile: grid 0 W all day; the battery runs the house all night (SOC 99% -> 38%) and is full again by 13:00, after which the panels are throttled.
- 11 Oct: production 0 kWh (inverter or PV off that day).

  **Main recommendation:** Owner call → Grid supply: confirm whether the grid breaker was switched off on purpose; if not, check the grid input and CT


**Residence, Chiang Mai** · 6.4 kWp · Check · 821.9 kWh · 128 kWh/kWp

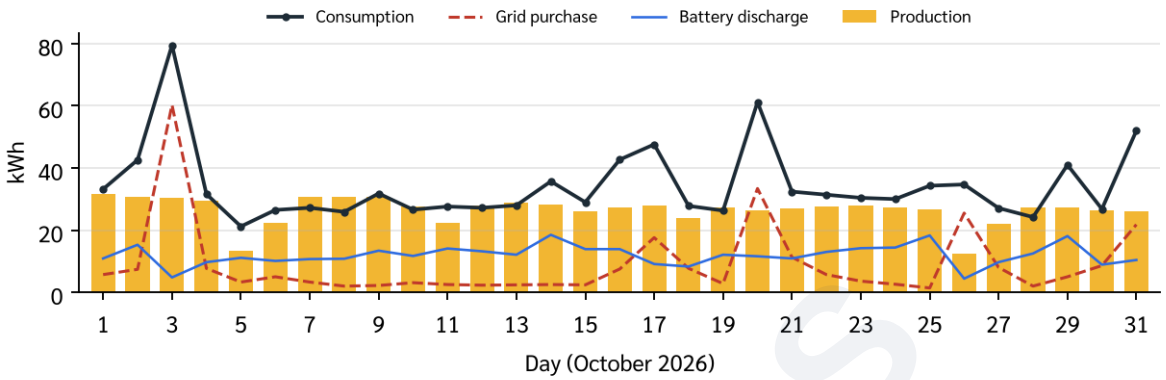


- Production 821.9 kWh (128 kWh/kWp), 6% more than September.
- Grid purchase 276.6 kWh; solar covered 74% of use. Several days with very high use (79.5 kWh on 3 Oct, 61.2 kWh on 20 Oct, 52 kWh on 31 Oct).
- Before/after the 25 Oct change: grid purchase 8.5 -> 10.3 kWh/day and battery discharge 12.0 -> 11.8 kWh/day. No improvement yet.
- 30 Oct profile: SOC falls from 33% at 23:00 to 8% by 01:00 with only ~0.6 kW of load - a jump too fast to be real discharge, so the SOC reading has probably drifted. It then stays at 8%, below the 15% Batt Shutdown that was set, and the grid supplies ~0.55 kW all night.

  **Main recommendation:** Battery Setting → Read all values: confirm Batt Shutdown 15%, Batt Low 20%, TOU 20% are still set (read-back)


**Commercial building, Songkhla** · 5 kWp · Check · 748.2 kWh · 150 kWh/kWp

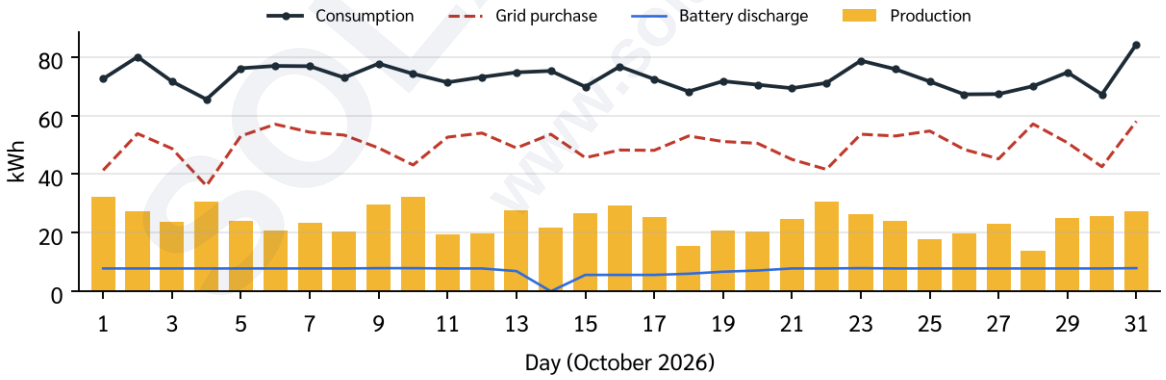


- Production 748.2 kWh (150 kWh/kWp - very high for 5 kWp, so the capacity entered may be too low), 13% more than September.
- Use 2,265 kWh; grid purchase 1,544.8 kWh; solar covered only 32%.
- The battery now cycles about 7.8 kWh every day (it did not cycle at all from 1 to 15 Sep). 14 Oct: battery did not cycle.
- 30 Oct profile: the battery is full by 12:00, empties by 21:00 and the building then draws 3-5 kW from the grid overnight. Settings look correct; the system is simply too small for this load.

  **Main recommendation:** Upgrade (owner decision) → PV array and battery: propose additional PV and storage; quote on request


**Office (5 kWp)** · 5 kWp · Check · 672.1 kWh · 134 kWh/kWp

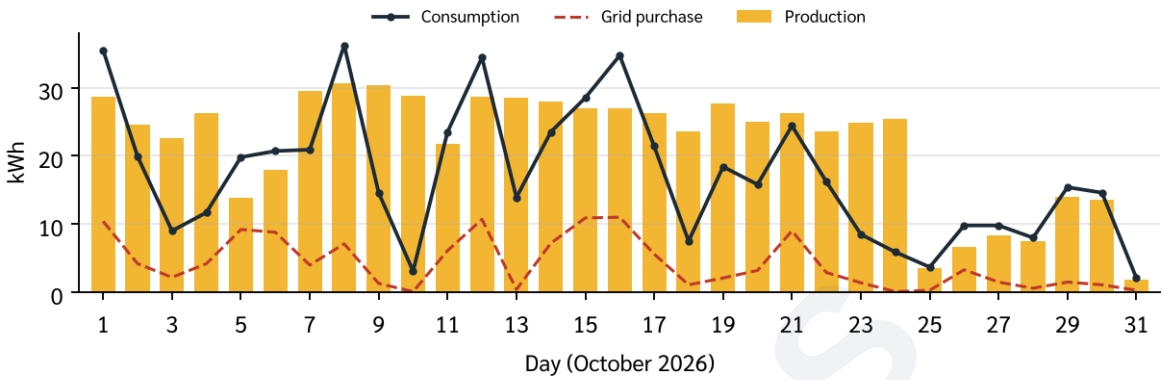


- Production 672.1 kWh (134 kWh/kWp) - but 269.6 kWh of it was exported unpaid before 25 Oct.
- After Solar Sell was disabled on 25 Oct: export 11.2 -> 0 kWh/day. Production fell to 7.9 kWh/day because the office now uses less (9.1 kWh/day) and nothing else can take the surplus.
- Battery: SOC 0% all day on 30 Oct, battery power about -3 W, charge 2.9 kWh and discharge 0 kWh in the whole month. The battery is not working (or not connected).
- Solar covered 75% of use; grid purchase 131.8 kWh.

  **Main recommendation:** Site visit → Battery and BMS cable: check breaker, BMS communication and battery state; repair or replace

**Villa A, Koh Samui** · 20 kWp · Check · 499.7 kWh · 25 kWh/kWp

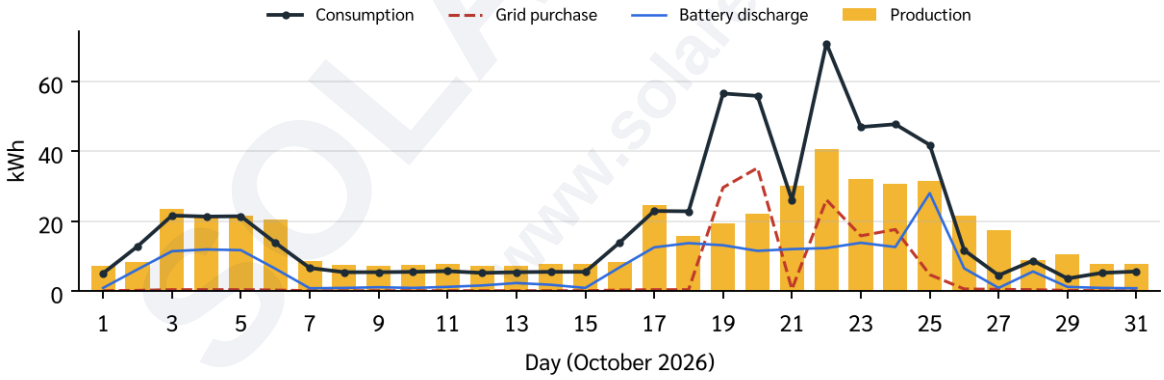



- Production 499.7 kWh (25 kWh/kWp). Low per kWp because the villa was empty on most days and there is no export: production follows the load.
- Occupied 3-6 and 17-27 Oct. On 19-20 Oct (before the change) the villa bought 29.6 and 35.2 kWh; on 25-26 Oct (after) 4.7 and 0.6 kWh with 28 kWh battery discharge on 25 Oct.
- Empty days: the battery sits at 100% and about 2 kWh/day is recorded as export, mostly at night, while the load reads negative (-100 to -350 W). This points to a CT/meter direction problem or an export path that should be checked.
- Grid purchase 135.2 kWh; solar covered 77% of use.

  **Main recommendation:** Site / remote check → Grid CT or meter direction: correct the CT direction (arrow toward the grid) or meter setting

SOLAR ESS www.solaress.org


**Ecolodge** · 10 kWp · Check · 402.6 kWh · 40 kWh/kWp

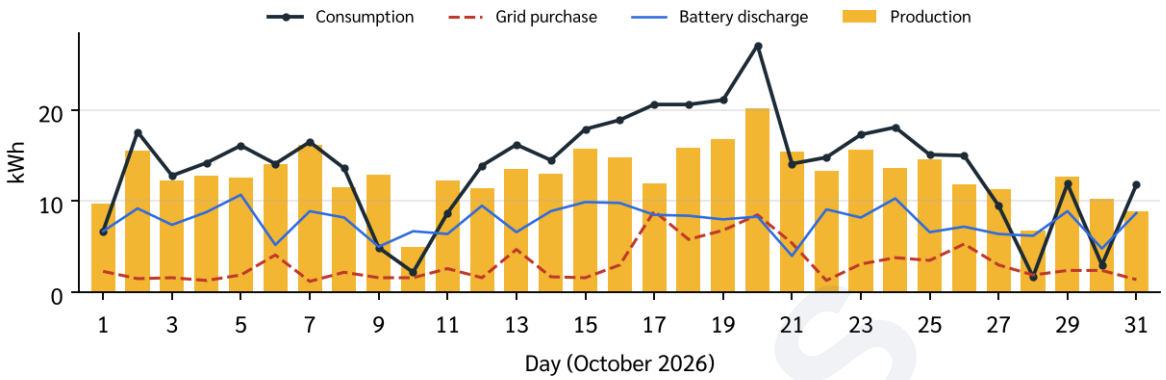


- Production 402.6 kWh (40 kWh/kWp) - low because the battery is full by late morning and there is no paid export.
- Grid purchase 98.0 kWh; solar covered 77% of use. Export 52.4 kWh (likely unpaid).
- 30 Oct profile: SOC falls to 40% by 05:00 and stays there while the grid supplies 0.4-0.8 kW until sunrise - a 40% floor.
- From 11:00 the profile shows PV 0 W, load 0 W and 0.5-0.7 kW going to the grid at the same time - this cannot all be true; the CT or meter readings need a check.


  **Main recommendation:** System Work Mode → Time of Use - SOC of all slots: 20%

**Poultry farm, Chiang Rai** · 20 kWp · OK · 1,497.6 kWh · 75 kWh/kWp

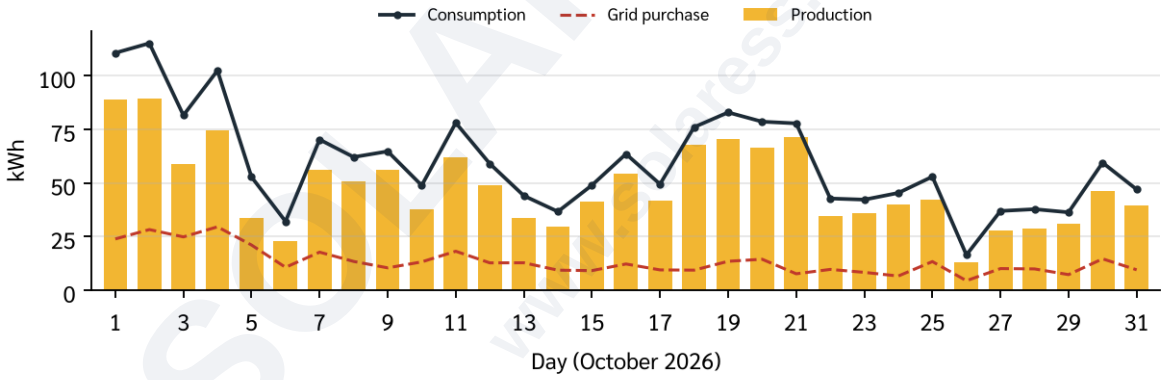



- Production 1,497.6 kWh (75 kWh/kWp); September 1,462.4 kWh in 24 days of data.
- Use 1,854.3 kWh; grid purchase 417.3 kWh; solar covered 77% of use. Export 60.6 kWh (about 2 kWh/day leaks past the zero-export limit).
- Production per kWp is limited by the zero-export setting: on low-load days the inverter throttles. Lower load in the second half of October (36-60 kWh/day vs 80-115 at the start).

**Garden home, Myanmar** · 10 kWp · OK · 1,124.8 kWh · 112 kWh/kWp

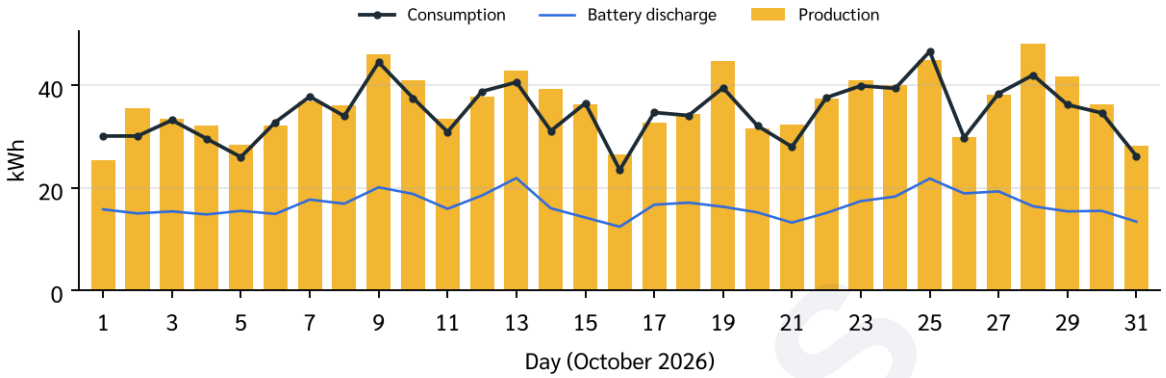



- Production 1,124.8 kWh (112 kWh/kWp), same as September (1,131.2 kWh).
- No grid; solar and battery covered 100% of use (1,076 kWh). Battery 562.5 kWh charged / 513.8 kWh discharged.
- 30 Oct profile: lowest SOC 44% at 07:00, full by 14:00. Healthy.

**Hybrid home (5 kWp)** · 5 kWp · OK · 706.7 kWh · 141 kWh/kWp

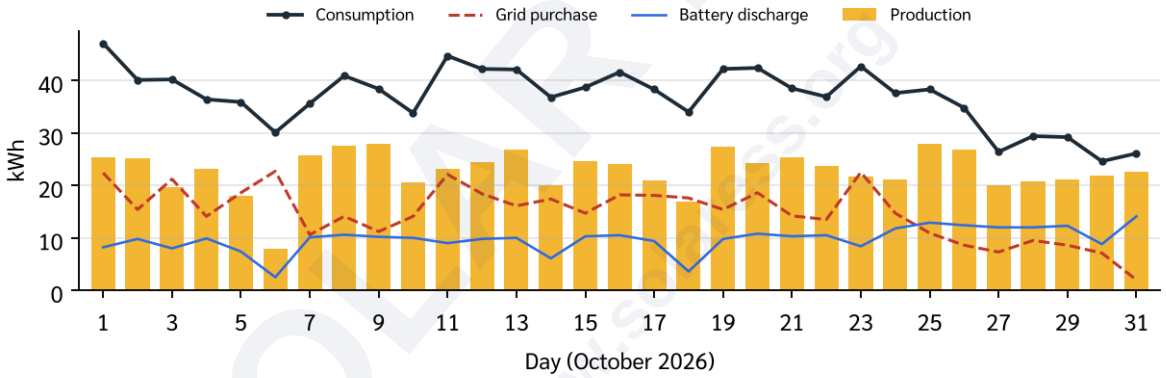



- Production 706.7 kWh (141 kWh/kWp), 18% more than September.
- Grid purchase 459.9 kWh; solar covered 60% of use.
- Before/after the 24 Oct change: grid purchase 17.0 -> 8.6 kWh/day, battery discharge 8.9 -> 12.0 kWh/day (+35%). Use was also lower (39.1 -> 30.8 kWh/day).
- 30 Oct profile: the battery now runs the house through the evening and stops at 20% at about 01:00, as intended.
  **Main recommendation:** Advanced Function → DC2 for WindTurbine: Disable (PV2 has panels)

**On-grid building, Chiang Rai** · 5 kWp · OK · 559.9 kWh · 112 kWh/kWp

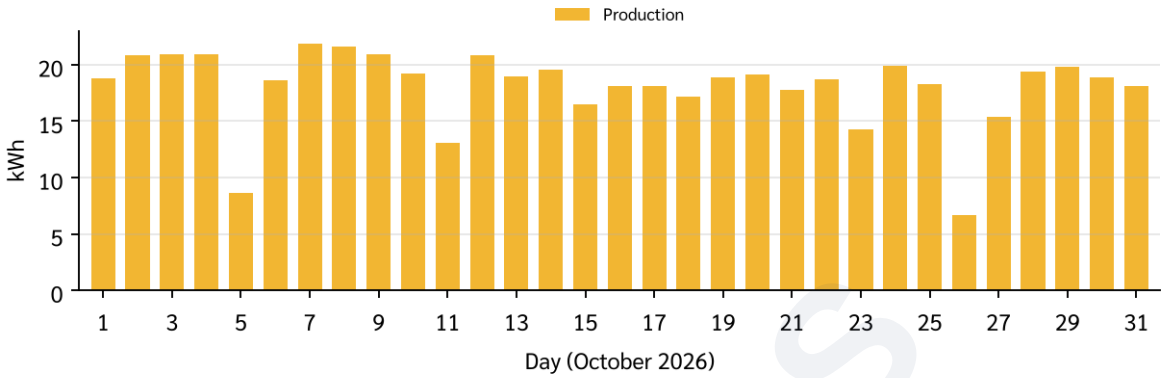



- Production 559.9 kWh (112 kWh/kWp) - first full month (online since 20 Sep).
- Steady 17-22 kWh on clear days; dips on 5, 11 and 26 Oct match cloudy days at the other Chiang Rai plants.
- No consumption, grid or export data on the platform, so solar share cannot be calculated.

**Off-grid café, Chiang Rai** · 10 kWp · OK · 345.2 kWh · 35 kWh/kWp

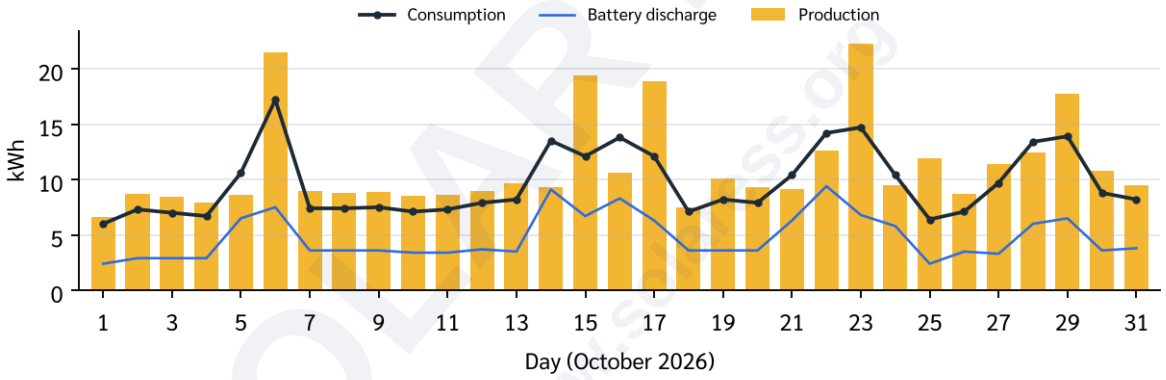



- Production 345.2 kWh (35 kWh/kWp); first full month on the new station (September had 7 days).
- Use 299.5 kWh, 100% from solar and battery. Battery 194.2 kWh charged / 148.5 kWh discharged.
- 30 Oct profile: SOC 71-99%, full by 10:00; the panels are throttled in the afternoon. There is room for more daytime loads (pumps, refrigeration).

**Villa C (5 kWp)** · 5 kWp · OK · 319.5 kWh · 64 kWh/kWp

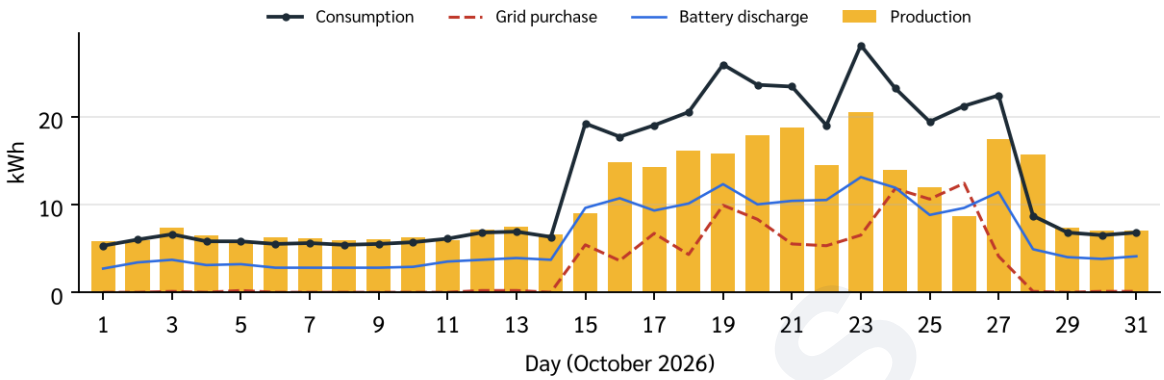


- Production 319.5 kWh (64 kWh/kWp), 64% more than September because the villa had guests from 15 to 27 Oct.
- Grid purchase 95.4 kWh, all on occupied days; solar covered 76% of use.
- 30 Oct profile: the battery stays between 81% and 100% on an empty day; settings look correct.

**Retreat centre (8 kWp)** · 8 kWp · Offline · 33.5 kWh · 4 kWh/kWp

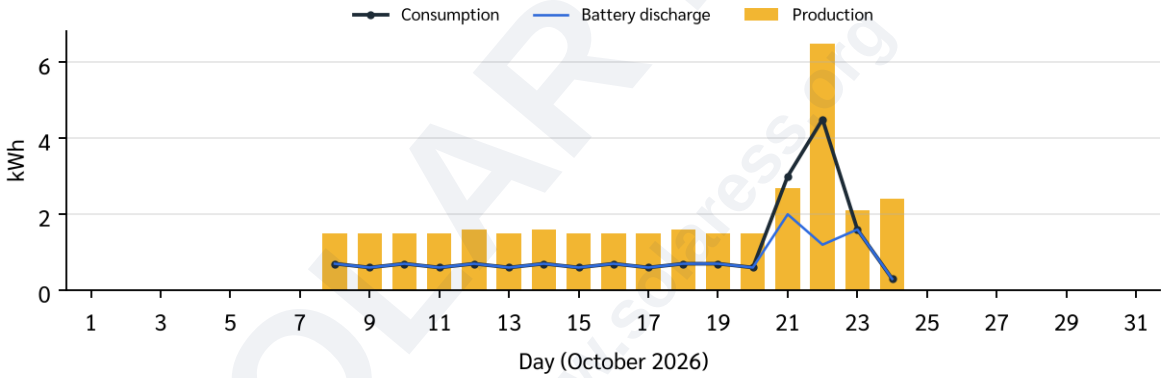


- Last data 24 Oct 2026 13:29. Data exists for 8-24 Oct only (17 days).
- Production 33.5 kWh in those 17 days - about 1.5 kWh/day, the battery standby only: the centre appears to have had almost no load.
- No data from 25 to 31 Oct: the monthly figures are incomplete and are not estimated.

  **Main recommendation:** Site / owner call → Wi-Fi / data logger: check Wi-Fi, router and logger power; re-pair the logger if the Wi-Fi password changed

**Home E (5.5 kWp)** · 5.5 kWp · Offline · no data

No data

- No data in September or October 2026. Last data 24 May 2025.
- Production, consumption and battery figures could not be read and are not estimated.
  **Main recommendation:** Owner call → Data logger: ask whether the system still runs; reconnect the logger or remove the plant from the platform

**Warehouse (5 kWp)** · 5 kWp · Offline · no data

No data

- The platform holds no production data for this plant (no last-update time).
- Figures could not be read and are not estimated.
  **Main recommendation:** Owner call → Data logger: check whether a logger was installed; connect it or remove the plant

SOLAR ESS
www.solaress.org