Solar ESS Co. Ltd.
53 Moo 2 Tambon Nanglae, Amphoe Muang
Chiang Rai 57100, Thailand
Tel 063 151 6694, 089 632 5829
www.solaress.org · LINE: solaress1

SOLAR ESS MONTHLY REPORT · OCTOBER 2026 · SOLISCLOUD · PLANT REPORT


Change settings

Home S3, Lamphun


Discharge capped 1.6 kW · floor 35%

8 kWp · 8 kW 1-phase hybrid inverter · battery

705	3.67	60%	19.4	0	10.3
kWh solar	kWh/kWp/day	solar share of use	kWh/day bought	kWh exported	kWh/day from battery

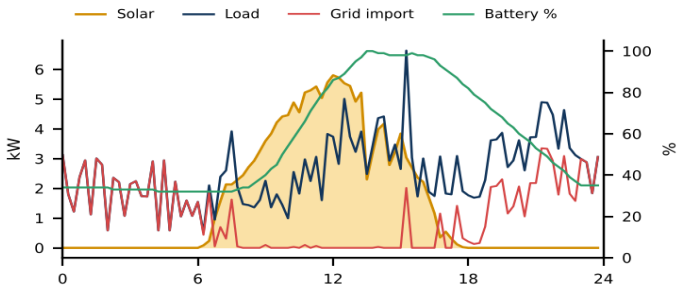

24 October, 5-minute data

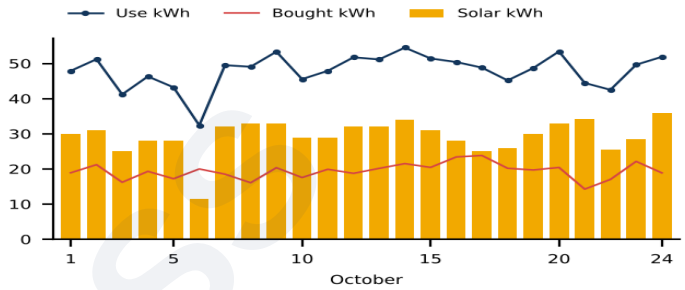

Daily totals, 1–24 October


What we found

- At night the battery discharges at only 1.6 kW while the house uses 3–5 kW; the grid supplies the rest (19 kWh/day bought).
- Battery stops at about 35% in the morning.
- Battery full by 13:30, then solar is throttled.

What to do

- Raise the battery discharge current limit and lower the battery low SOC to 20%.
- Expected: 4–6 kWh/day less grid.

How this plant compares with the other SolisCloud plants (kWh per kWp per day, 1–24 Oct)

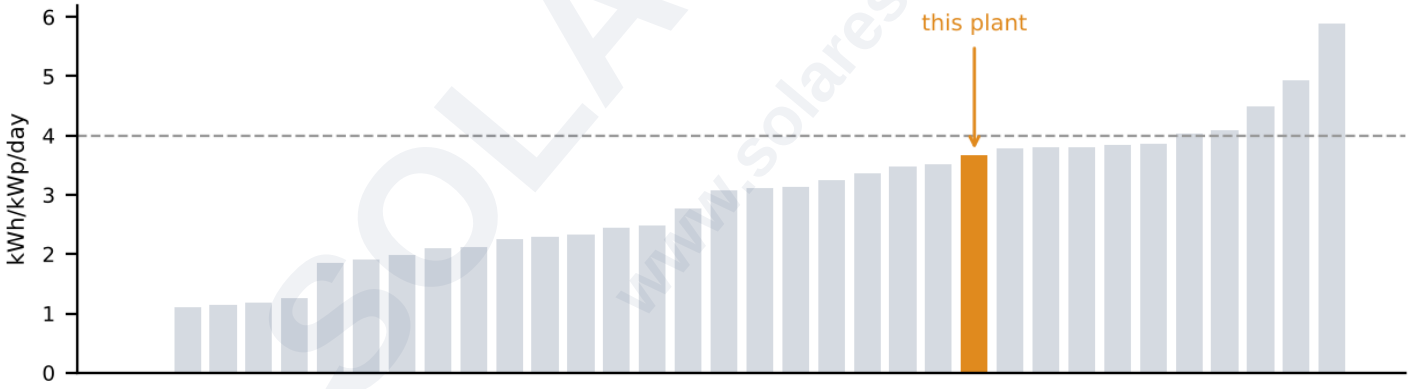

Rank 11 of 34 for yield per kWp. Dashed line ≈ 4.0, a typical clear month in the north and centre. A low yield is not always a fault – a full battery or little daytime load makes the inverter throttle the panels.

This plant report is part of the October 2026 SolisCloud fleet review on www.solaress.org (Technical → Monthly Report), which also lists the recommended standard settings. Figures are estimates from monitoring data; site name removed.