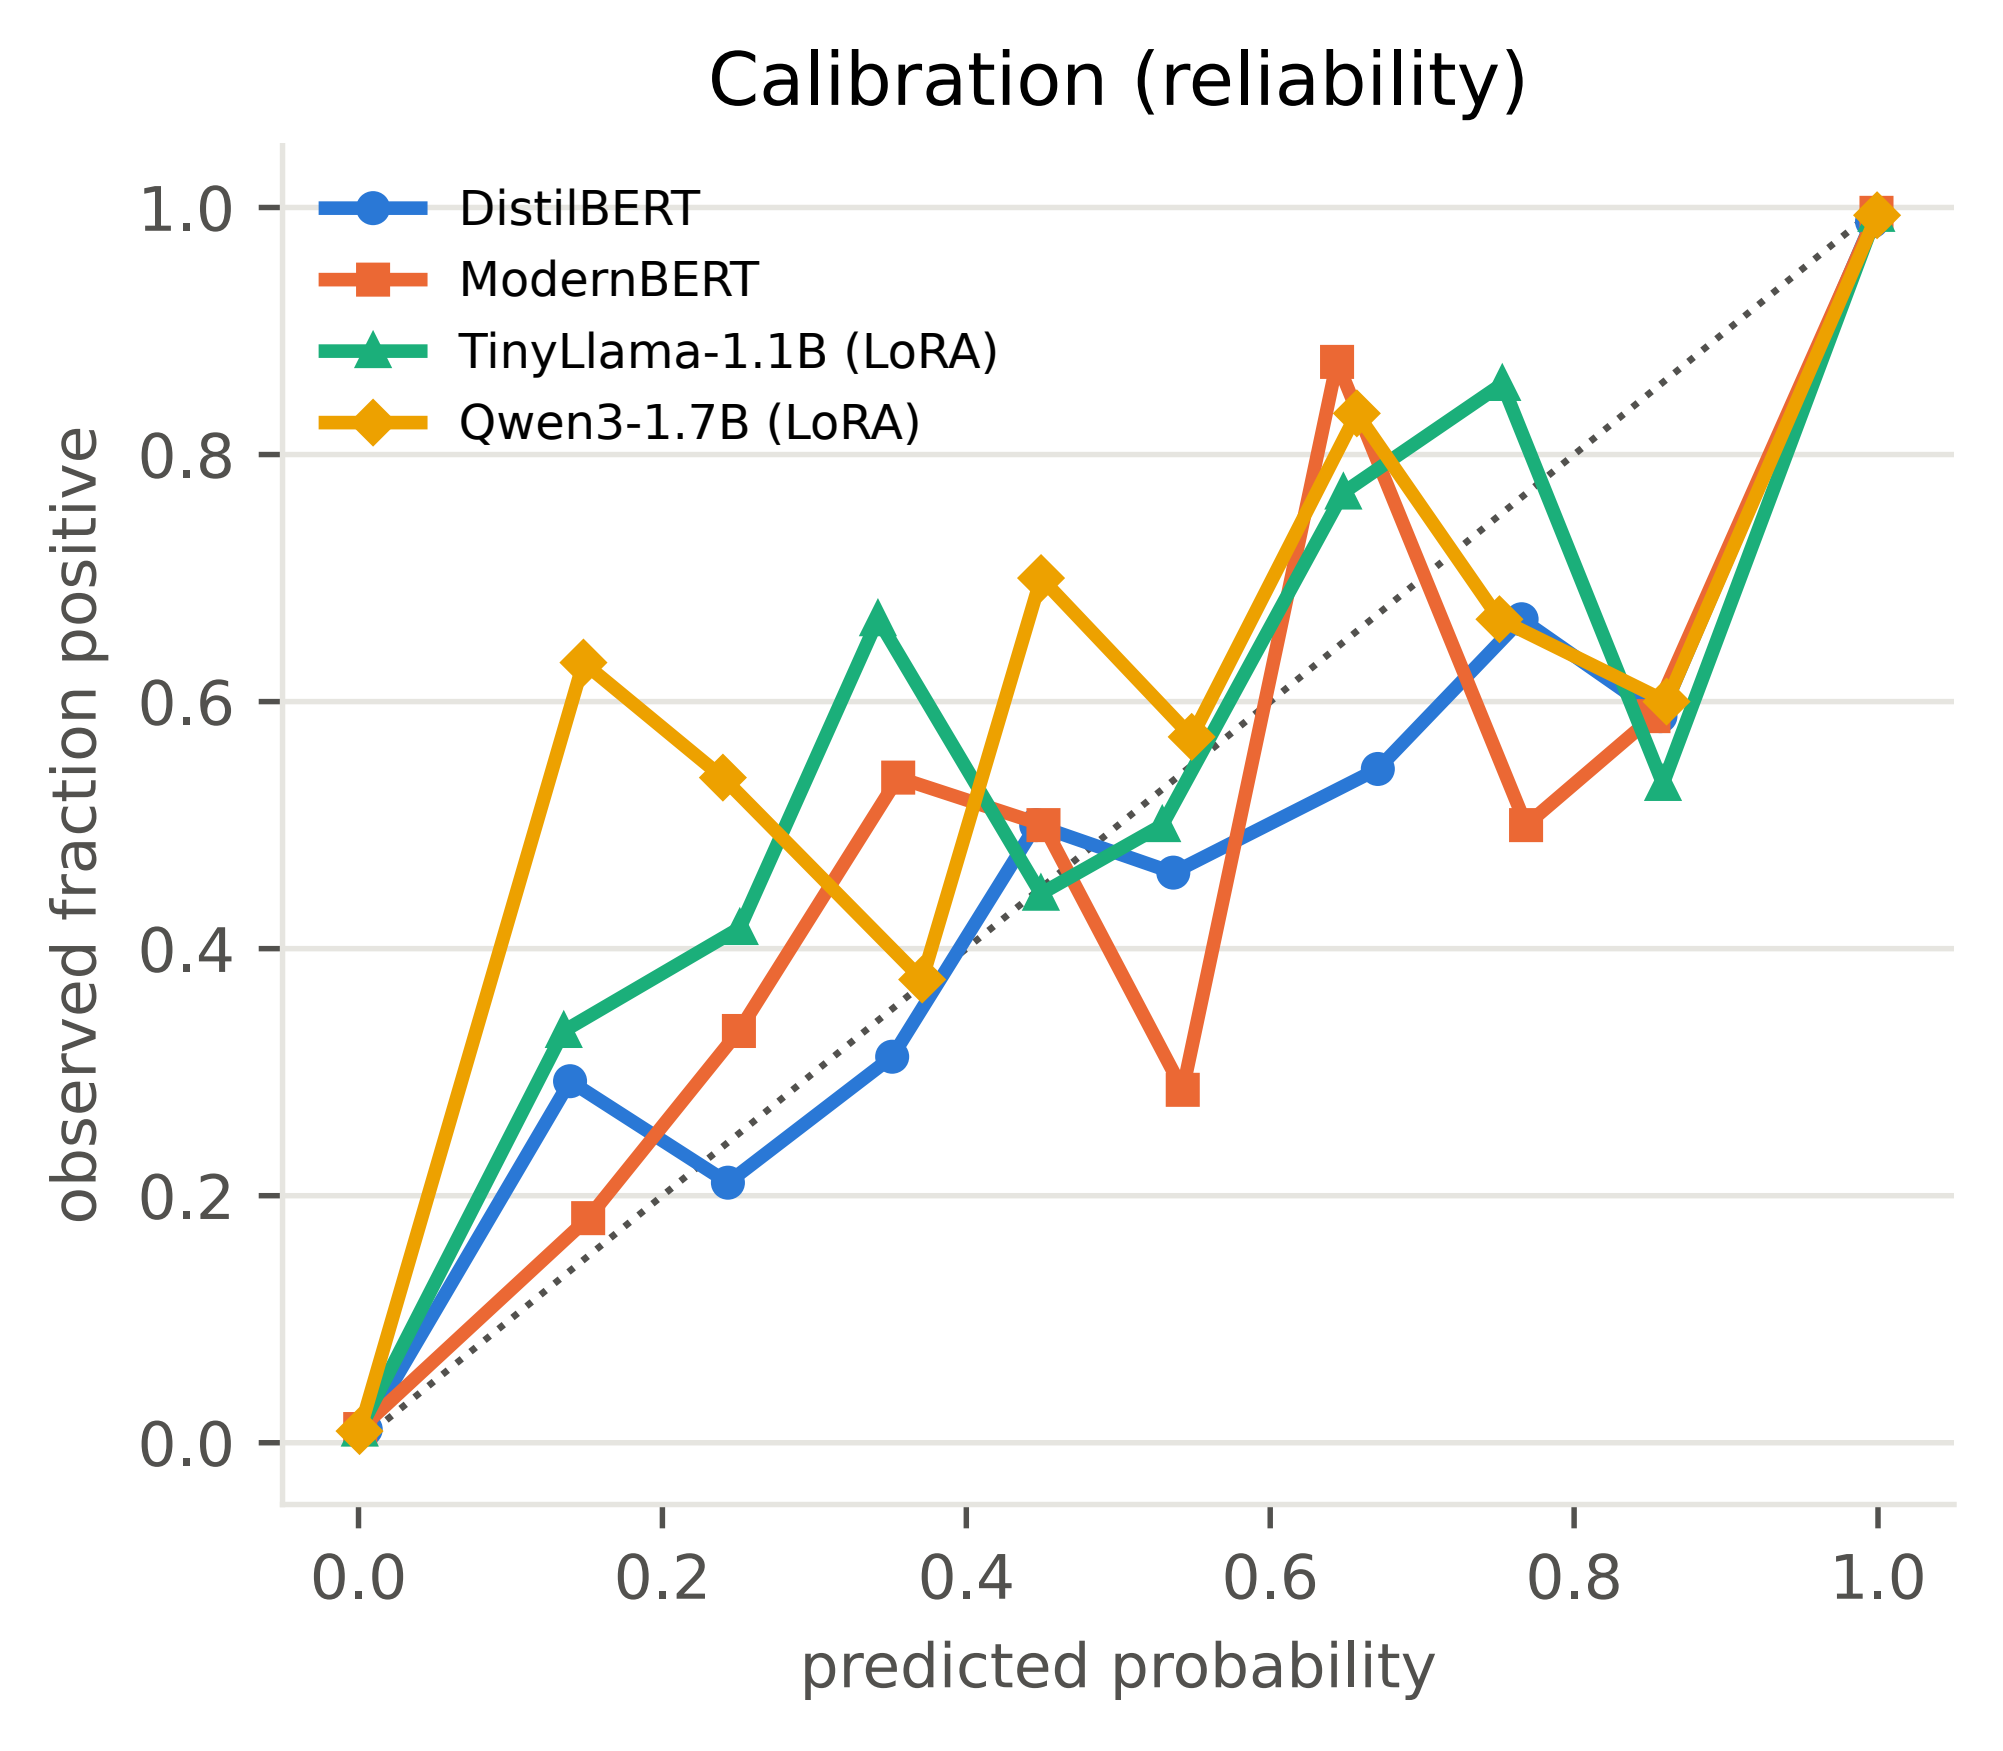
Calibration (reliability)
DistilBERT
ModernBERT
TinyLlama-1.1B (LoRA)
Qwen3-1.7B (LoRA)
observed fraction positive
predicted probability
0.0
0.2
0.4
0.6
0.8
1.0