

Figure 6: Conceptual Selective Human Escalation Architecture

(Appendix B)



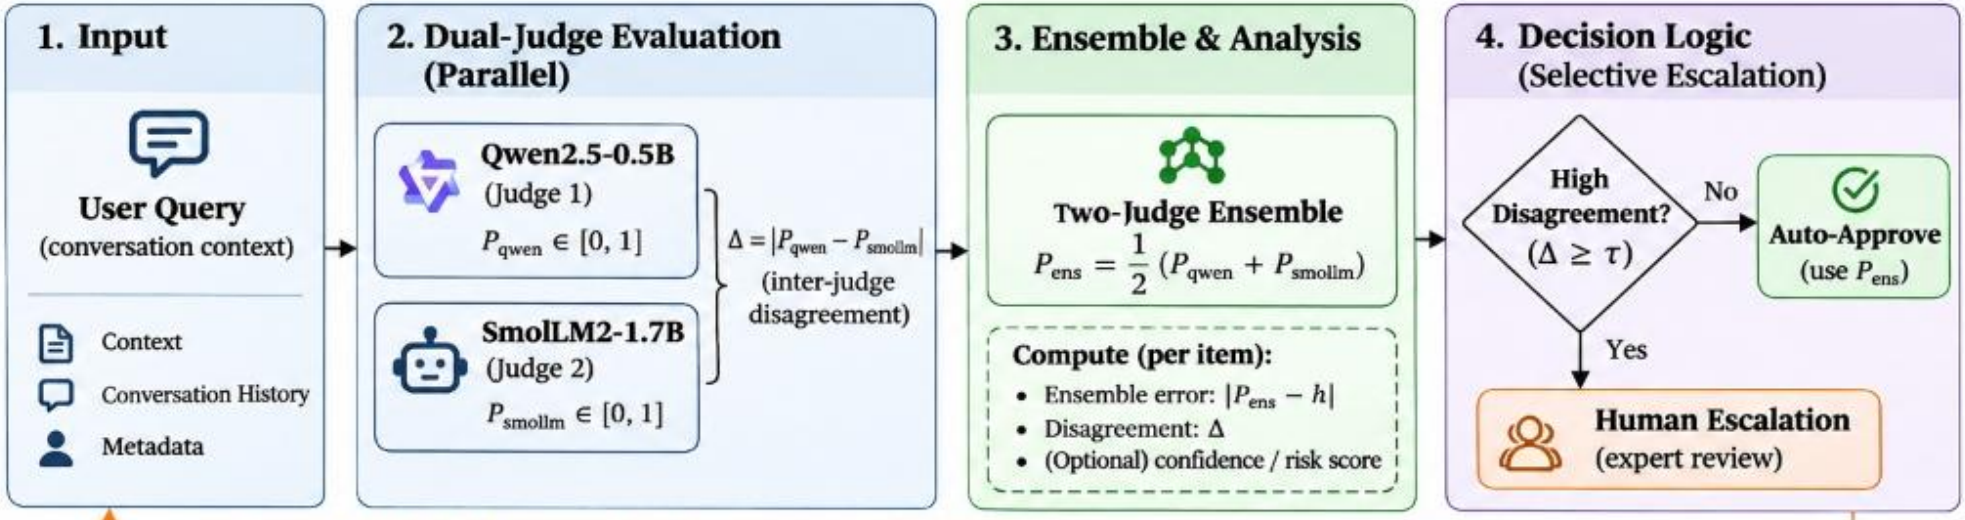

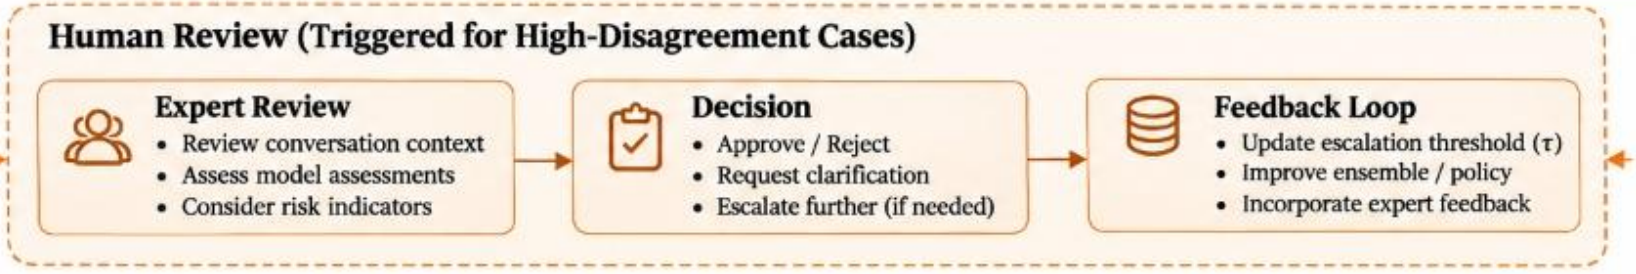

Notes: *(1) Conceptual workflow only; not an implemented or validated production system.* | *(2) τ is an uncalibrated, conceptual threshold (e.g., 0.40) and not empirically optimized.* | *(3) Low disagreement ($\Delta < \tau$) does not guarantee correctness.* | *(4) Independent out-of-domain validation is required before deployment.*