




# KPIs at district-level

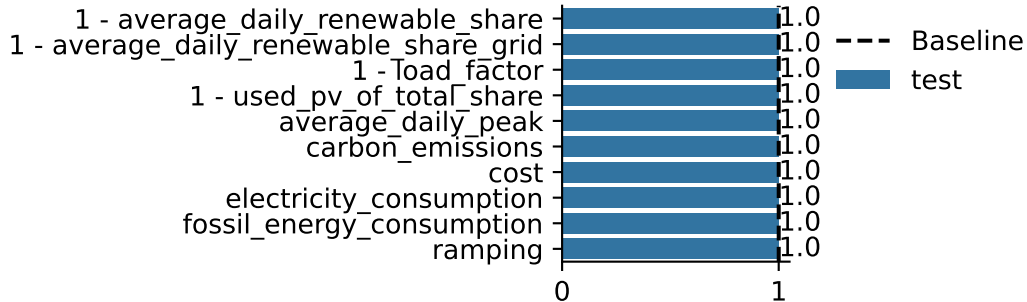


# KPIs at district-level

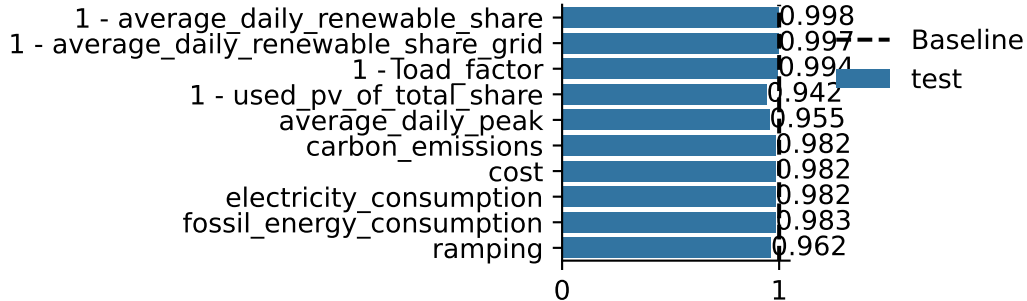


# KPIs at district-level

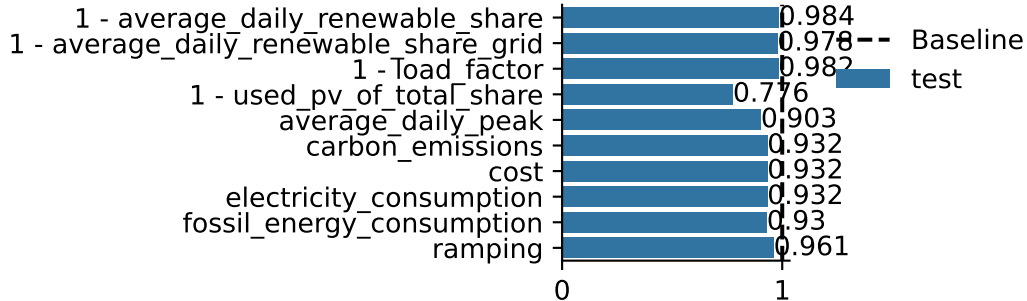


# KPIs at district-level

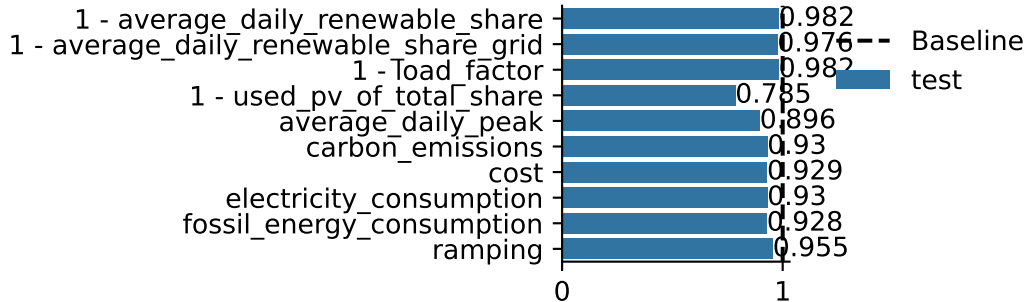


# KPIs at district-level

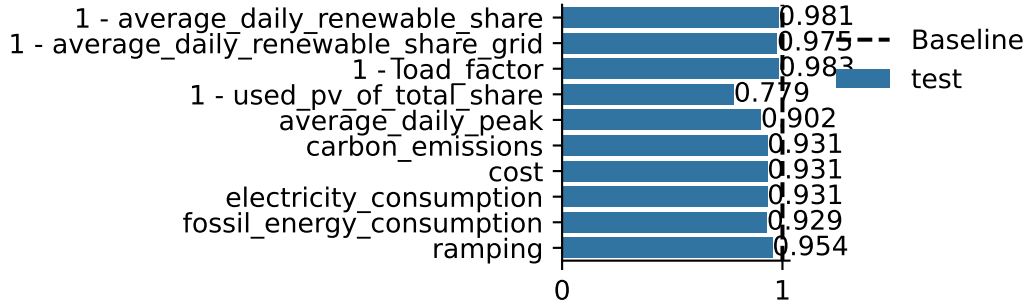







# KPIs at district-level

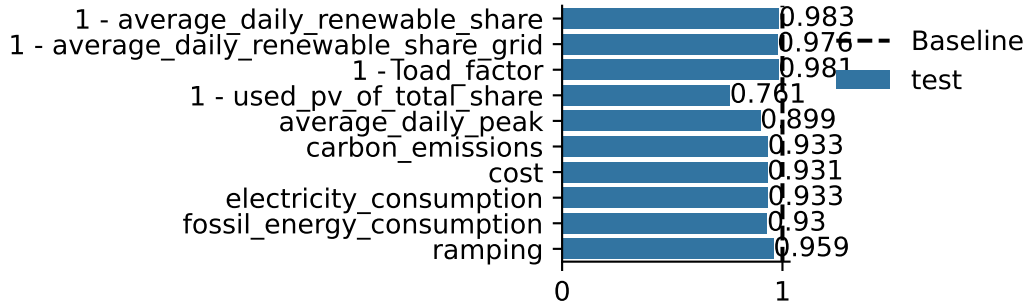

# KPIs at building-level






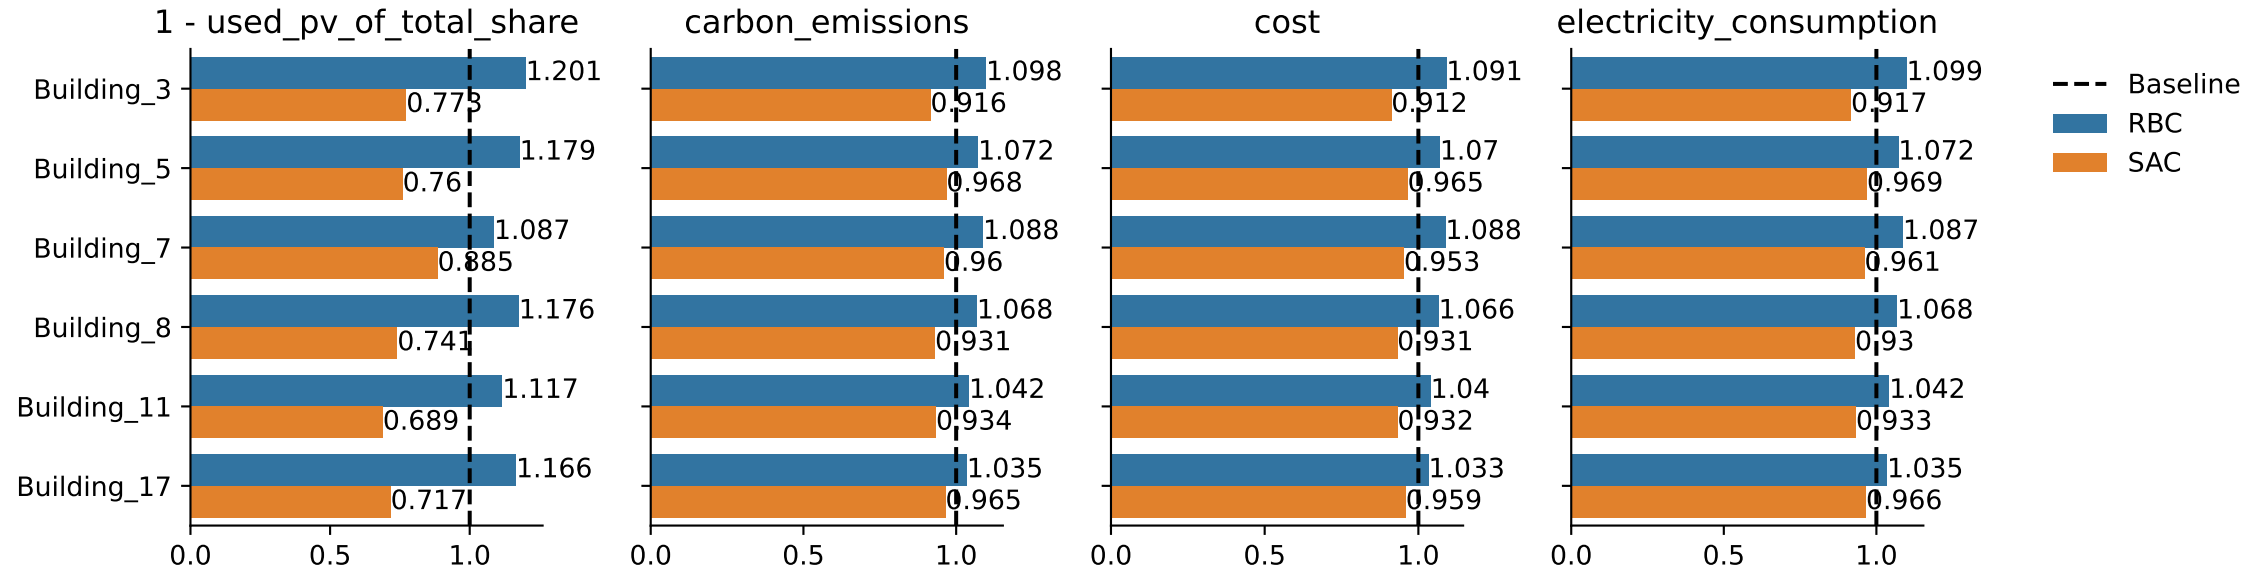


# Building-level net electricity consumption profile

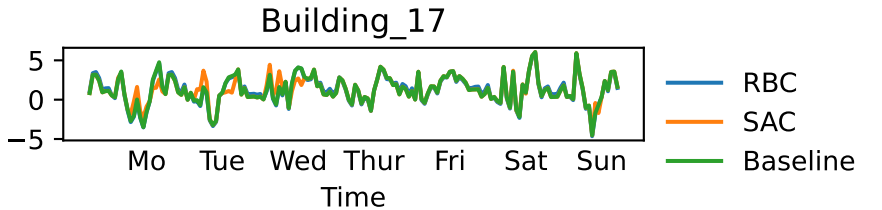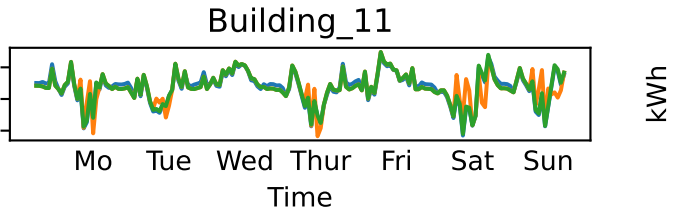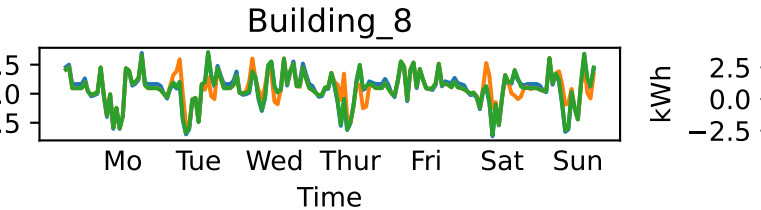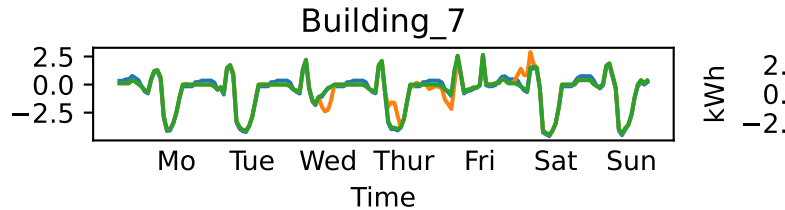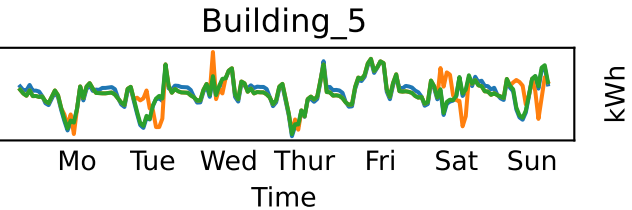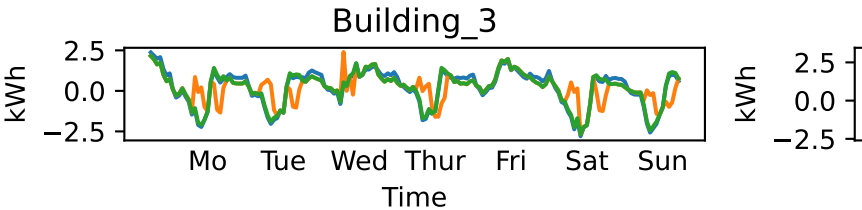





# Building-level battery SoC profiles

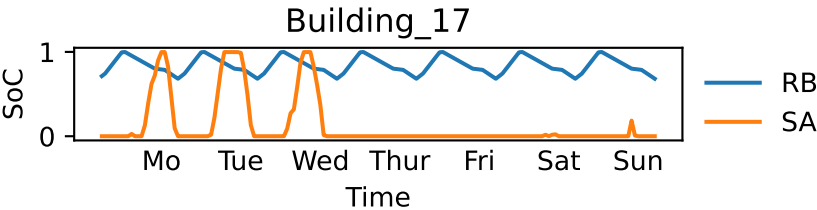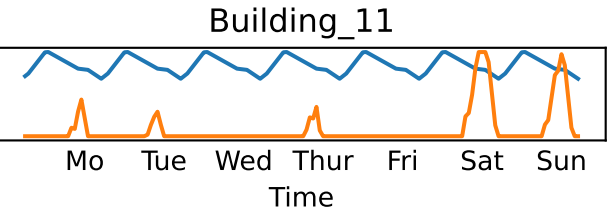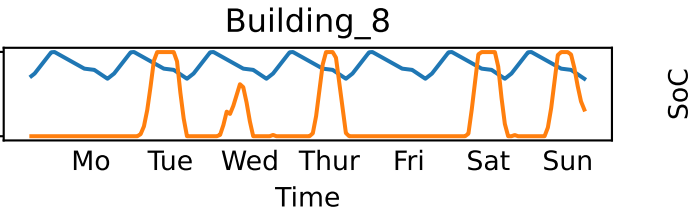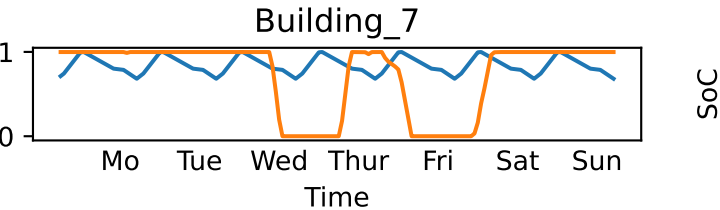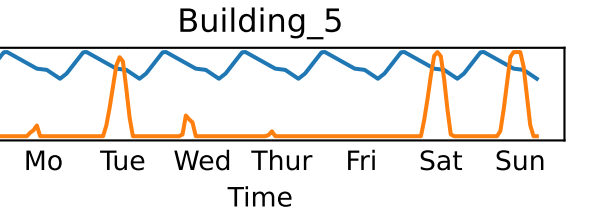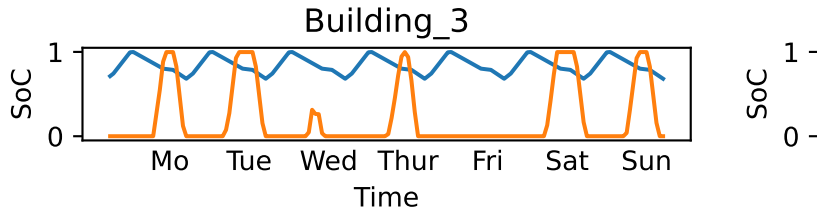


# KPIs at district-level

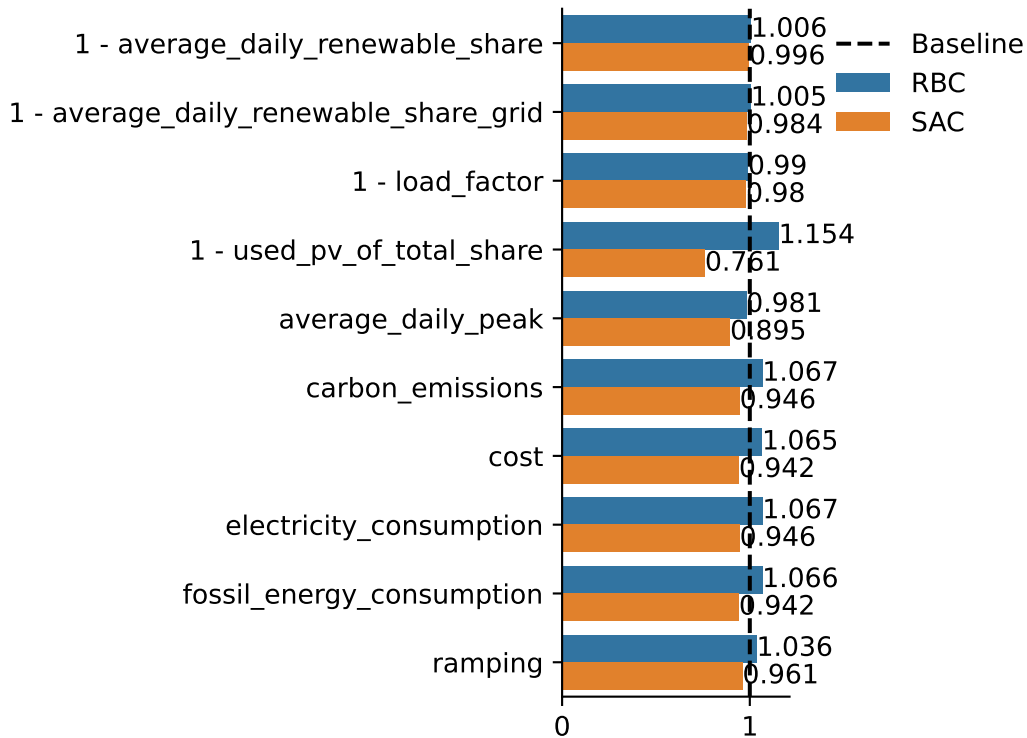


# District-level net electricity consumption profile

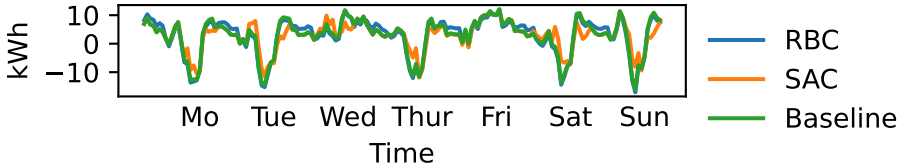


Used PV / available share (Building\_3)

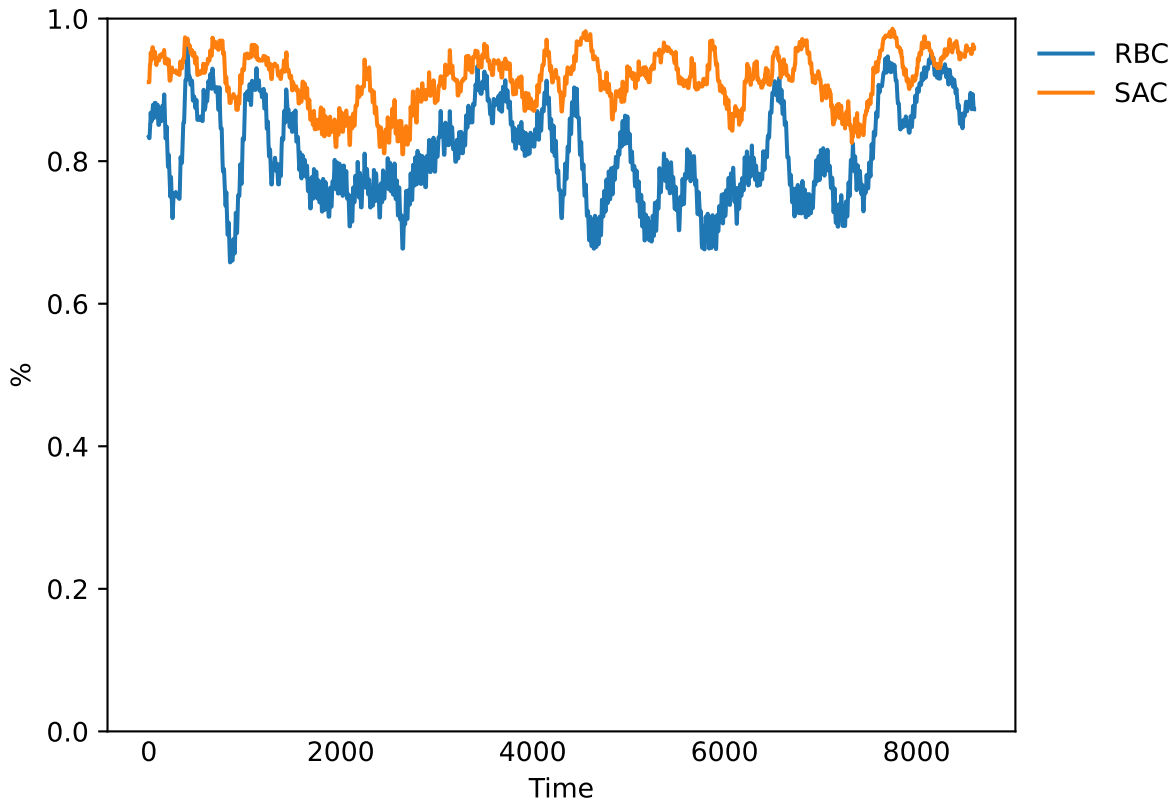


Used PV / available share (Building\_5)

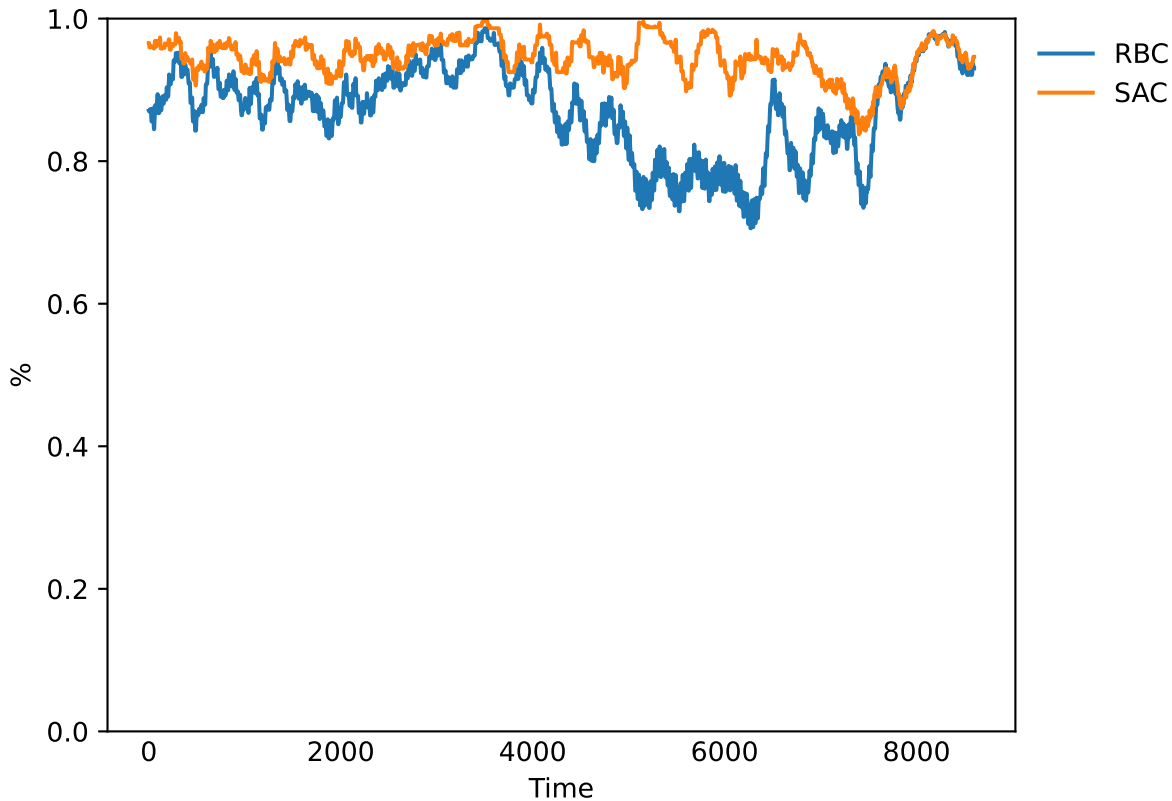


Used PV / available share (Building\_7)

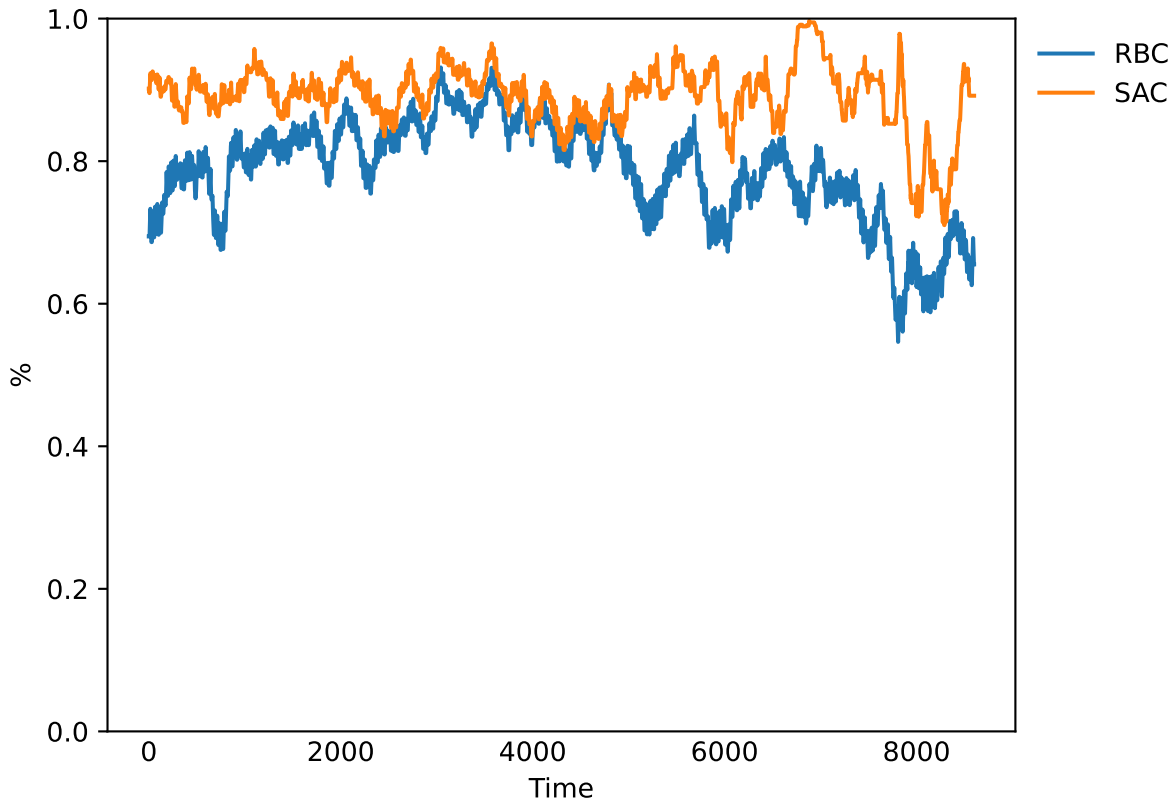

Used PV / available share (Building\_8)

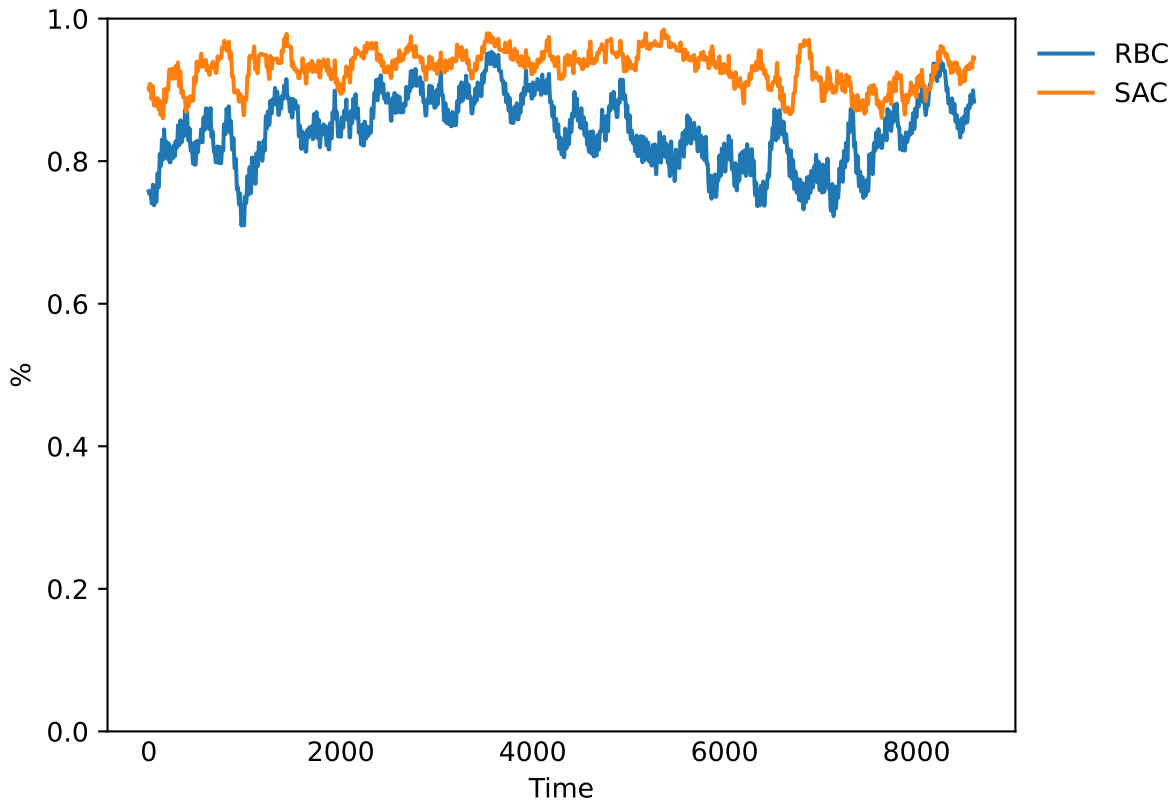


Used PV / available share (Building\_11)

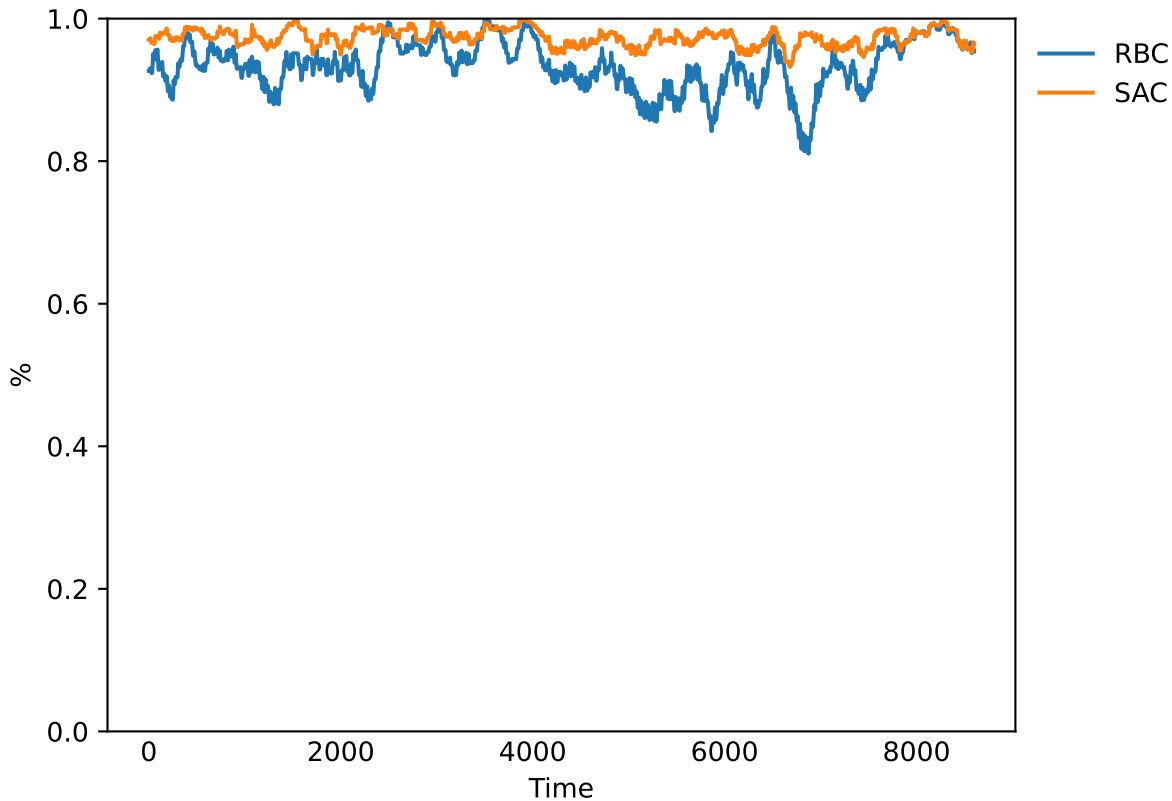





Used PV / available share (Building\_17)

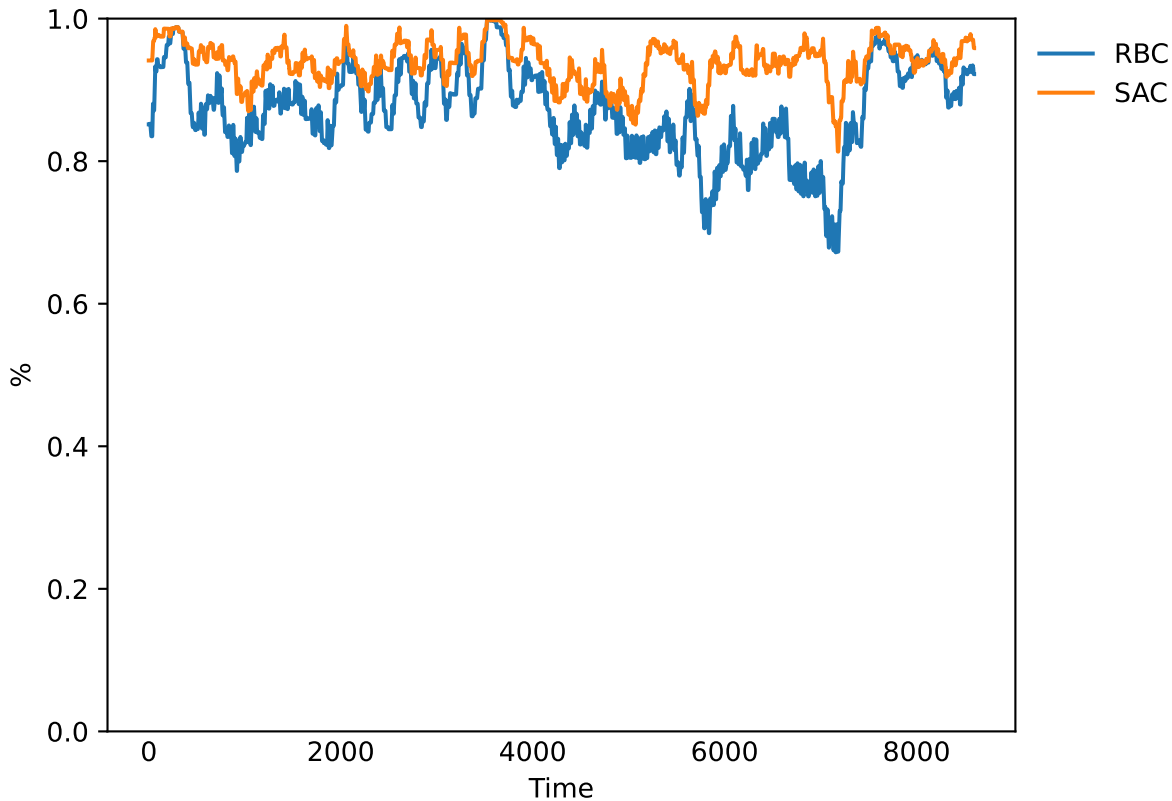


District-level used renewable energy grid / available

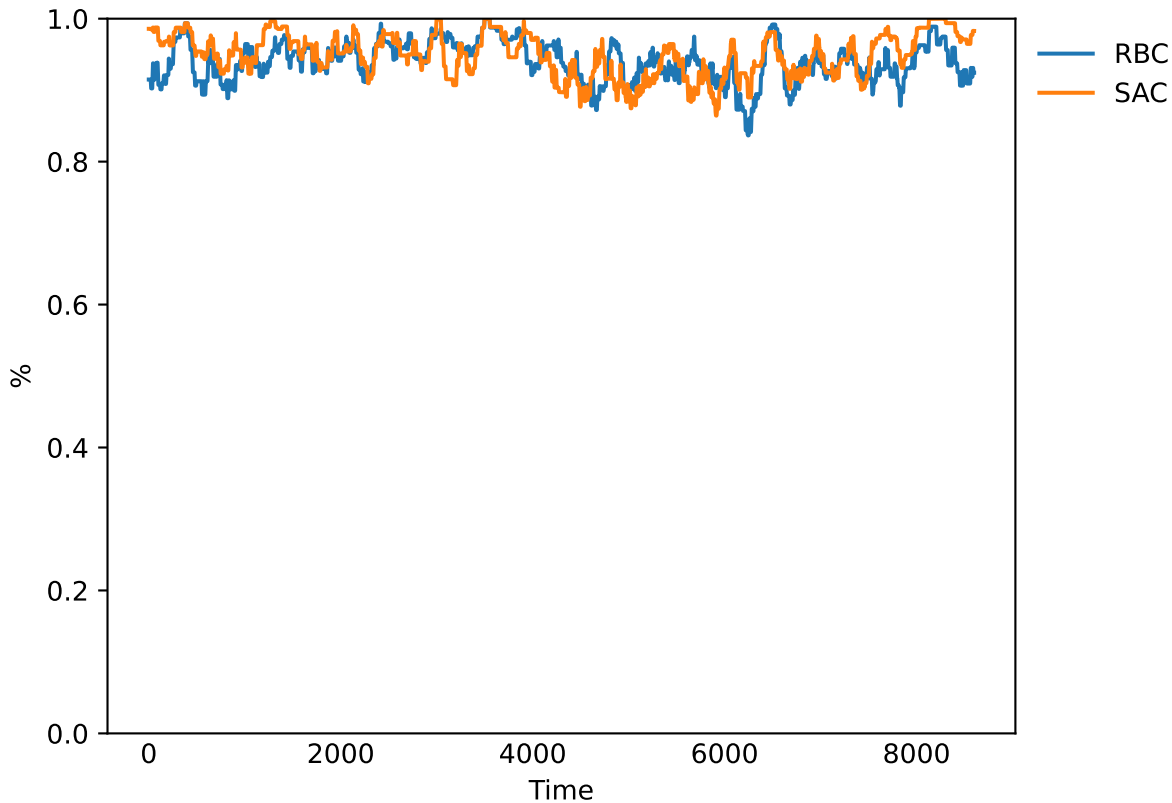


District-level used renewable energy / available

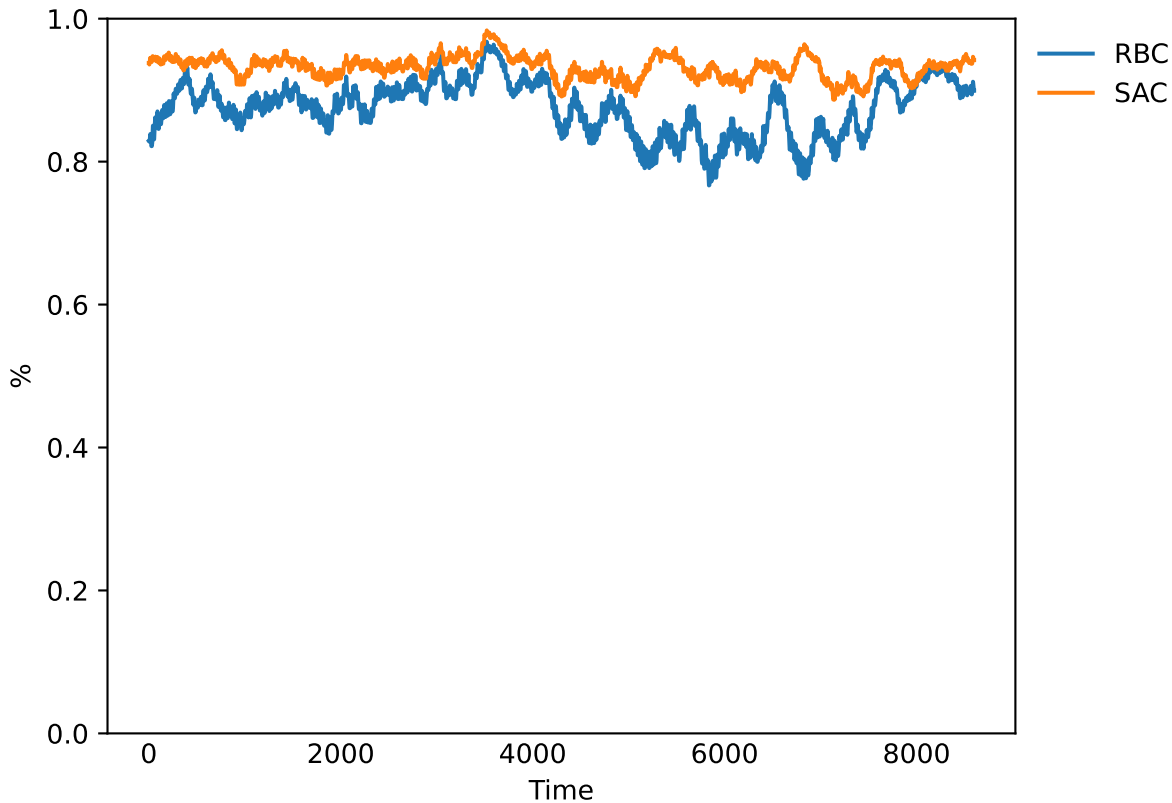


# District-level fossil energy consumption

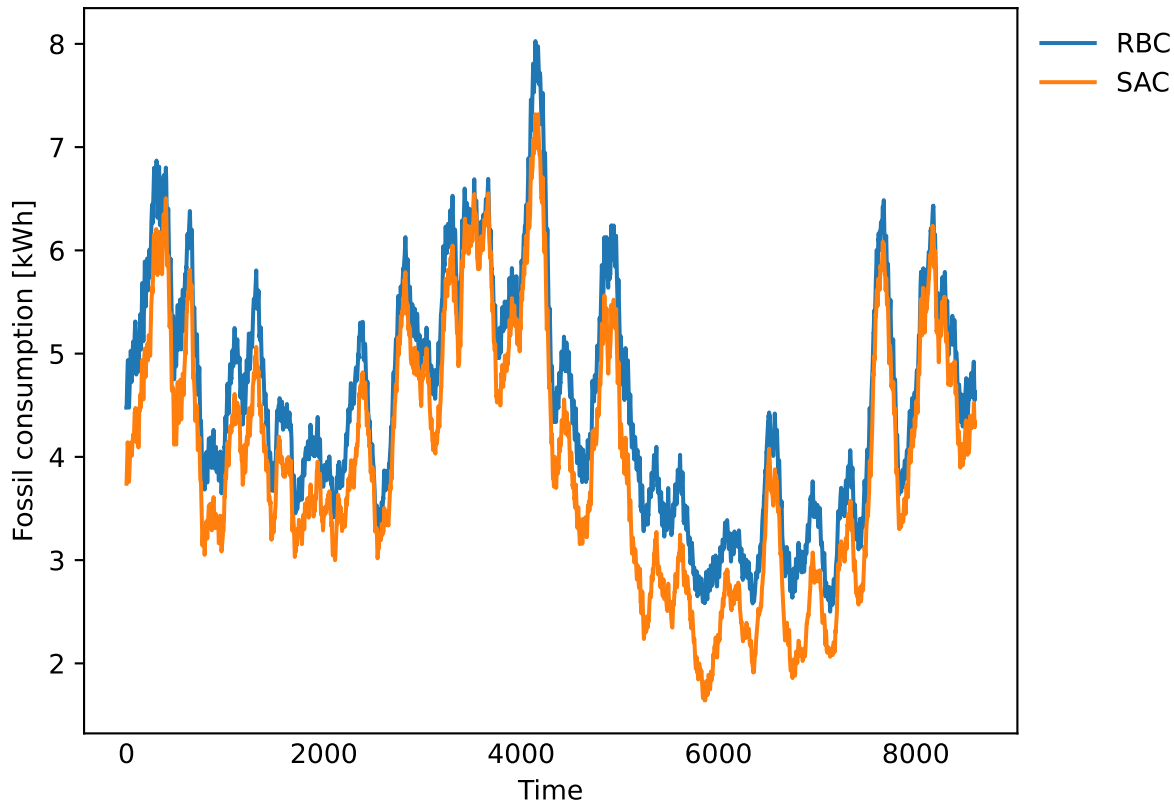


SAC - Building\_3 loss values

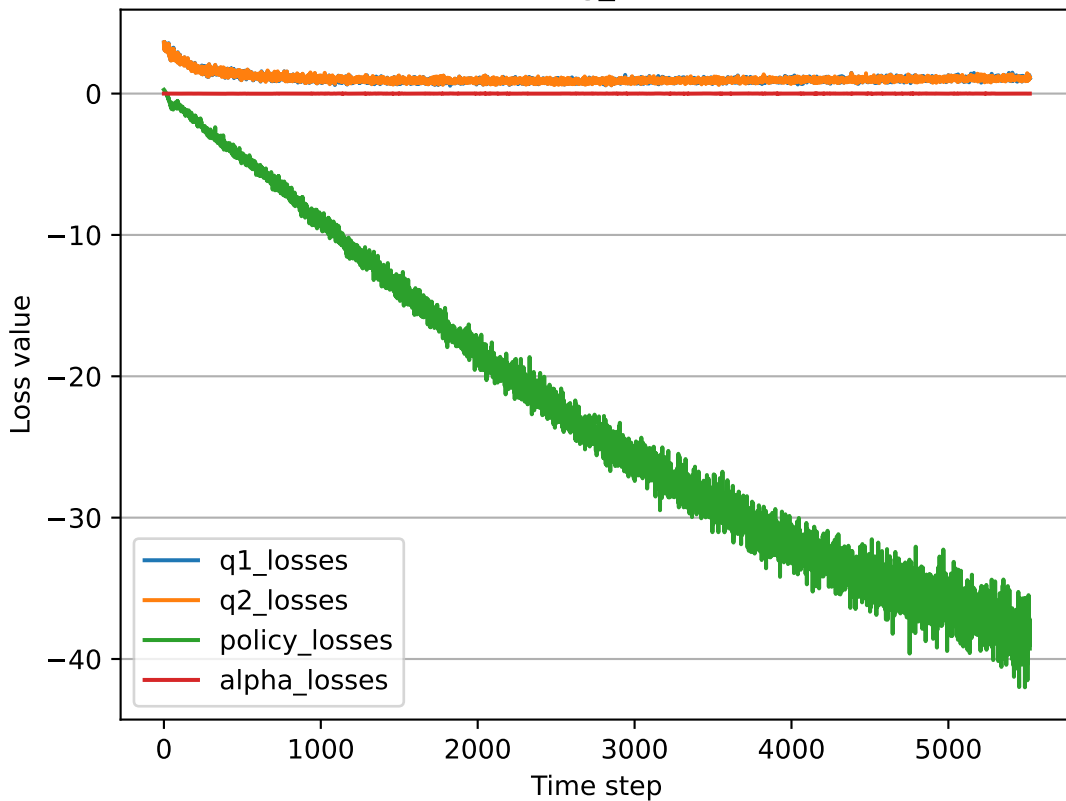


SAC - Building\_5 loss values

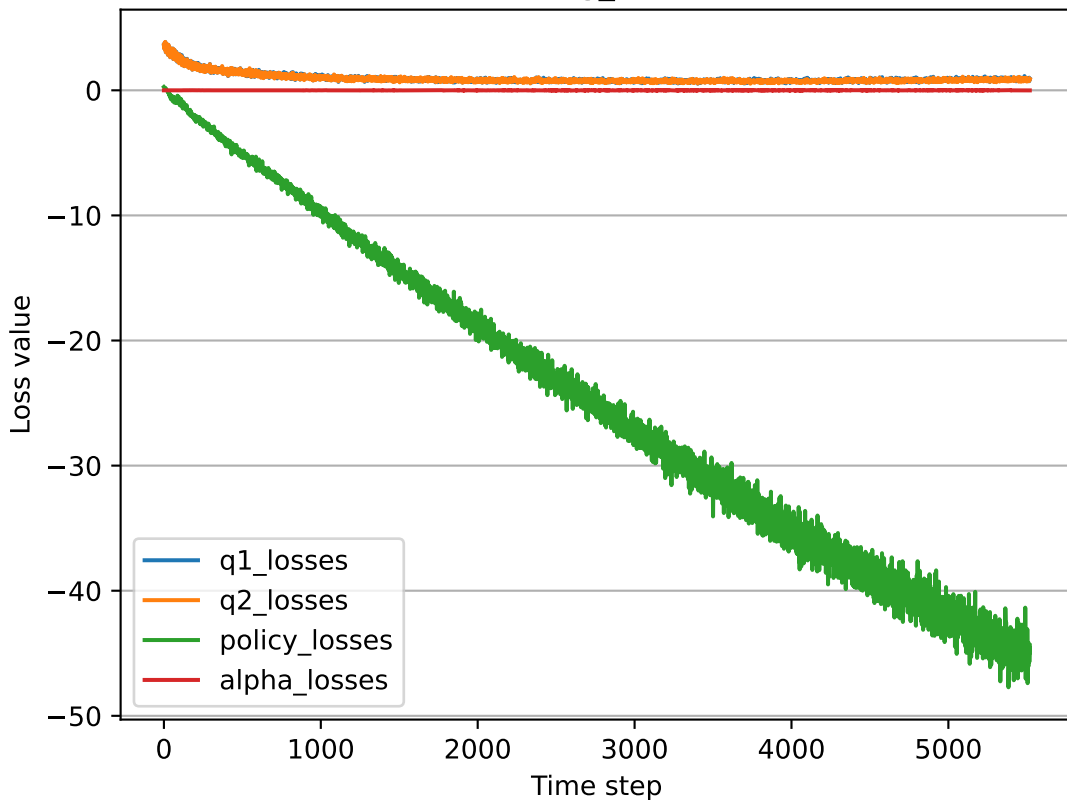

SAC - Building\_7 loss values

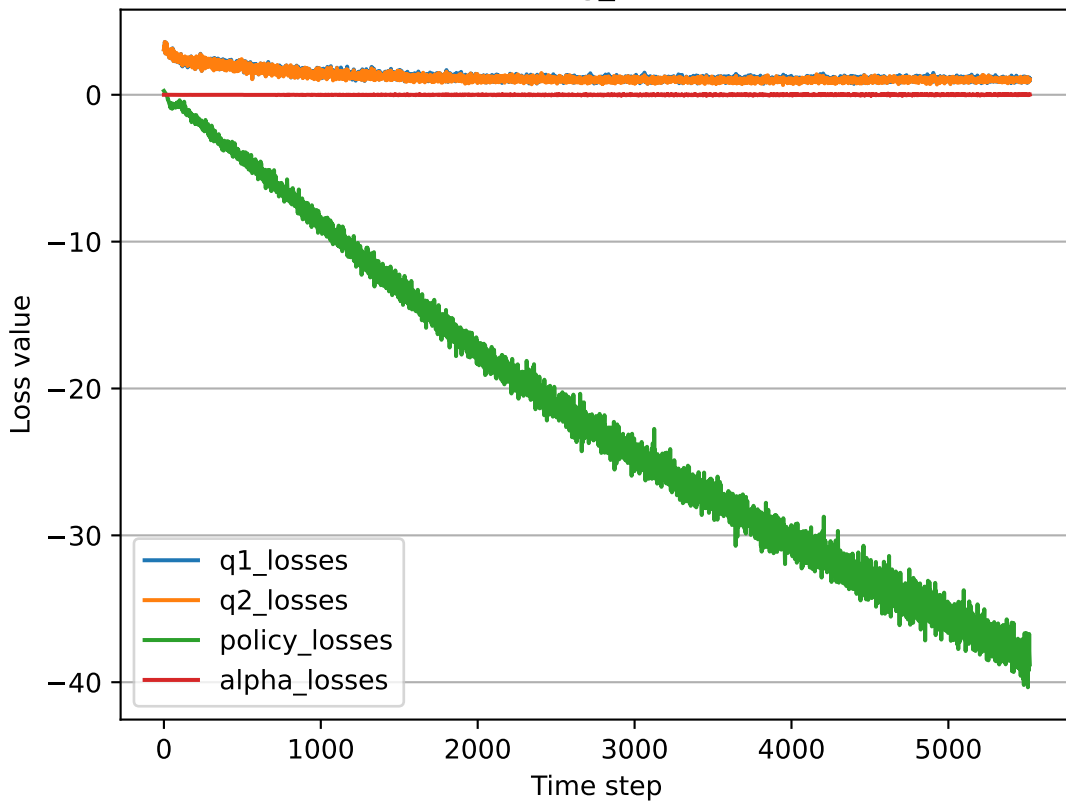


SAC - Building\_8 loss values

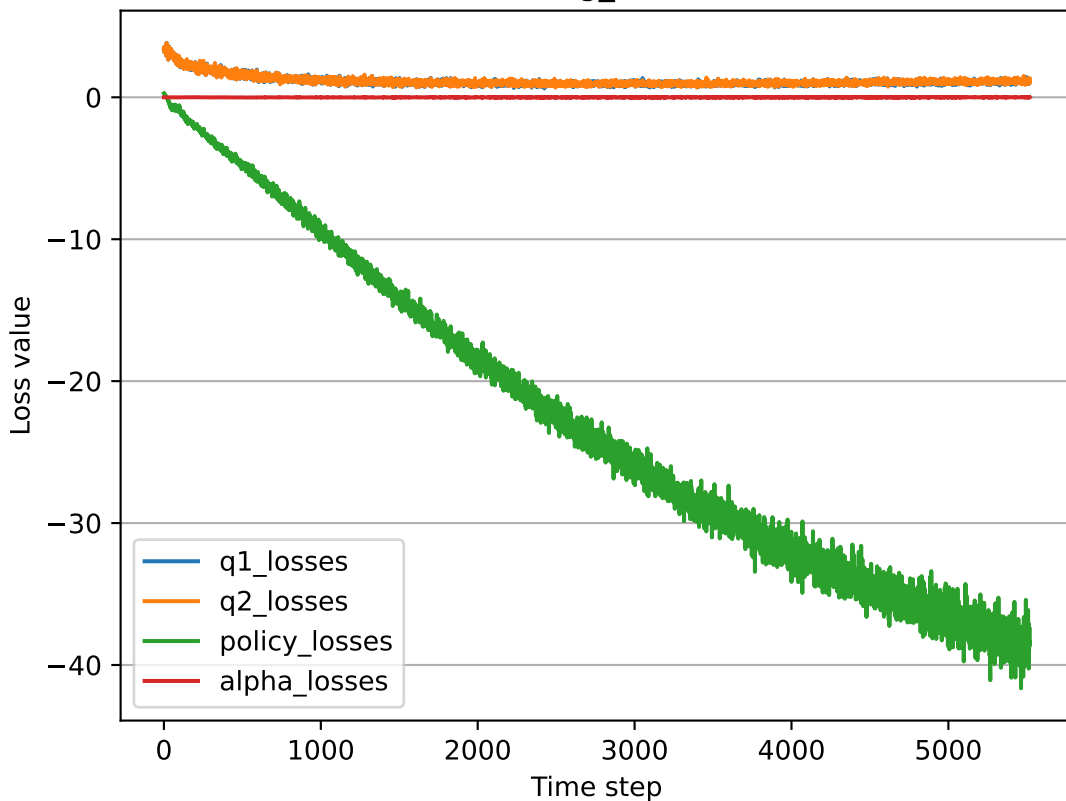





SAC - Building\_11 loss values

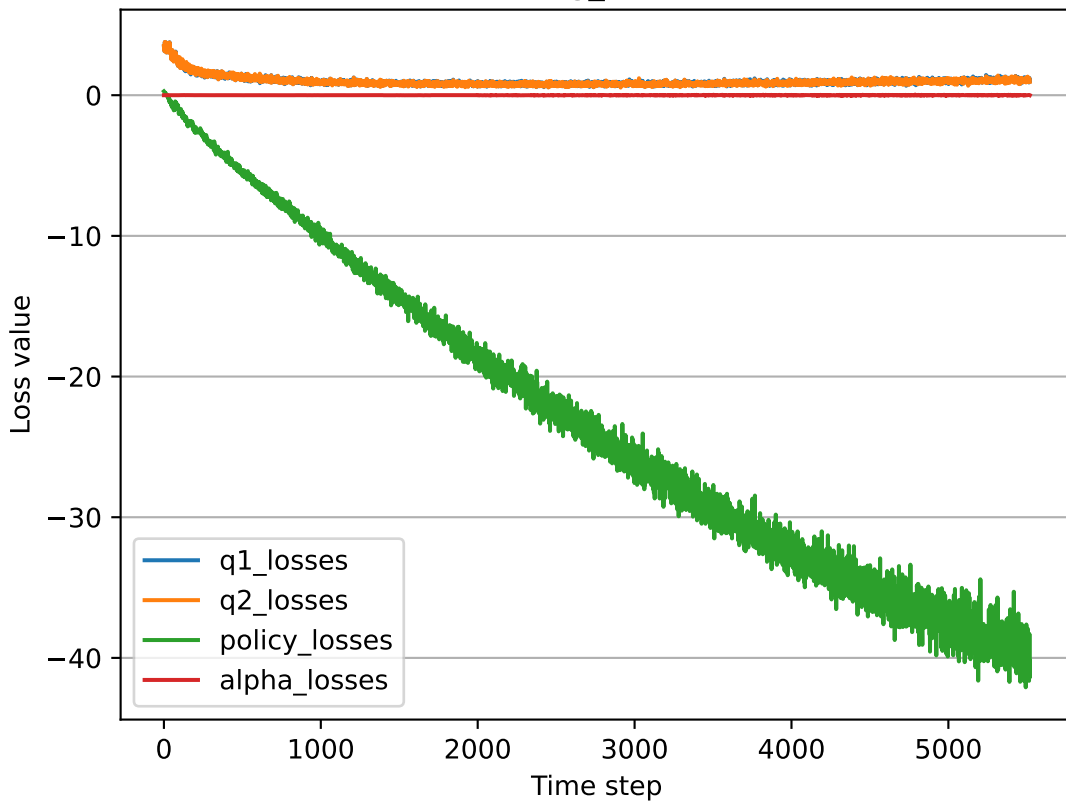


SAC - Building\_17 loss values

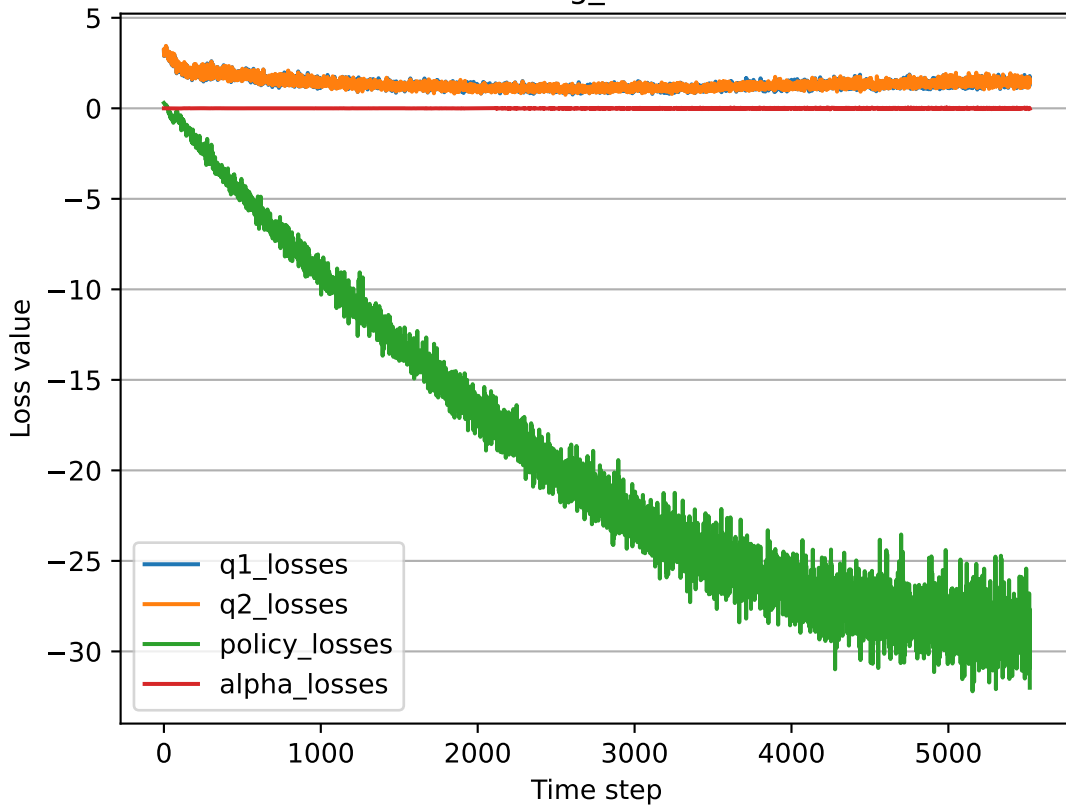


SAC - Building\_3 reward values

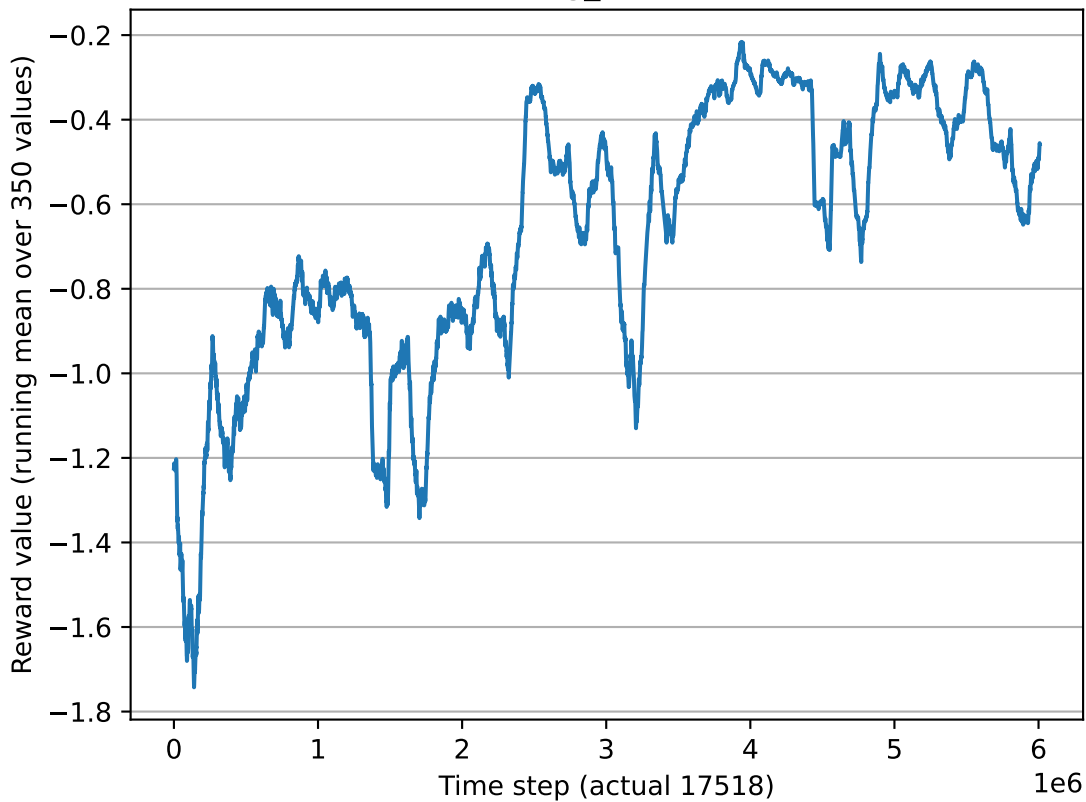


SAC - Building\_5 reward values

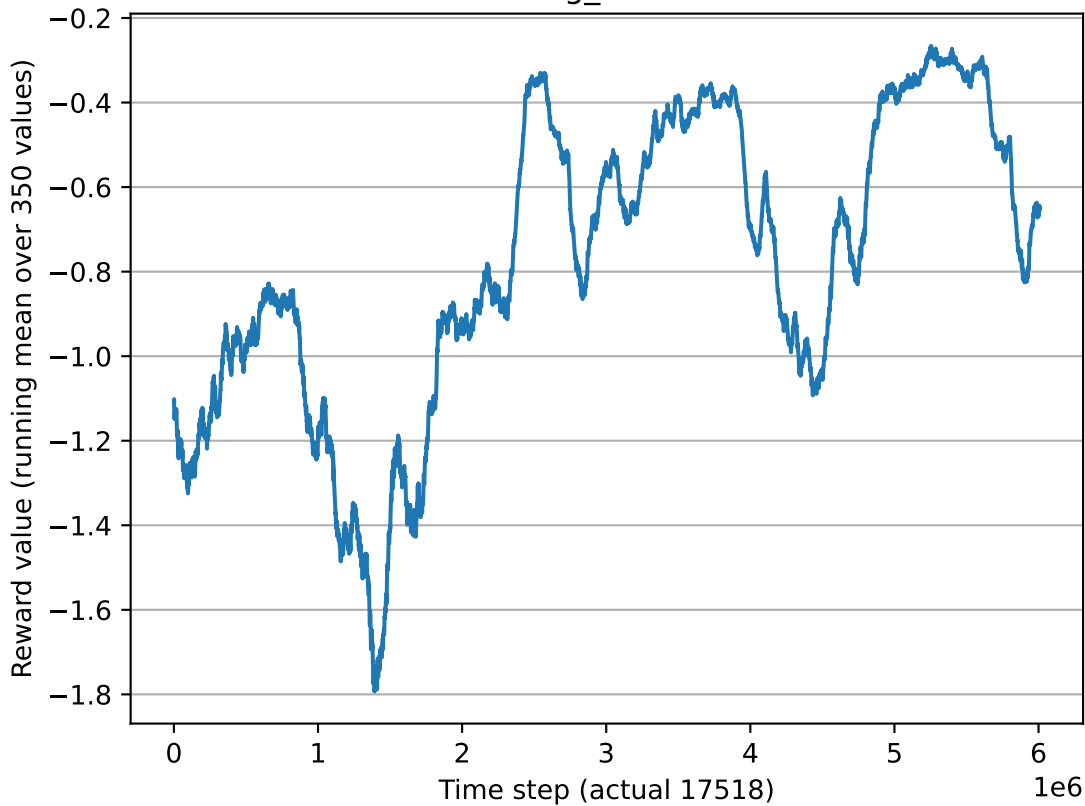


SAC - Building\_7 reward values

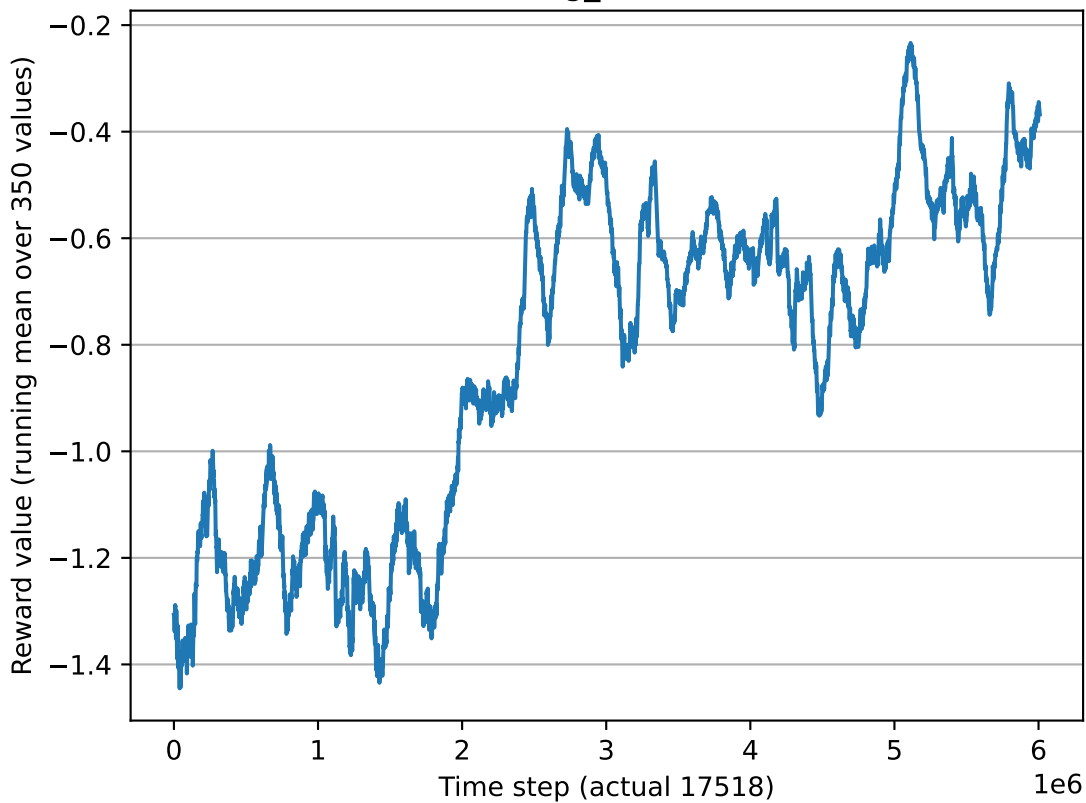


SAC - Building\_8 reward values

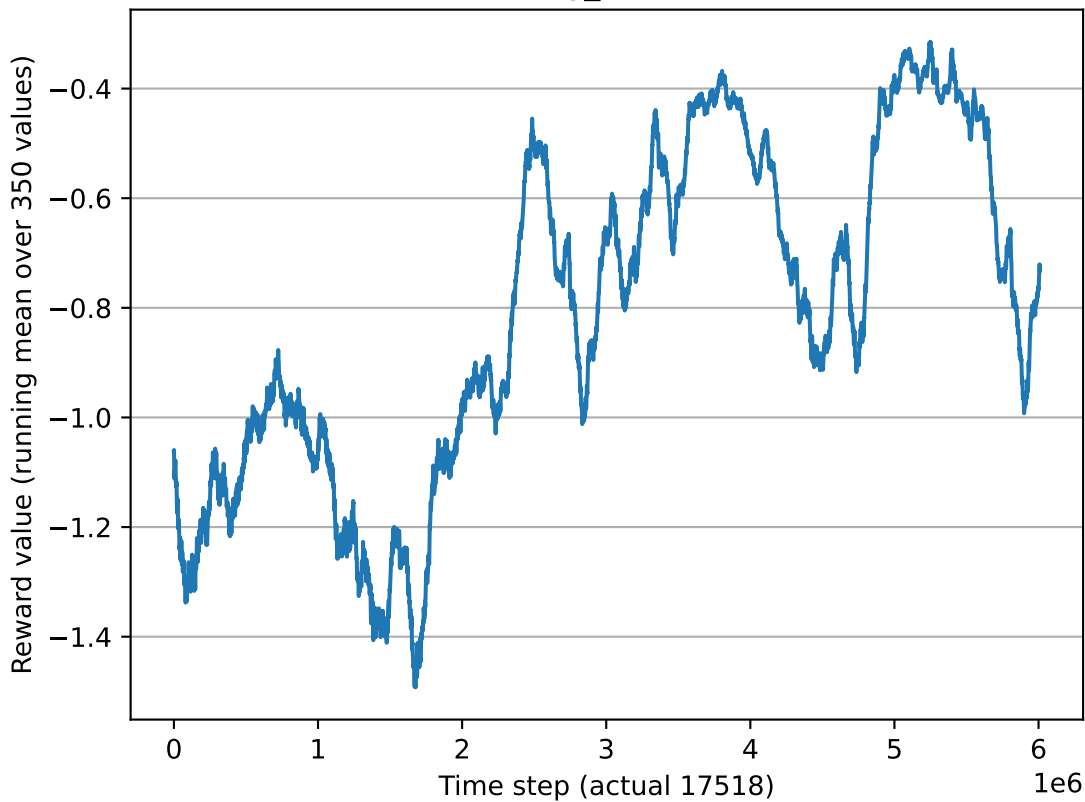

SAC - Building\_11 reward values

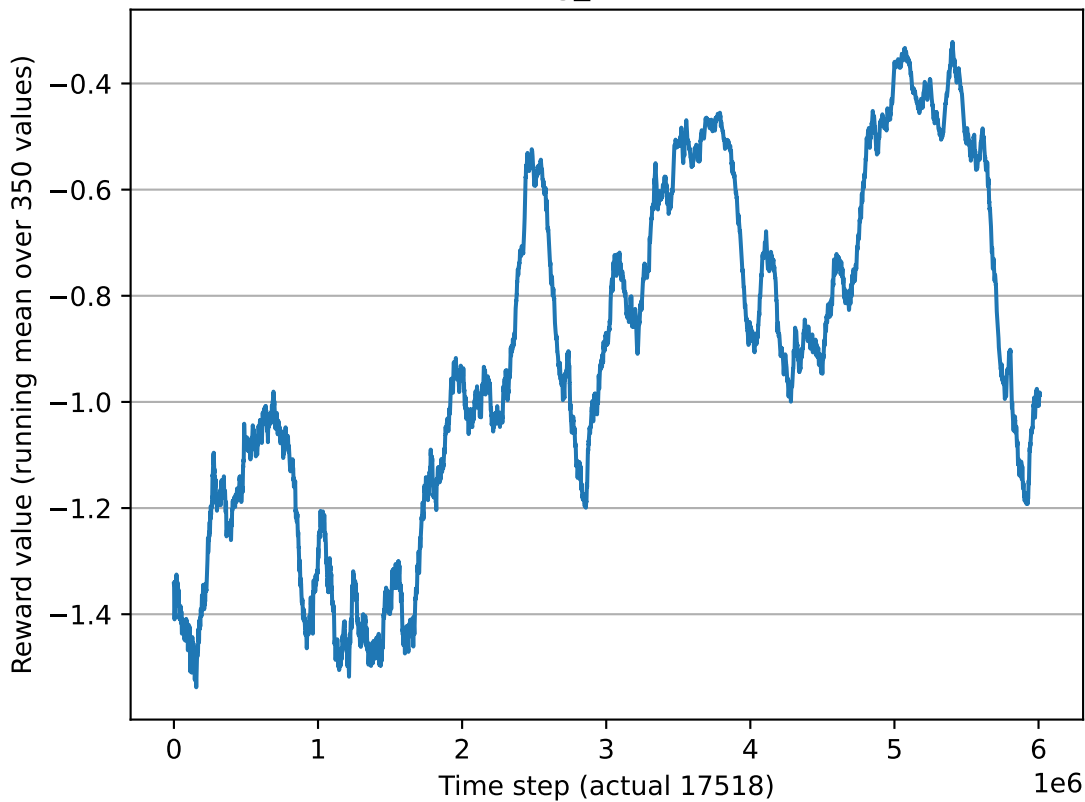

SAC - Building\_17 reward values

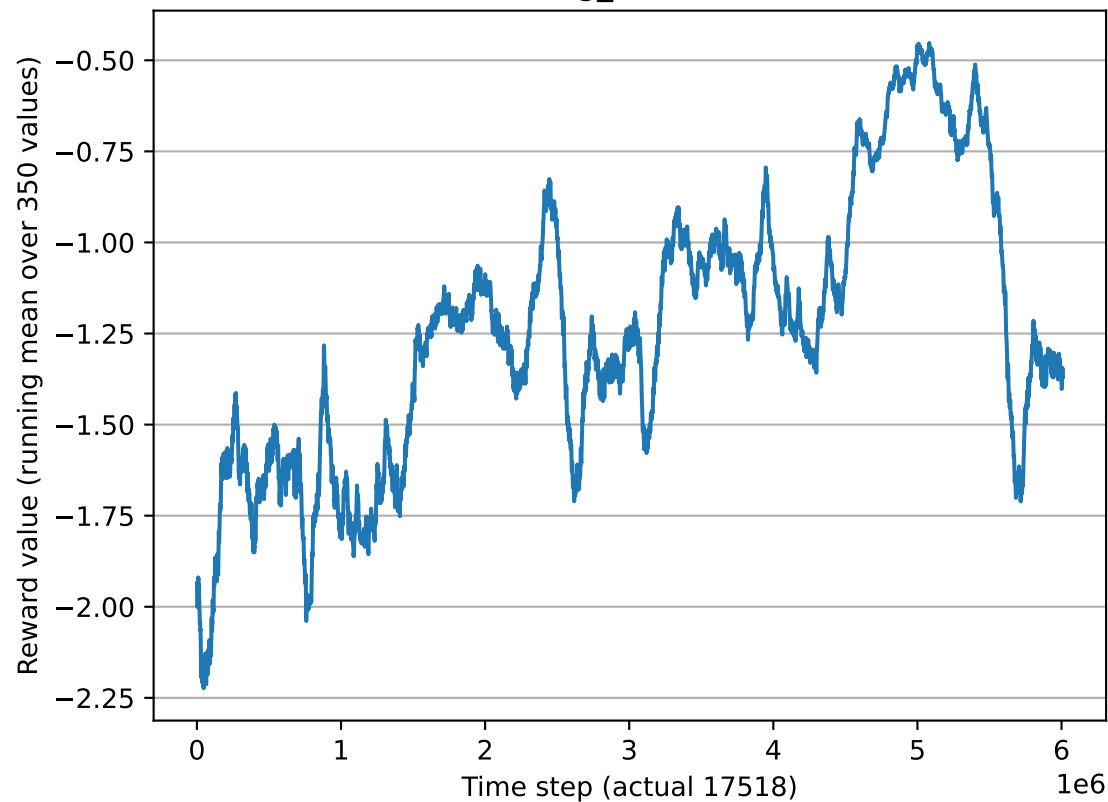



SAC evaluation results during training

