


Install Base Report




Site: ABC Facility/nAddress: 1234 Example Street/nContact: +1 234 567 890


Total Instruments by Manufacturer

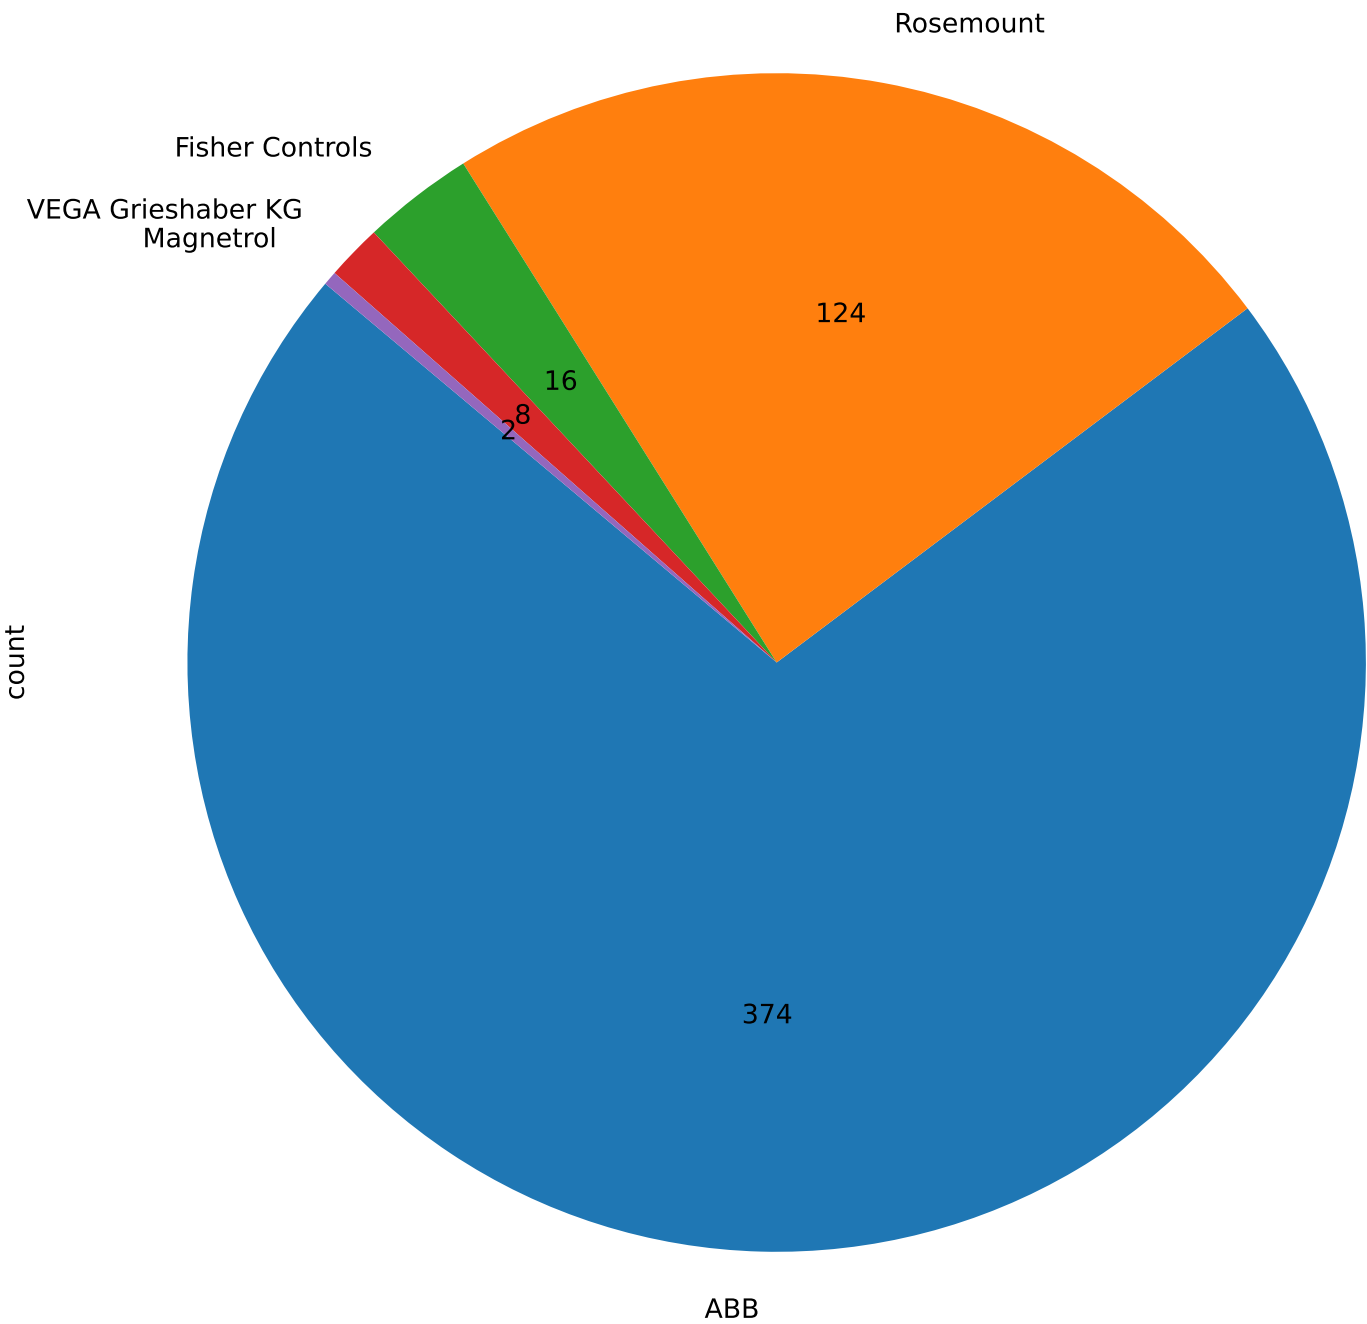


Total Instruments by Protocol

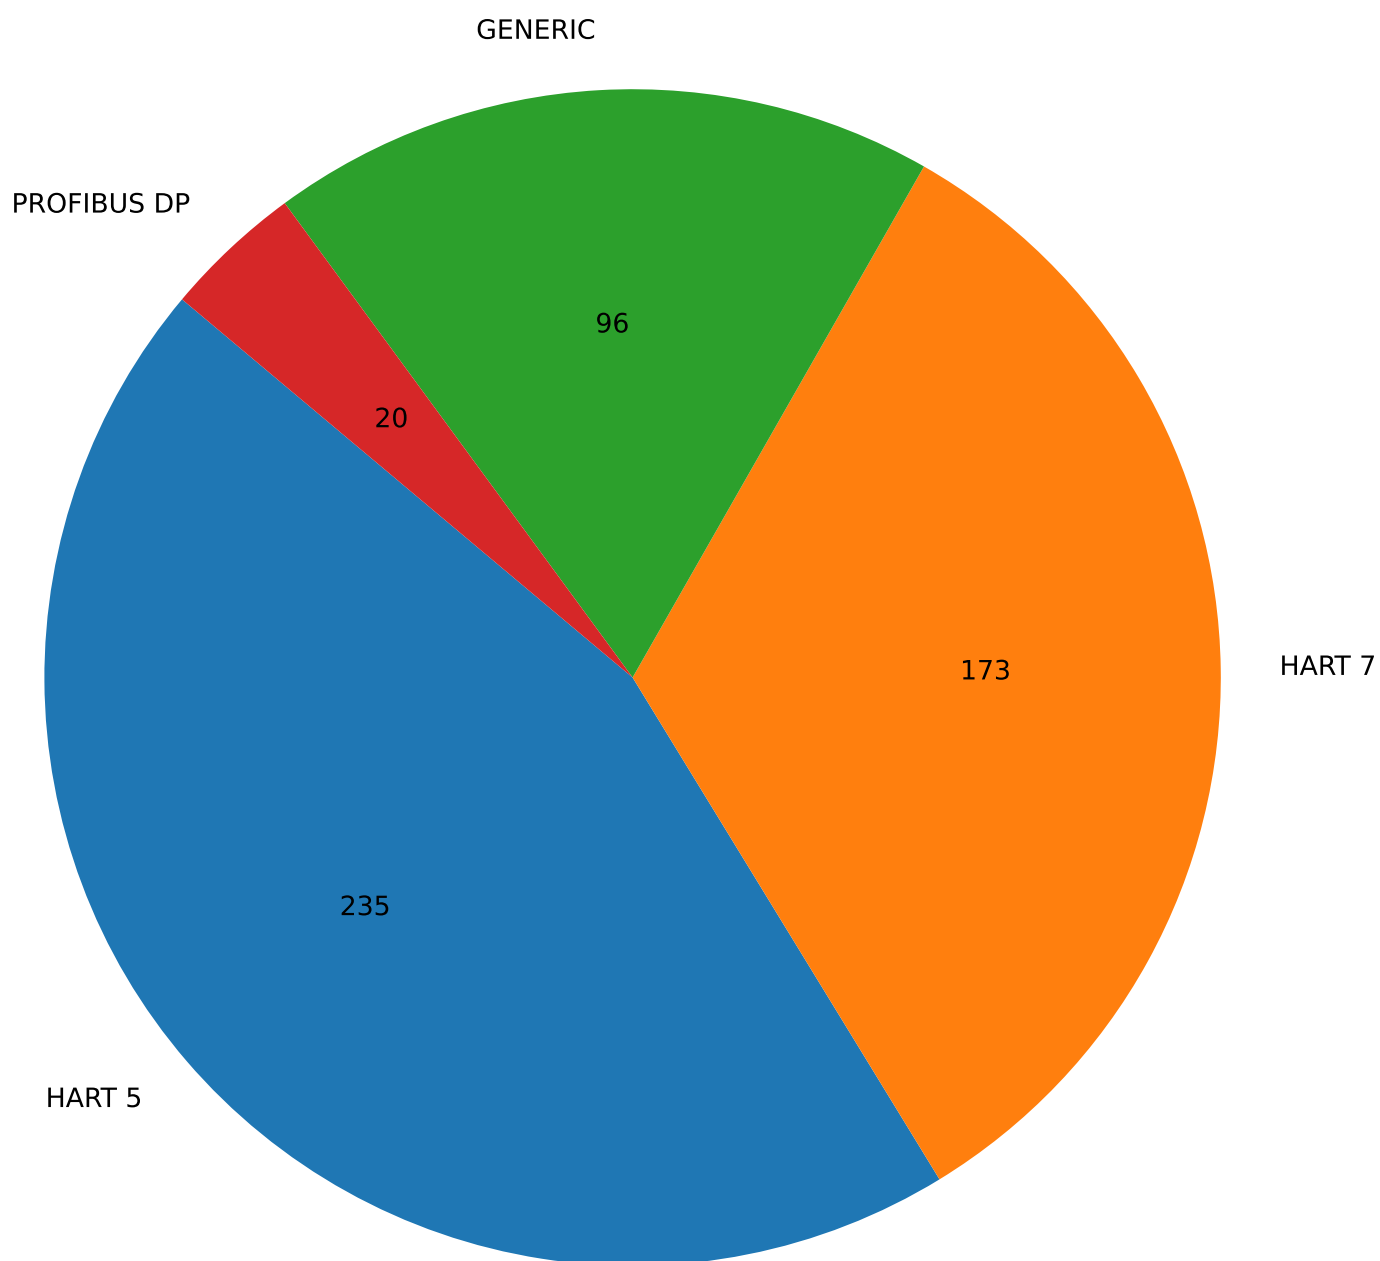

HART Instruments by Manufacturer

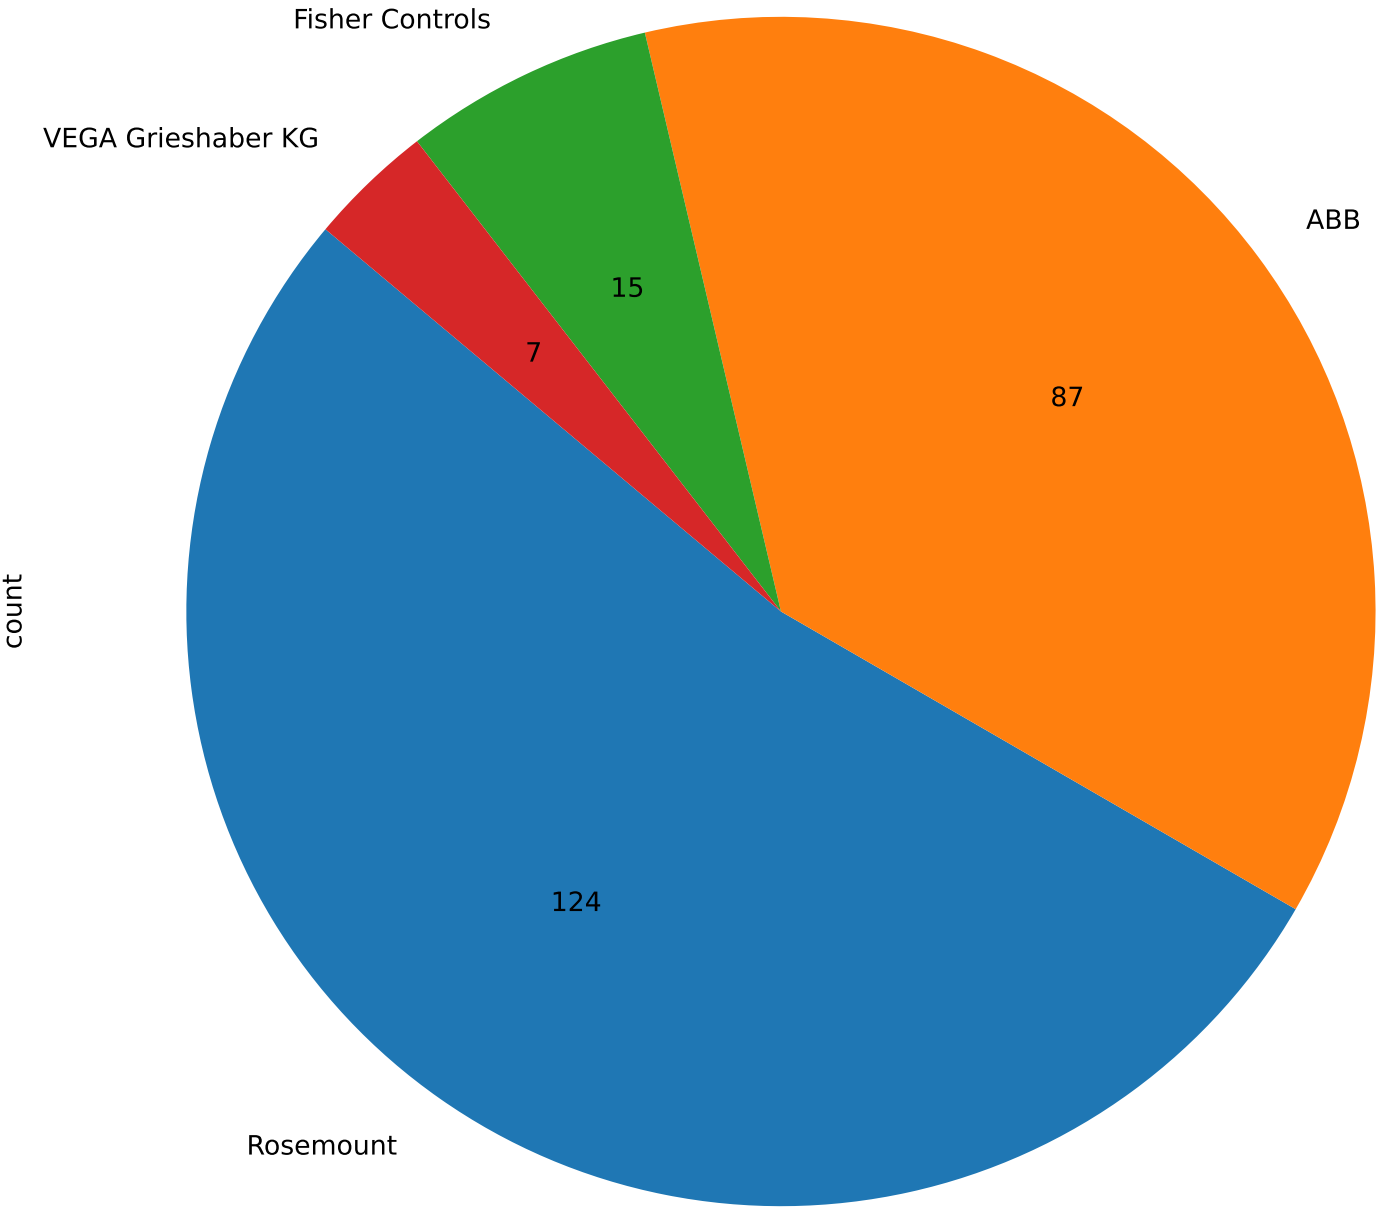

HART Instruments by Device Type

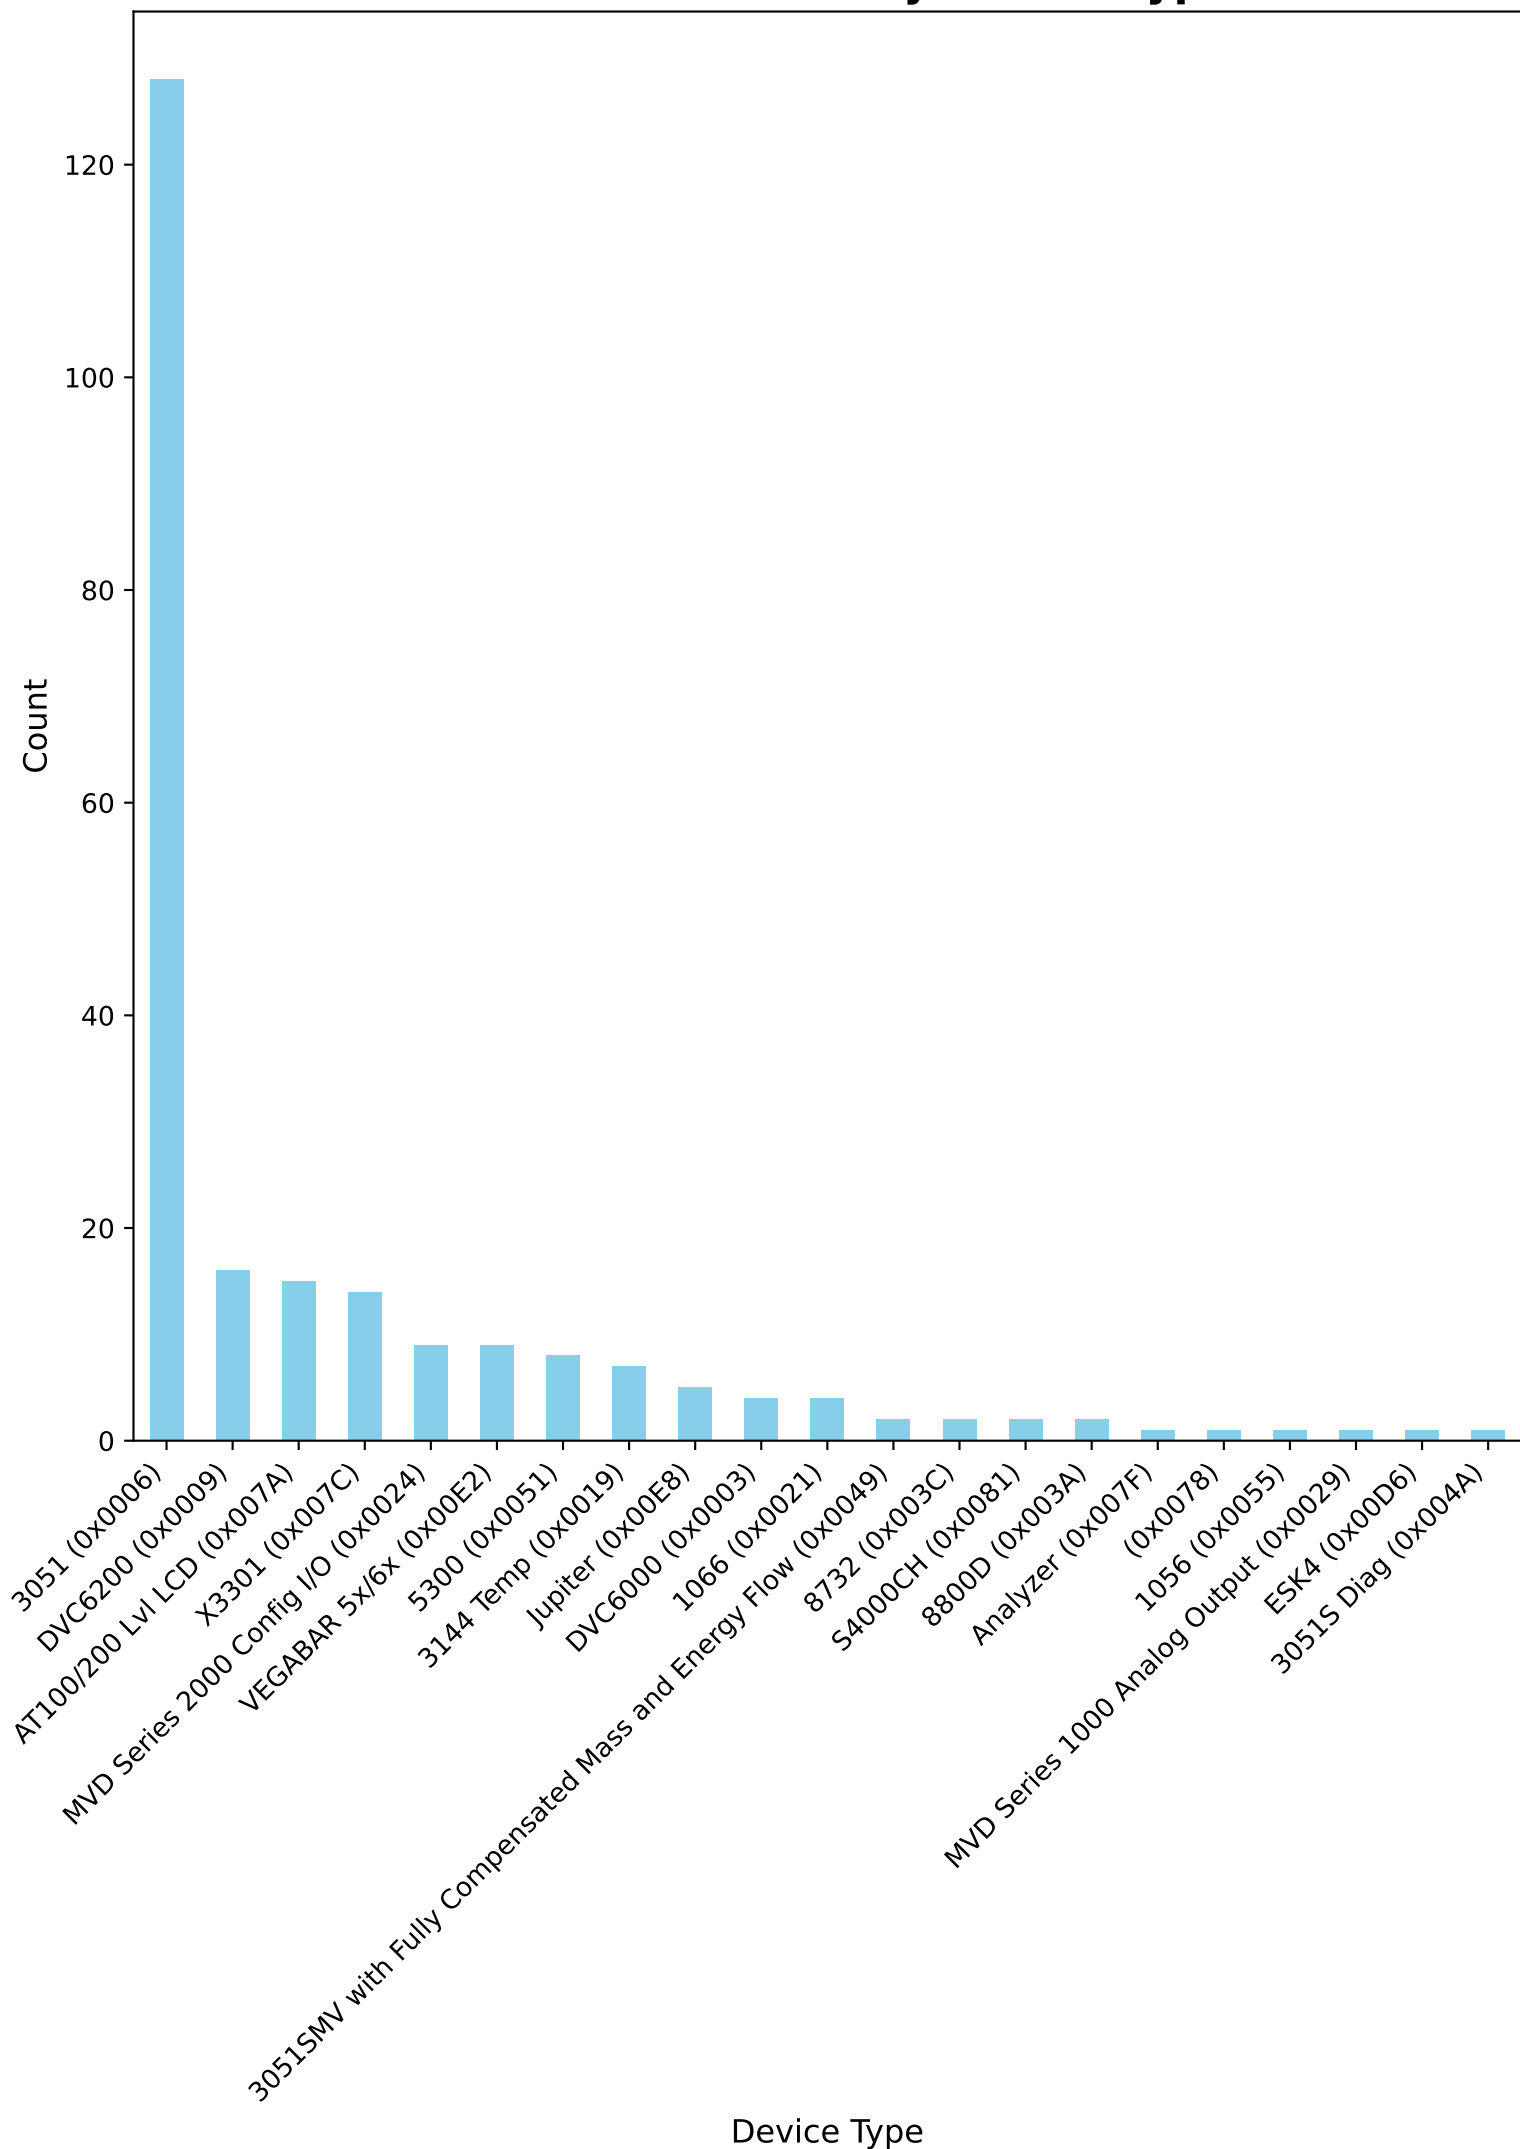

Device Information (Count of Similar Devices)

DEVICE TYPE	PACKAGE MANUFACTURER (ID)	HART 5	HART 7
(0x0078)	ABB	1	0
(0xE091)	ABB	0	27
(0xE373)	ABB	0	12
1056 (0x0055)	ABB	1	0
1066 (0x0021)	ABB	4	0
3051 (0x0006)	ABB	6	0
3051 (0x0006)	Rosemount	122	0
3051S Diag (0x004A)	Rosemount	1	0
3051SMV with Fully Compensated Mass and Energy Flow (0x0049)	ABB	2	0
3144 Temp (0x0019)	ABB	7	0
38XXVA (0x0A02)	ABB	0	9
5300 (0x0051)	ABB	8	0
8732 (0x003C)	ABB	2	0
8800D (0x003A)	ABB	2	0
AT100/200 Lvl LCD (0x007A)	ABB	15	0
Analyzer (0x007F)	ABB	1	0
DVC6000 (0x0003)	ABB	4	0
DVC6200 (0x0009)	Fisher Controls	16	0
ESK4 (0x00D6)	ABB	1	0
FLUXUS (0xE0BD)	ABB	0	14
Jupiter (0x00E8)	ABB	5	0
Jupiter Model JM4 (0x56DF)	ABB	0	2
LMT Magnetostrictve Level (0x1A9D)	ABB	0	3
MVD Series 1000 Analog Output (0x0029)	ABB	1	0
MVD Series 2000 Config I/O (0x0024)	ABB	9	0
MVD Series 2000 Config I/O (0x1F24)	ABB	0	1
Model 706 (0x56E0)	ABB	0	54
Position Xmtr (0xE394)	ABB	0	6
S4000CH (0x0081)	ABB	2	0
VEGABAR 5x/6x (0x00E2)	ABB	1	0
VEGABAR 5x/6x (0x00E2)	VEGA Grieshaber KG	8	0
VEGABAR 80 series (0x62C3)	ABB	0	10
VEGABAR 80 series SIL (0x62C2)	ABB	0	8
VEGAFLEX 80 series SIL (0x62D4)	ABB	0	4
VEGAPULS 64 (0x62BE)	ABB	0	11
X3301 (0x007C)	ABB	14	0