


Cord Detection Pipeline

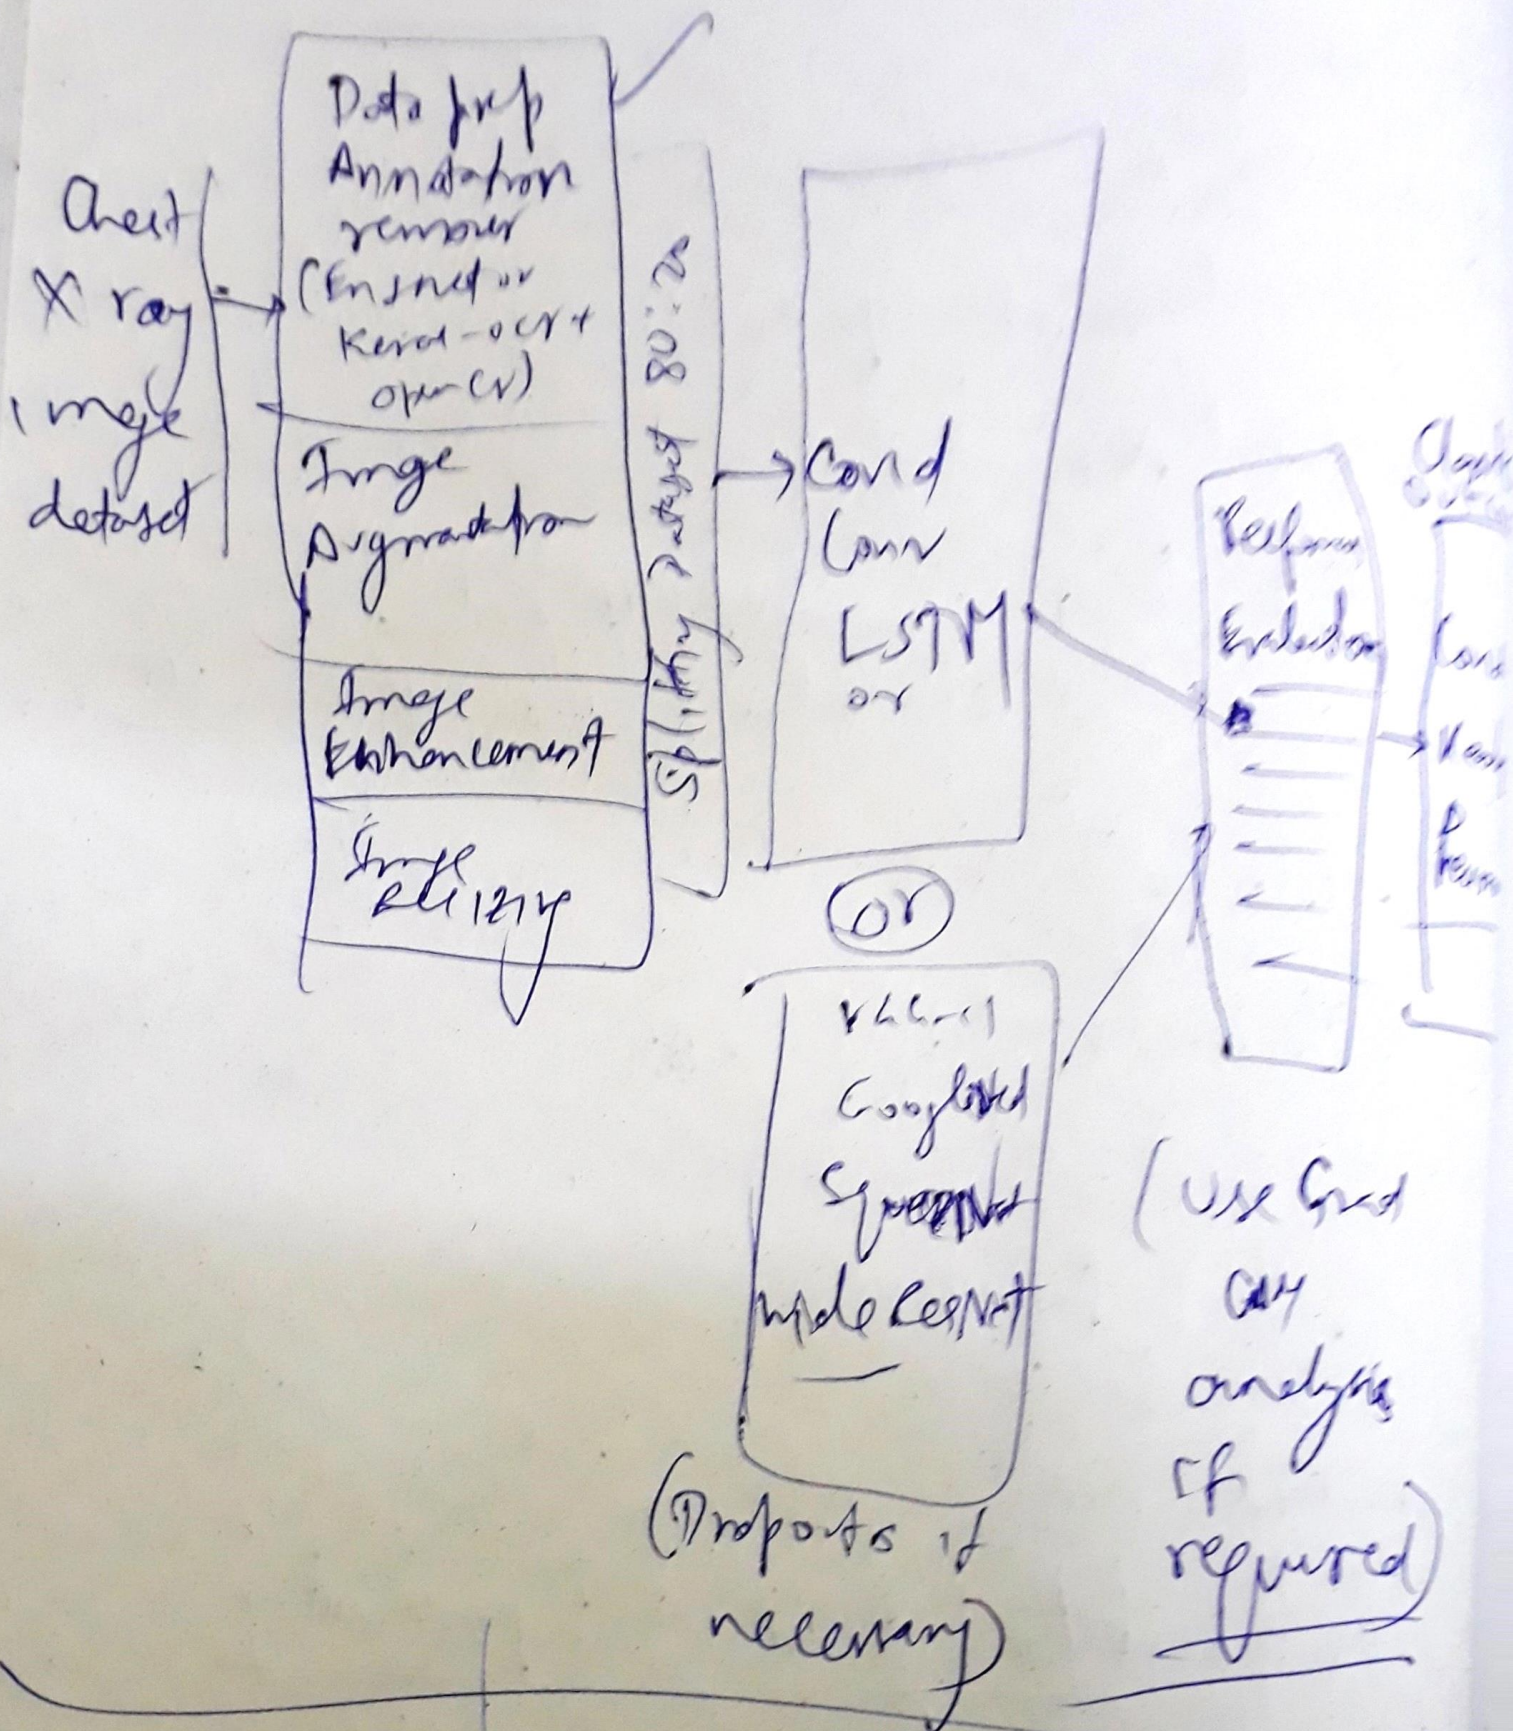

web app — Upload Cord Xray

result = 77

Accuracy = 77

Correl. → 2800
 ml → 2600
 P → 2400

