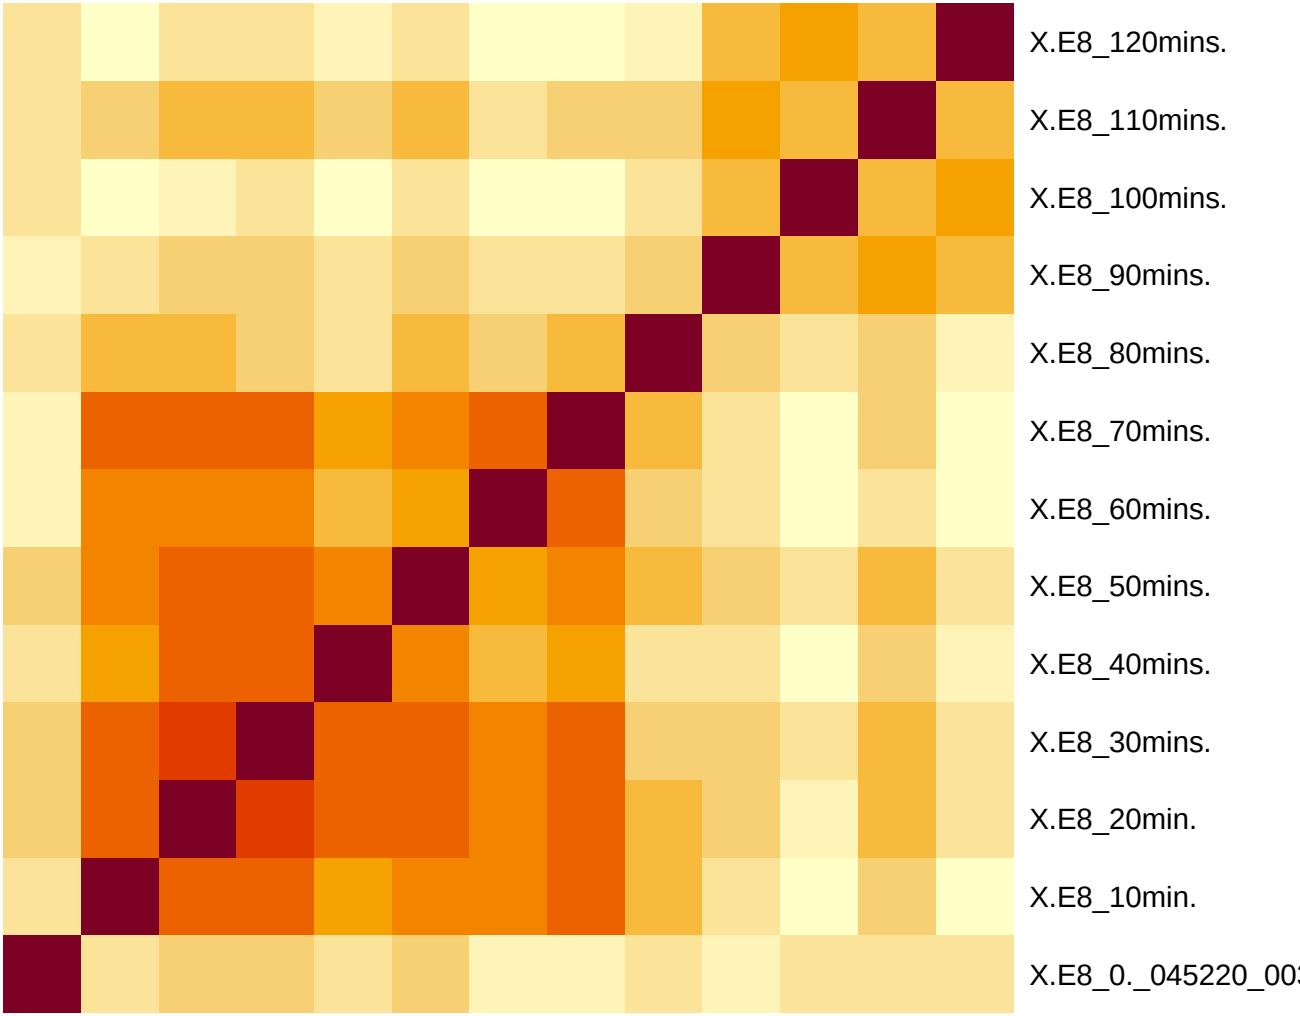control : Sample−Sample Correlation, <= 120 min