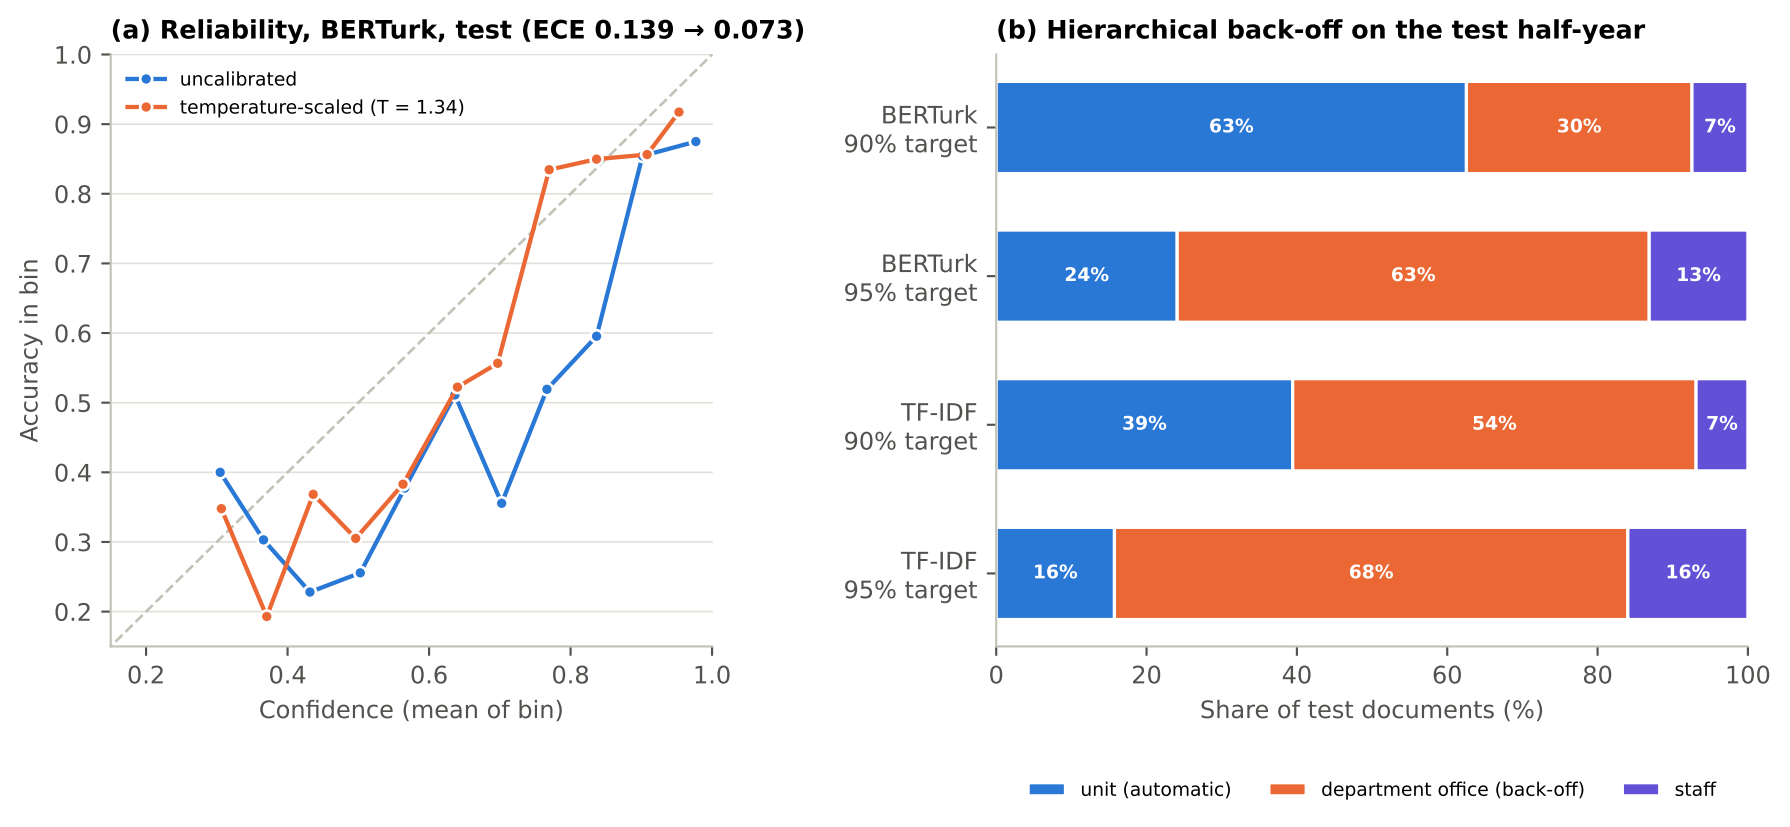
(a) Reliability, BERTurk, test (ECE 0.139 → 0.073)
uncalibrated
temperature-scaled (T = 1.34)
Accuracy in bin
Confidence (mean of bin)
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0.3
0.2
0.2
0.4
0.6
0.8
1.0
(b) Hierarchical back-off on the test half-year
BERTurk 90% target
BERTurk 95% target
TF-IDF 90% target
TF-IDF 95% target
63%
30%
7%
24%
63%
13%
39%
54%
7%
16%
68%
16%
0
20
40
60
80
100
Share of test documents (%)
unit (automatic)
department office (back-off)
staff