



ERCOT Grid Operations

ESR Integration Report : 09/06/2026

Current Daily Values:

Installed ESR Discharge Capacity*	22,024 MW
Total ESR Discharge Capacity**	22,536 MW
Installed ESR Charge Capacity+	21,866 MW
Total ESR Charge Capacity++	22,376 MW

Peak Load	82,270 MW
Peak Load Hour (HE)	18
ESR Discharge at Peak Load Hour	283 MW
ESR Charge at Peak Load Hour	210 MW
ESR Net Charge/Discharge at Peak Load Hour^	73 MW

Max ESR Discharge Generation	10,838 MW
Max ESR Discharge Time	19:54
Penetration at Max ESR Discharge Time	13.98%

Max ESR Charge Load	10,241 MW
Max ESR Charge Time	09:24
Penetration at Max ESR Charge Time	16.35%

Max ESR Discharge Penetration	13.98%
Max ESR Discharge Penetration Time	19:54
ESR Discharge Generation at Max ESR Discharge Penetration Time	10,838 MW

Max ESR Charge Penetration	16.35%
Max ESR Charge Penetration Time	09:24
ESR Charge Load at Max ESR Charge Penetration Time	10,241 MW

All Time Record Values:

	Record Max MW	Record Max MW Time	Penetration at Record Max MW	Max SOC in Record Hour	Min SOC in Record Hour
ESR Discharge Generation	13,300 MW	08/23/2026 19:45	15.35%	79.61%	45.49%
ESR Charge Load	11,576 MW	08/30/2026 09:29	18.15%	54.66%	26.59%
ESR Injection	13,268 MW	08/23/2026 19:45	15.31%	79.61%	45.49%

	Record Penetration	Record Penetration Time	MW at Record Penetration Time	Max SOC in Record Hour	Min SOC in Record Hour
ESR Discharge Generation	20.61%	03/13/2026 19:31	10,514 MW	75.87%	41.76%
ESR Charge Load	18.15%	08/30/2026 09:29	11,564 MW	54.66%	26.59%

	Record SOC Delta	Record SOC Delta Time
ESR SOC Hourly Increase	9,946 MWh	08/30/2026 10:04
ESR SOC Hourly Decrease	12,934 MWh	08/23/2026 20:17

* Sum of maximum discharge capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESRs modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).

** Sum of maximum discharge capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESRs modeled in ERCOT's network operations model.

+ Sum of maximum charge capacity (i.e. maximum point of delivery total load in RIOO) of all ESRs that are modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).


++ Sum of maximum charge capacity (i.e. maximum point of delivery total load in RIOO) of all ESRs that are modeled in ERCOT's network operations model.

^ ESR Net Charge/Discharge = ESR Net output (positive represents Net Discharge; negative represents Net Charge).


Note that generation, generation record, and generator capacity values in following pages of this report are based on units modeled in ERCOT's network operations model.

Hourly Average Actual Load vs. Actual ESR Output


09/06/2026

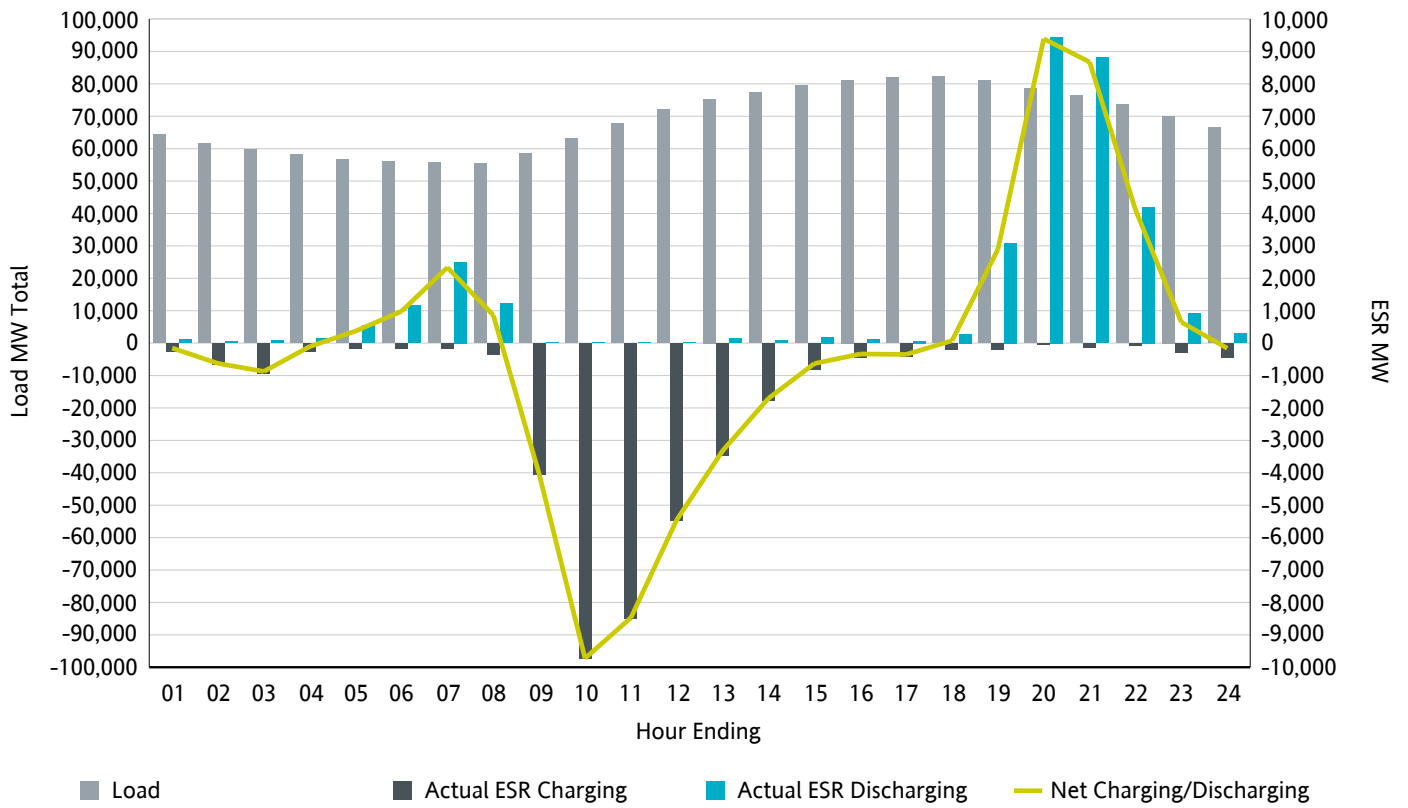


Actual ESR Discharging Output as a Percentage of Total Installed ESR Discharge Capacity 09/06/2026

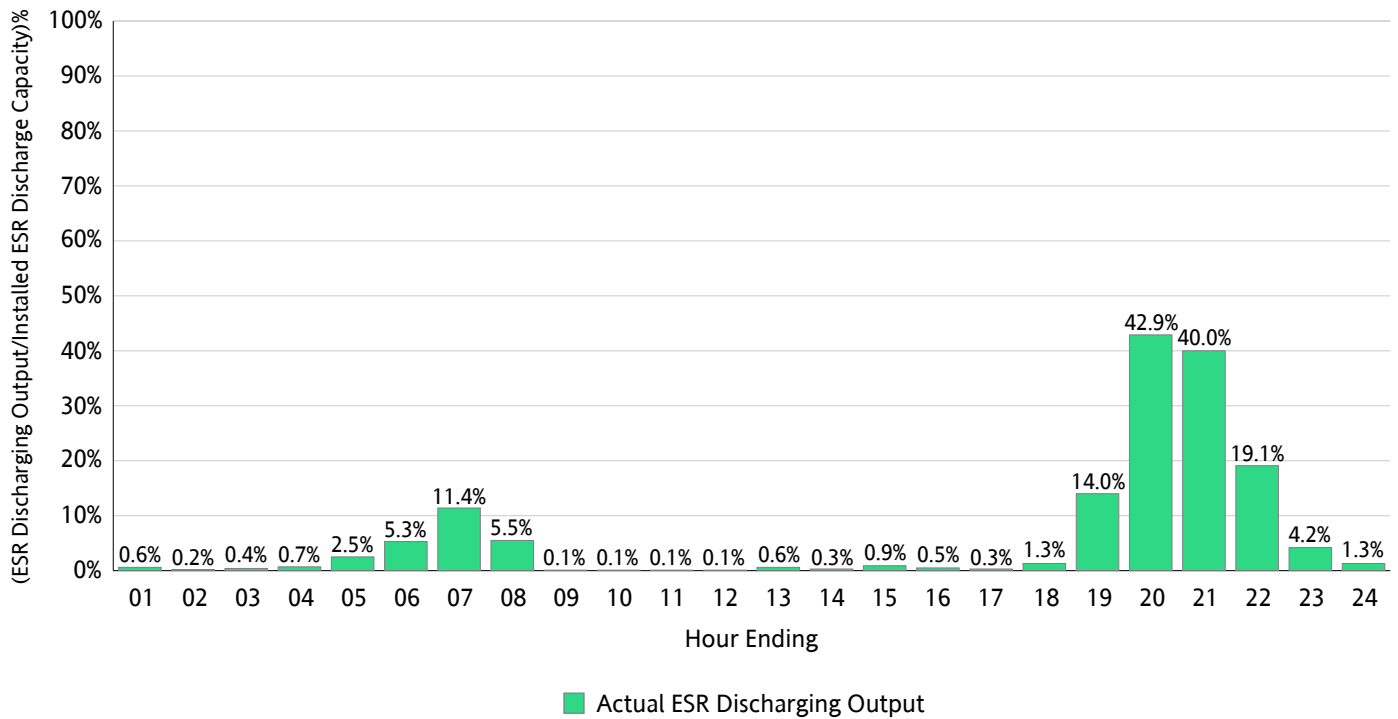

Actual ESR Charging Output as a Percentage of Total Installed ESR Charge Capacity 09/06/2026

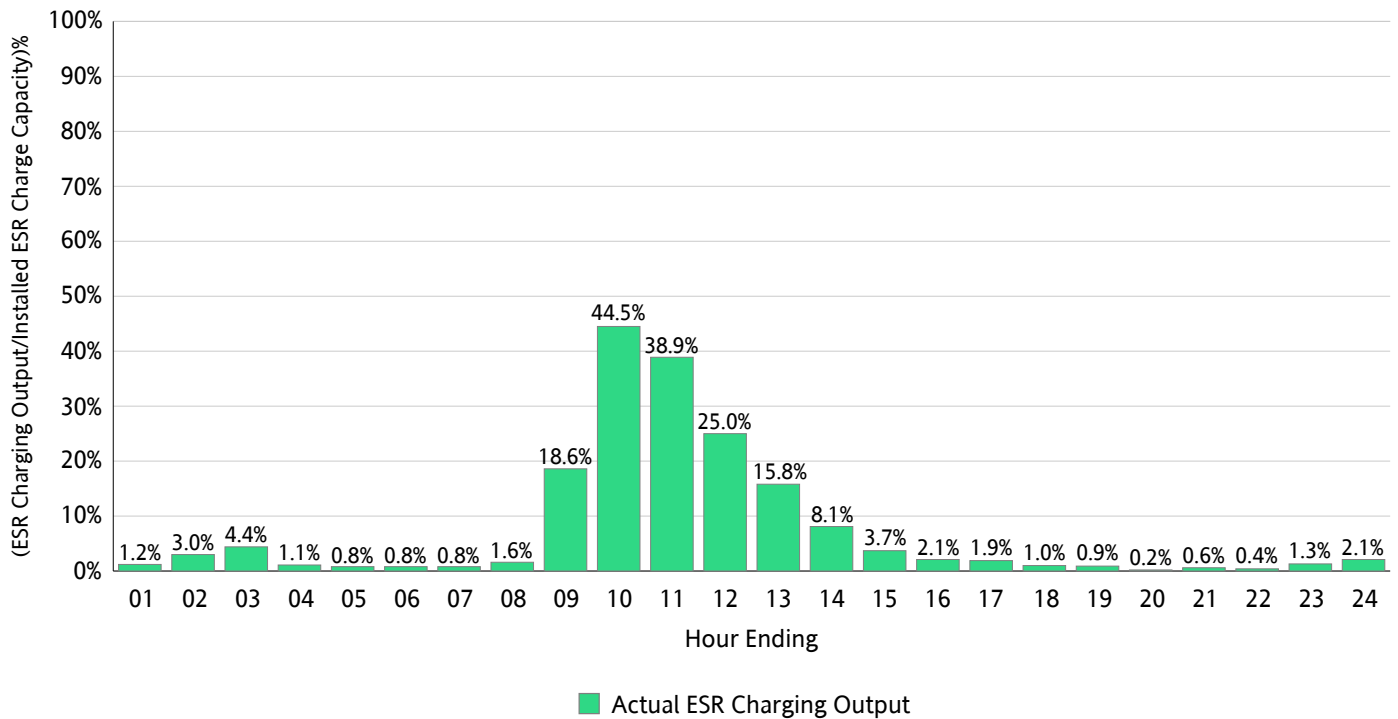

Actual ESR Net Output as a Percentage of ERCOT Load 09/06/2026

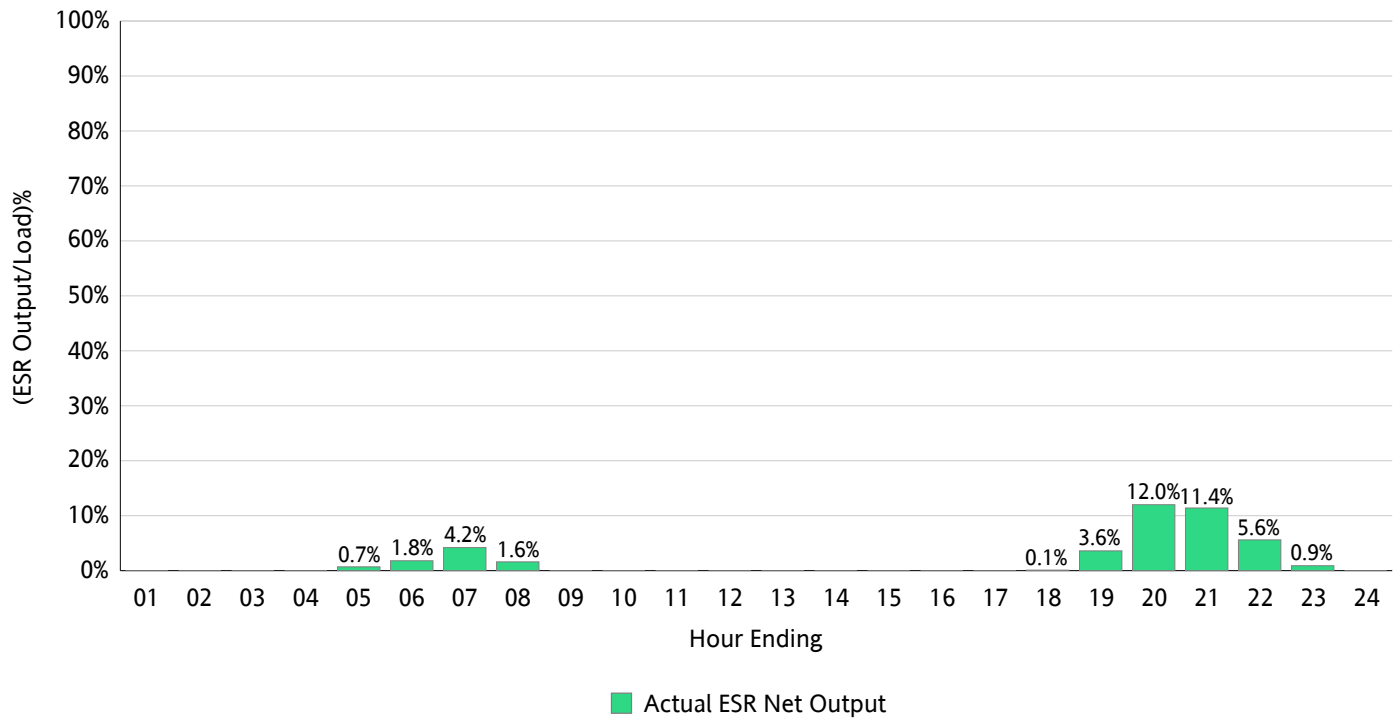

ERCOT Load vs. Actual ESR Net Output
08/30/2026 - 09/06/2026

