



ERCOT Grid Operations

ESR Integration Report : 11/02/2025

Current Daily Values:

Installed ESR Discharge Capacity*	15,928 MW
Total ESR Discharge Capacity**	17,468 MW
Installed ESR Charge Capacity+	15,977 MW
Total ESR Charge Capacity++	17,357 MW

Peak Load	49,527 MW
Peak Load Hour (HE)	19
ESR Discharge at Peak Load Hour	2,268 MW
ESR Charge at Peak Load Hour	539 MW
ESR Net Charge/Discharge at Peak Load Hour^	1,729 MW

Max ESR Discharge Generation	5,708 MW
Max ESR Discharge Time	17:44
Penetration at Max ESR Discharge Time	11.71%

Max ESR Charge Load	4,240 MW
Max ESR Charge Time	09:06
Penetration at Max ESR Charge Time	8.79%

Max ESR Discharge Penetration	11.74%
Max ESR Discharge Penetration Time	17:42
ESR Discharge Generation at Max ESR Discharge Penetration Time	5,705 MW

Max ESR Charge Penetration	8.79%
Max ESR Charge Penetration Time	09:06
ESR Charge Load at Max ESR Charge Penetration Time	4,240 MW

* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).

** Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model.

+ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLR's that are modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).


++ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLR's that are modeled in ERCOT's network operations model.

^ ESR Net Charge/Discharge = Total Discharging from ESR generators - Total Charging from ESR CLR's. Positive represents Net Discharge; negative represents Net Charge.


Note that generation, generation record, and generator capacity values in following pages of this report are based on units modeled in ERCOT's network operations model.

Hourly Average Actual Load vs. Actual ESR Output


11/02/2025

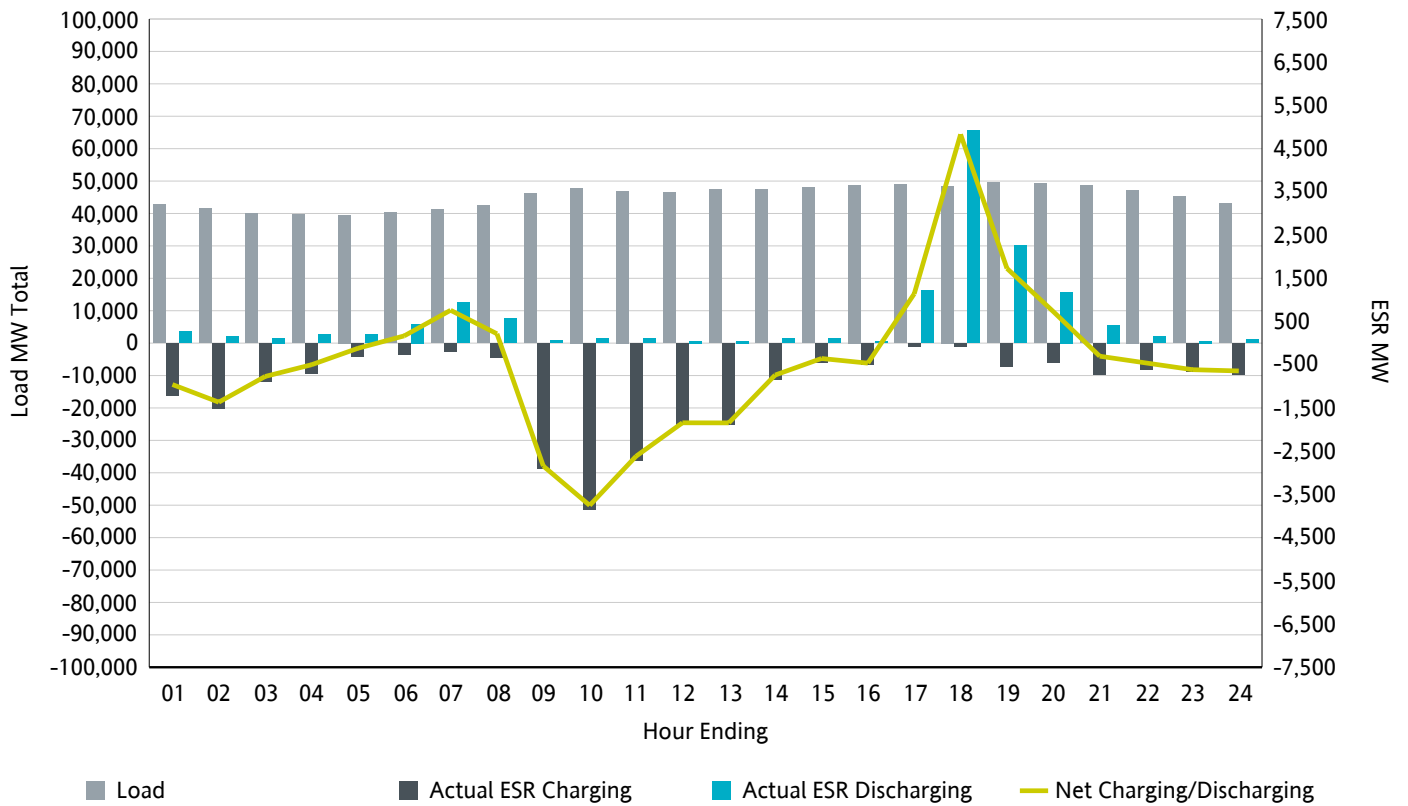


Actual ESR Discharging Output as a Percentage of Total Installed ESR Discharge Capacity 11/02/2025

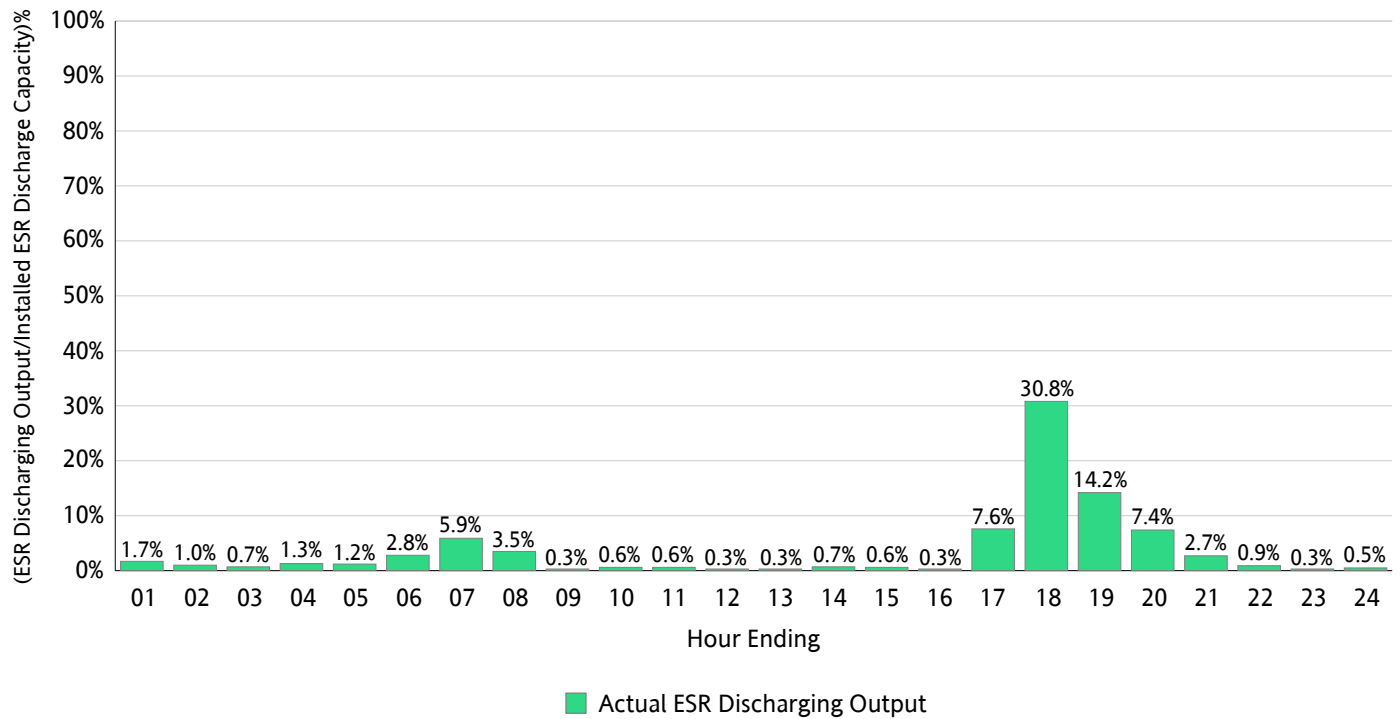

Actual ESR Charging Output as a Percentage of Total Installed ESR Charge Capacity 11/02/2025

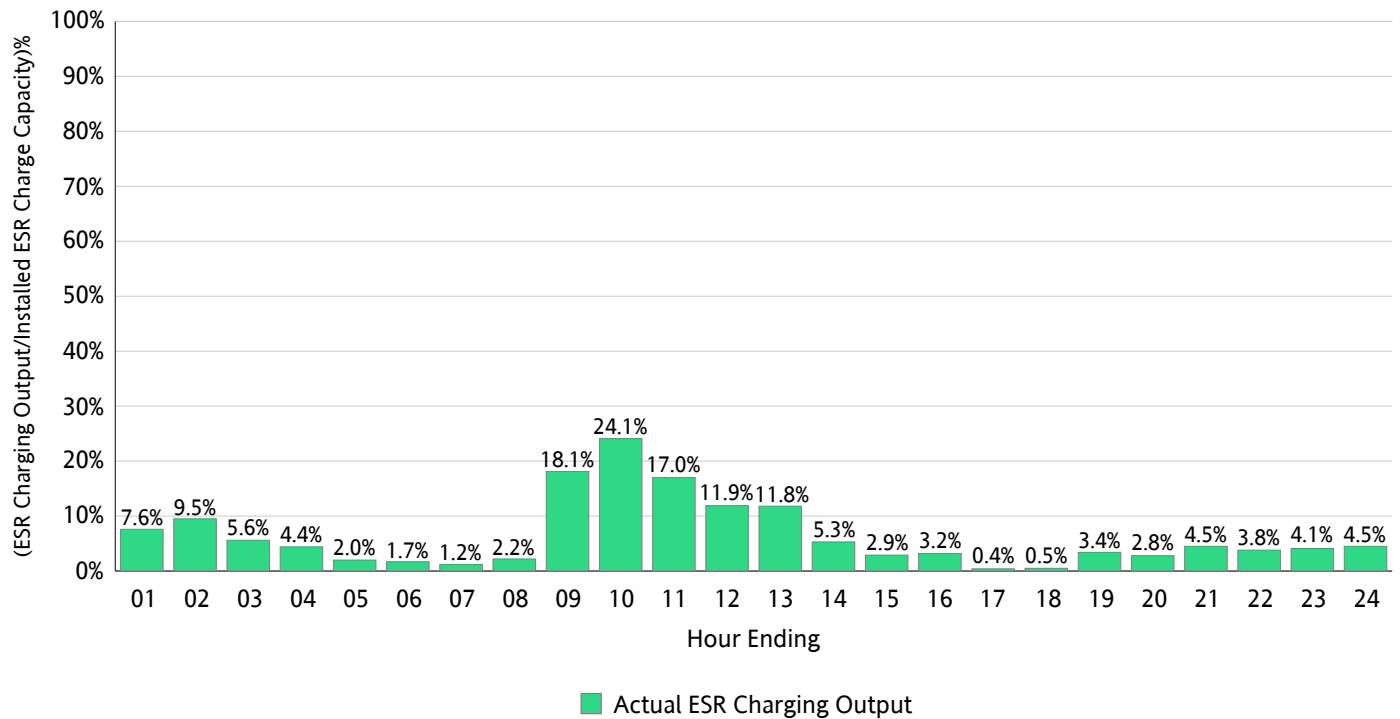

Actual ESR Net Output as a Percentage of ERCOT Load 11/02/2025

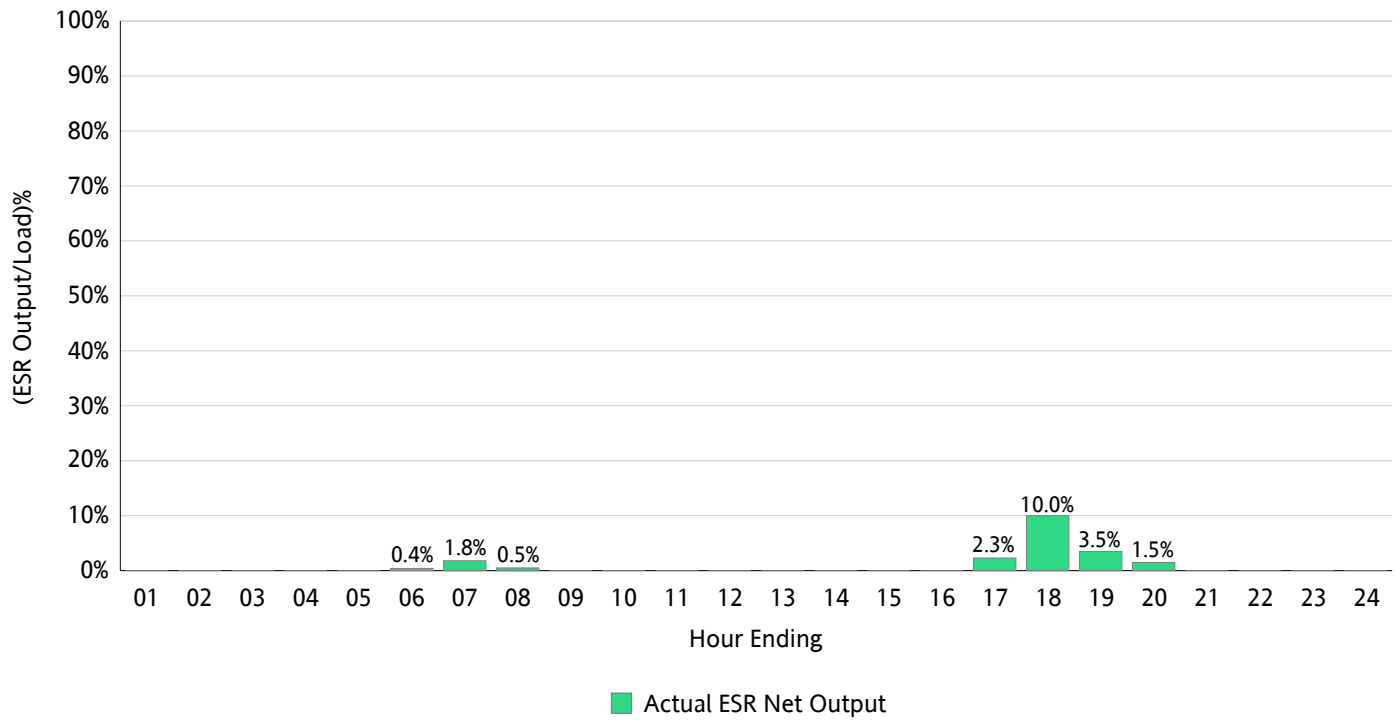

ERCOT Load vs. Actual ESR Net Output
10/26/2025 - 11/02/2025

