

Single Field Analysis

Eye: Right

Name: SODZI FAITH MAD.

DOB: 03-08-1939

ID: 6TYR

Central 24-2 Threshold Test

Fixation Monitor: Gaze Track

Fixation Target: Central

Fixation Losses: 0/0

False POS Errors: 2 %

False NEG Errors: 13 %

Test Duration: 07:32

Fovea: 33 dB

Stimulus: III, White

Background: 31.5 ASB

Strategy: SITA-Standard

Pupil Diameter:



Visual Acuity:

RX: DS DC X


Date: 27-07-2018

Time: 12:32

Age: 78

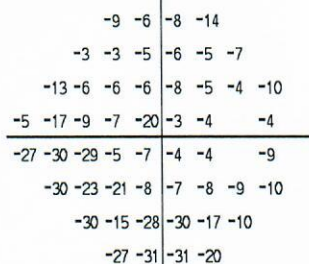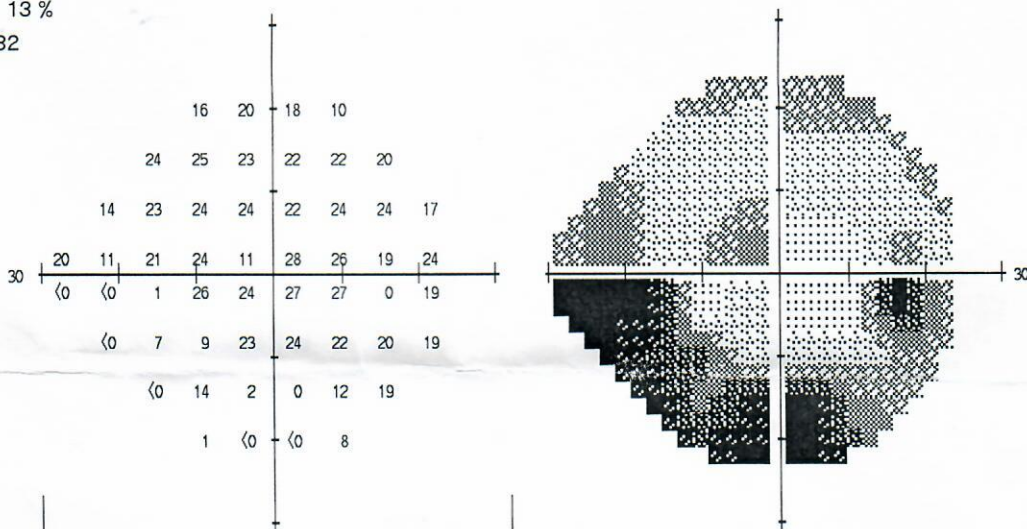

Total Deviation

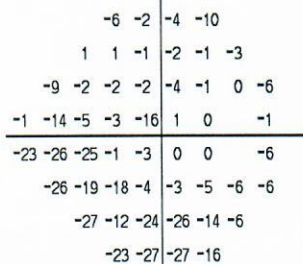

Pattern Deviation



GHT

Outside Normal Limits

VFI 70%

MD -12.87 dB P < 0.5%

PSD 10.26 dB P < 0.5%

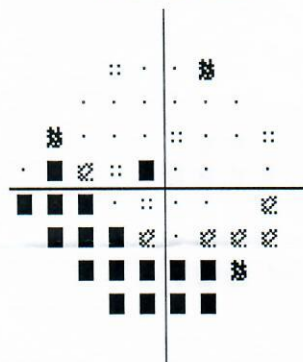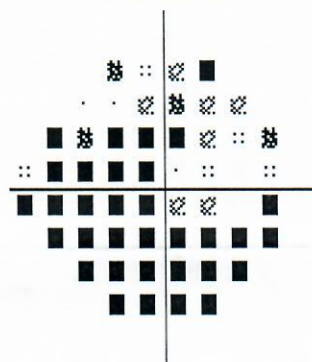

:: < 5%

⊗ < 2%

⊠ < 1%

■ < 0.5%

KORLE BU TEACHING HOSPITAL
EYE CLINIC
KORLE BU
GREATER ACCRA
GHANA

