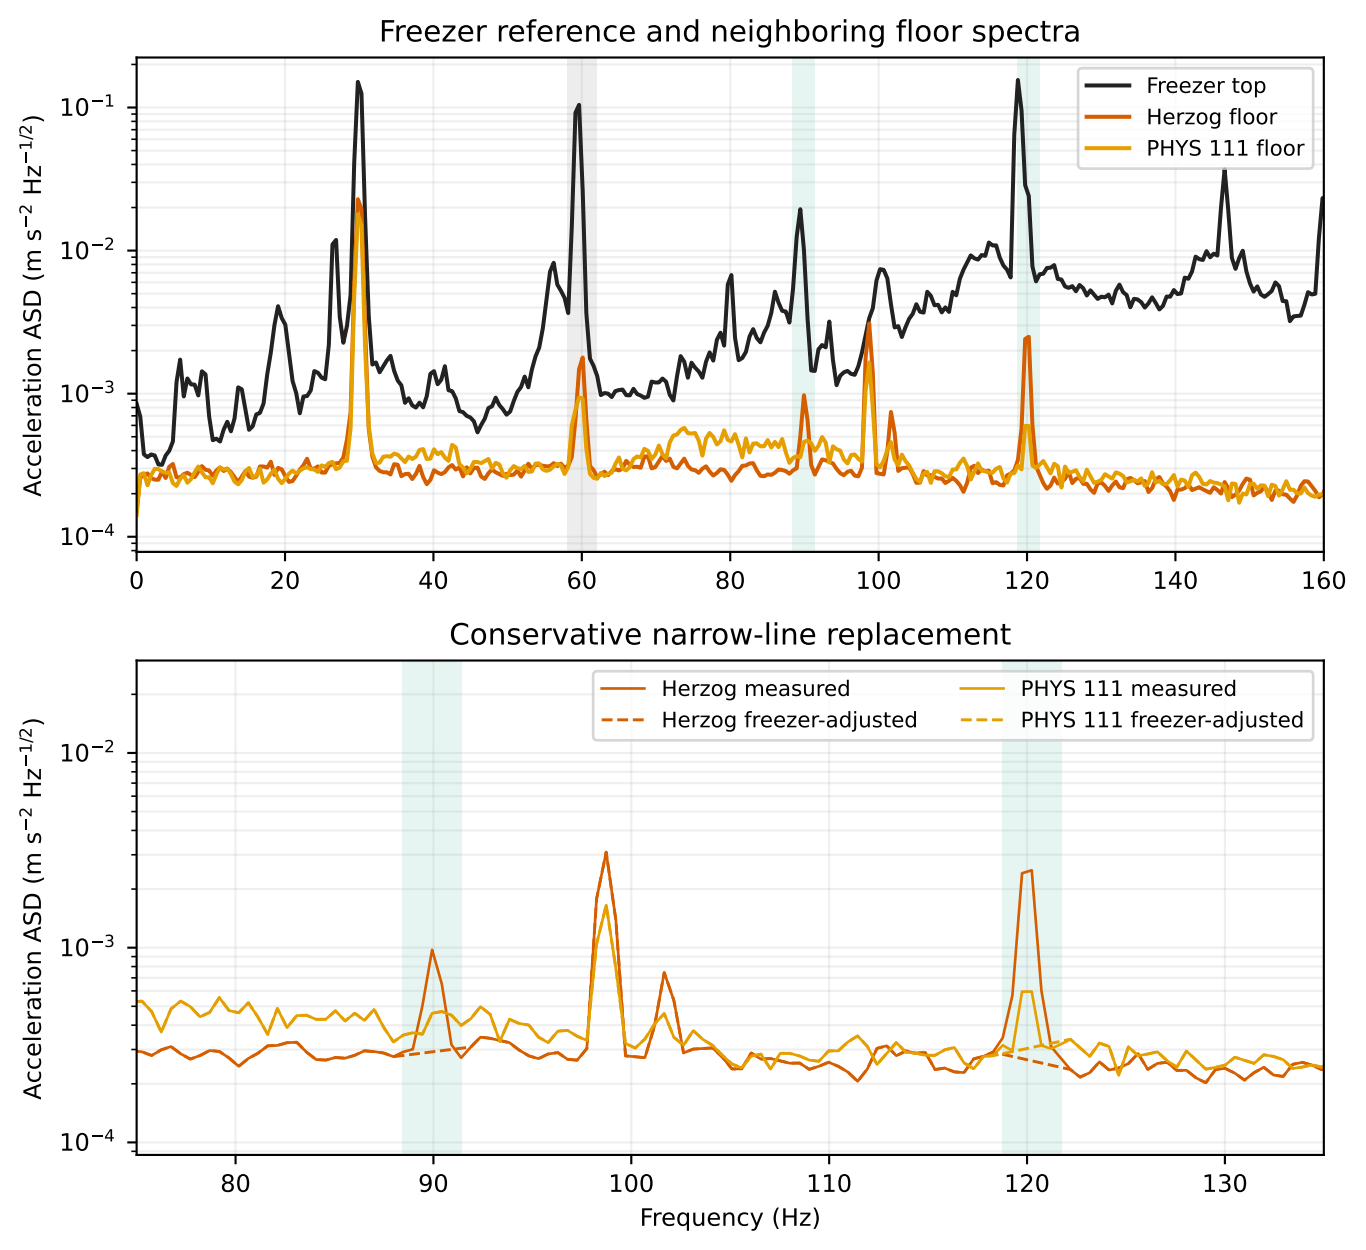
Freezer reference and neighboring floor spectra
Freezer top
Herzog floor
PHYS 111 floor
Acceleration ASD (m s^{-2} Hz$^{-1/2}$)
10^{-1}
10^{-2}
10^{-3}
10^{-4}
0
20
40
60
80
100
120
140
160
Conservative narrow-line replacement
Herzog measured
Herzog freezer-adjusted
PHYS 111 measured
PHYS 111 freezer-adjusted
Acceleration ASD (m s^{-2} Hz$^{-1/2}$)
10^{-2}
10^{-3}
10^{-4}
80
90
100
110
120
130
Frequency (Hz)