


CLICK I/O Module Specifications

CO-04DA-2 \$119.00

4-Channel Analog Voltage Output Module

4-channel analog voltage output module, 12-bit resolution, range: 0-10V. External 24VDC power required, removable terminal block included. (replacement ADC p/n CO-8TB).

Wiring Diagram

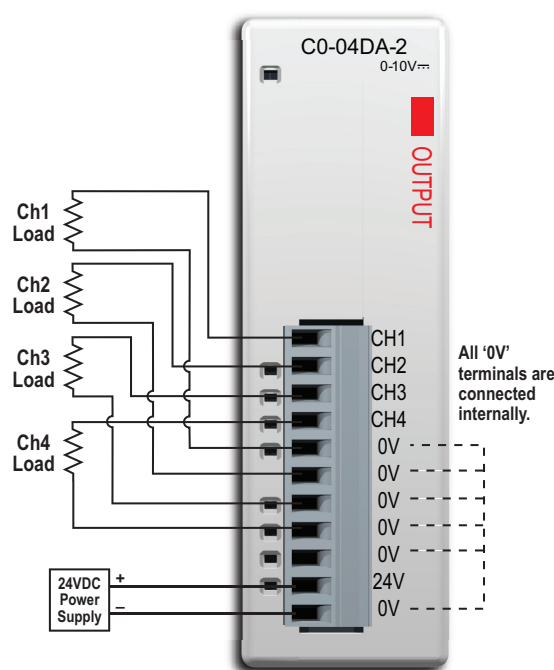

NOTE: When using this module you must also use CLICK programming software and PLC firmware version V1.40 or later.

CO-04DA-2 Output Specifications	
Outputs per Module	4
Output Range	0-10 V
Resolution	12-bit, 2.44 mV per count
Output Type	Voltage sourcing at 10mA max. (one common)
Output Value in Program Mode	Determined by CPU
Output Value in Fault Mode	0 V
Output Impedance	0.2Ω typical
Load Impedance	>1000Ω
Maximum Capacitive Load	0.01 uF maximum
Allowed Load Type	Grounded
Maximum Inaccuracy	0.5% of range
Max. Full Scale Calibration Error (Not including Offset)	±0.2% of range maximum voltage
Max. Offset Calibration Error	±0.2% of range maximum
Accuracy vs. Temperature	±75 PPM/°C maximum full scale calibration change (±0.0025% of range/°C)
Max. Crosstalk at DC, 50/60 Hz	-72 dB, 1 LSB
Linearity Error (End to End)	±4 LSB max., (±0.1% of full scale); monotonic with no missing codes
Output Stability and Repeatability	±2% LSB after 10 minute warmup period typical
Output Ripple	0.1% of full scale
Output Settling Time	0.3 ms maximum, 5 μs minimum (full scale range)
All Channel Update Rate	10 ms
Max. Continuous Overload	Outputs current limited to 40 mA typical; continuous overloads on multiple outputs can damage module.
Field to Logic Side Isolation	1800 VAC applied for 1 second (100% tested)
Type of Output Protection	0.1 μF transient suppressor
Output Signal at Power Up and Power Down	0 V
External 24 VDC Power Required	85 mA
Base Power Required (24 VDC)	20 mA
Terminal Block Replacement	ADC p/n CO-8TB
Weight	2.9 oz (82 g)

Z/PLink Pre-Wired PLC Connection Cables and Modules for CLICK PLC

11-pin connector cable
ZL-C0-CBL11 (0.5 m length)
ZL-C0-CBL11-1 (1.0 m length)
ZL-C0-CBL11-2 (2.0 m length)



ZL-RTB20 20-pin feed-through connector module



Power Budgeting

Power Budgeting

There are two areas to be considered when determining the power required to operate a CLICK PLC system. The first area is the power required by the CLICK PLC, along with the internal logic side power that the CPU provides to its own I/O and any connected I/O modules that are powered through the PLC expansion port; plus any device, such as a C-more Micro-Graphic panel, that is powered through one of the communications ports.

The second area is the power required by all externally connected I/O devices. This should be viewed as the field side power required. The field side power is dependent on the voltage used for a particular input or output device as it relates to the wired I/O point, and the calculated load rating of the connected device.

It is strongly recommended that the power source for the logic side be separate from the power source for the field side to help eliminate possible electrical noise.

Power budgeting requires the calculation of the total current the 24 VDC power source needs to provide to CLICK's logic side, and also a separate calculation of the total current required for all devices operating from the field side of the PLC system.

Refer to the Power Budgeting example shown on the following page. The table shows required current for a CLICK PLC, two I/O modules, and a C-more Micro. Use the total amperage values to select the properly sized power supply.



CLICK 24 VDC Power Supply
CO-00AC or CO-01AC




Other 24 VDC Power Supply
Example: PSP24-60S

PLC Current Consumption (mA)		
Part Number	Power Budget 24 VDC (logic side)	External 24 VDC (field side)
Basic PLC Units		
CO-00DD1-D	120	60
CO-00DD2-D	120	0
CO-00DR-D		
CO-00AR-D		
Standard PLC Units		
CO-01DD1-D	140	60
CO-01DD2-D	140	0
CO-01DR-D		
CO-01AR-D		
Analog PLC Units		
CO-02DD1-D	140	60
CO-02DD2-D	140	0
CO-02DR-D		
Ethernet Basic PLC Units		
CO-10DD1E-D	120	60
CO-10DD2E-D	120	0
CO-10DRE-D		
CO-10ARE-D		
Ethernet Standard PLC Units		
CO-11DD1E-D	140	60
CO-11DD2E-D	140	0
CO-11DRE-D		
CO-11ARE-D		

I/O Module Current Consumption (mA)		
Part Number	Power Budget 24 VDC (logic side)	External 24 VDC (field side)
Discrete Input Modules		
CO-08ND3	30	0
CO-08ND3-1	30	0
CO-16ND3	40	0
CO-08NE3	30	0
CO-16NE3	40	0
CO-08NA	30	0
Discrete Output Modules		
CO-08TD1	50	15
CO-08TD2	50	0
CO-16TD1	80	100
CO-16TD2	80	0
CO-08TA	80	0
CO-04TRS	100	0
CO-08TR	100	0

I/O Module Current Consumption (continued) (mA)		
Part Number	Power Budget 24 VDC (logic side)	External 24 VDC (field side)
Discrete Combo I/O Modules		
CO-16CDD1	80	50
CO-16CDD2	80	0
CO-08CDR	80	0
Analog Input Modules		
CO-04AD-1	20	65
CO-04AD-2	23	65
CO-04RTD	25	0
CO-04THM	25	0
Analog Output Modules		
CO-04DA-1	20	145
CO-04DA-2	20	85
Analog Combo I/O Modules		
CO-4AD2DA-1	25	75
CO-4AD2DA-2	20	65
C-more Micro-Graphic Panel		
Monochrome only	90	0

Choosing a PLC Unit

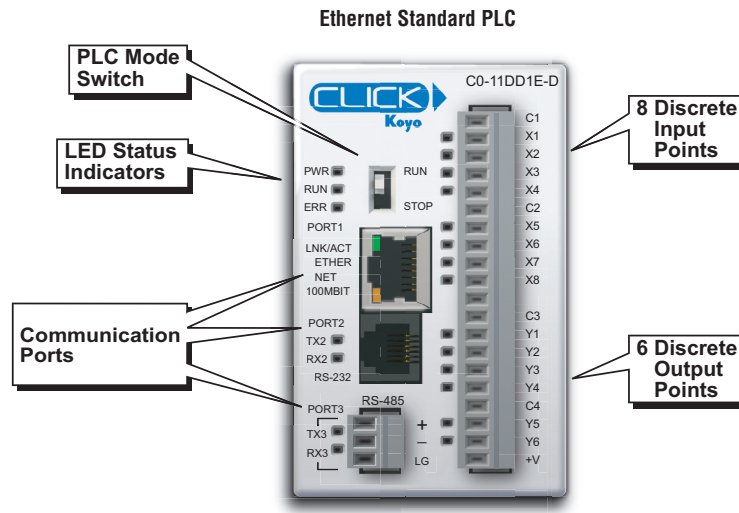

Ethernet Standard PLCs			
Part Number	Discrete Input Type	Discrete Output Type	External Power
CO-11DD1E-D	8 DC (sink/source)	6 DC (sink)	24V DC (required for all PLCs)
CO-11DD2E-D		6 DC (source)	
CO-11DRE-D		6 Relay	
CO-11ARE-D	8 AC		

Choosing Expansion I/O Modules


I/O Modules

A variety of discrete, combo, and analog I/O modules are available for the CLICK PLC system. Up to eight I/O modules can be connected to a CLICK PLC unit to expand the system I/O count and meet the needs of a specific application. Complete I/O module specifications and wiring diagrams can be found later in this section.


Discrete Input Modules



CO-08ND3




CO-08ND3-1



CO-16ND3



CO-08NE3



CO-16NE3




CO-08NA

Discrete Input Modules			
Part Number	I/O Type/ Number/Commons	Sink or Source	Voltage Ratings
CO-08ND3	DC/8/2	Sink or Source	12-24 VDC
CO-08ND3-1	DC/8/2	Sink or Source	3.3-5 VDC
CO-16ND3	DC/16/4	Sink or Source	24 VDC
CO-08NE3	AC/DC / 8/2	Sink or Source	24 VAC/VDC
CO-16NE3	AC/DC / 16/4	Sink or Source	24 VAC/VDC
CO-08NA	AC/8/2	N/A	100-120 VAC

Choosing Expansion I/O Modules


Discrete I/O Modules (continued)

Discrete Output Modules

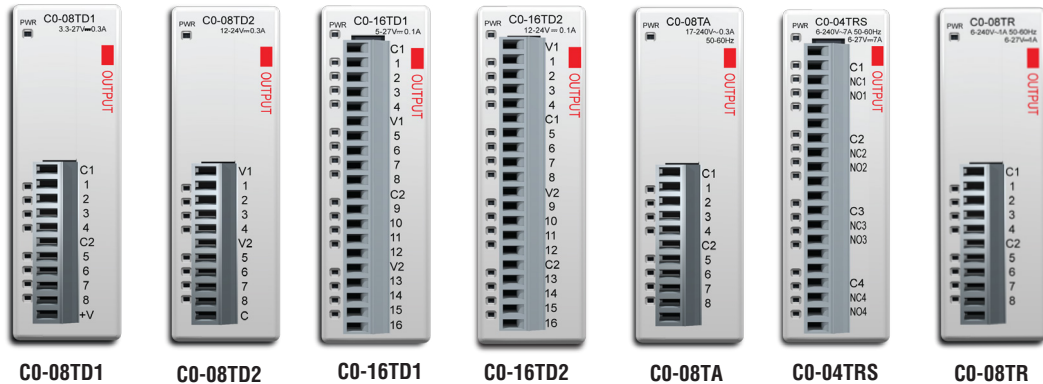

Discrete Output Modules			
Part Number	I/O Type/ Number/ Commons	Sink or Source	Voltage/Current Ratings
CO-08TD1	DC/8/2	Sink	3.3-27 VDC, 0.3 A
CO-08TD2	DC/8/1	Source	12-24 VDC, 0.3 A
CO-16TD1	DC/16/2	Sink	5-27 VDC, 0.1 A
CO-16TD2	DC/16/2	Source	12-24 VDC, 0.1 A
CO-08TA	AC/8/2	N/A	17-240 VAC, 0.3 A
CO-04TRS	Relay/4/4	N/A	6-27 VDC, 7 A 6-240 VAC, 7 A
CO-08TR	Relay/8/2	N/A	6-27 VDC, 1 A 6-240 VAC, 1 A

Discrete Combo I/O Modules

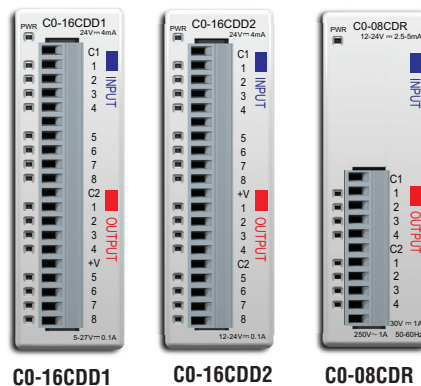


Discrete Combo I/O Modules				
Part Number	Input Type	Input Voltage	Output Type	Output Voltage / Current Ratings
CO-16CDD1	8 DC (source/sink)	24 VDC	8 DC (sink)	5-27 VDC / 0.1 A
CO-16CDD2	8 DC (source/sink)	24 VDC	8 DC (source)	12-24 VDC / 0.1 A
CO-08CDR	4 DC (source/sink)	12-24 VDC	4 (relay)	6.25-24 VDC, 1 A 6-240 VAC, 1 A

Choosing Expansion I/O Modules


Analog I/O Modules

Analog Input Modules

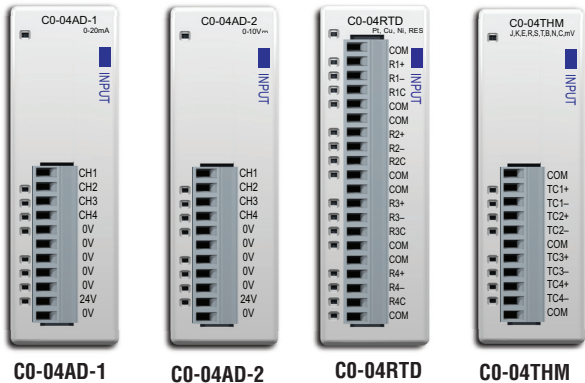

Analog Input Modules		
Part Number	Analog Input Types	External Power Required
CO-04AD-1	4 channel, current (0-20 mA), 13 bit	24 VDC
CO-04AD-2	4 channel, voltage (0-10 V), 13 bit	24 VDC
CO-04RTD	4 channel RTD input (0.1 degree °C/°F resolution), or resistive input (0 to 3125 ohms)	None
CO-04THM	4 channel thermocouple input (0.1 degree °C/°F resolution), or voltage input (-156.25 mV to 1.25 V), 16 bit	None

Analog Output Modules

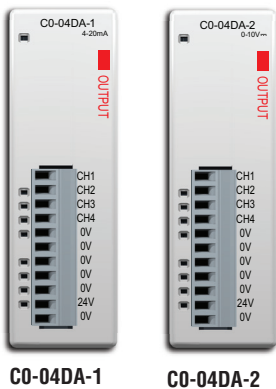


Analog Output Modules		
Part Number	Analog Output Types	External Power Required
CO-04DA-1	4 channel, current sourcing (4-20 mA), 12 bit	24 VDC
CO-04DA-2	4 channel, voltage (0-10 V), 12 bit	24 VDC

Choosing Expansion I/O Modules

Analog I/O Modules (continued)

Analog Combo I/O Modules

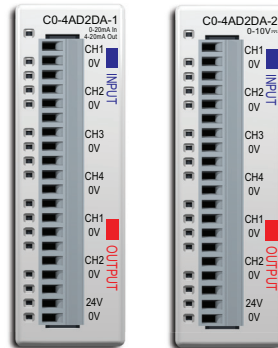

C0-4AD2DA-1

C0-4AD2DA-2

Analog Combo I/O Modules			
Part Number	Analog Input Type	Analog Output Type	External Power Required
C0-4AD2DA-1	4 channel, current (0-20 mA), 13 bit	2 channel, current sourcing (4-20 mA), 12 bit	24 VDC
C0-4AD2DA-2	4 channel, voltage (0-10 V), 13 bit	4 channel, voltage (0-10 V), 12 bit	24 VDC

General Specifications For All CLICK PLC Products

These general specifications apply to all CLICK PLCs, optional I/O modules, and optional power supply products. Please refer to the appropriate I/O temperature derating charts under both the PLC and I/O module specifications to determine best operating conditions based on the ambient temperature of your particular application.

General Specifications	
Power Input Voltage Range	20-28 VDC
Maximum Power Consumption	5 W (No 5 V use from communication port)
Maximum Inrush Current	30 A (less than 1ms)
Acceptable External Power Drop	Max 10 ms
Operating Temperature	Analog, analog combo I/O modules only: 32°F to 140°F (0°C to 60°C); All other modules: 32°F to 131°F (0°C to 55°C), IEC 60068-2-14 (Test Nb, Thermal Shock)
Storage Temperature	-4°F to 158°F (-20°C to 70°C) IEC 60068-2-1 (Test Ab, Cold) IEC 60068-2-2 (Test Bb, Dry Heat) IEC 60068-2-14 (Test Na, Thermal Shock)
Ambient Humidity	30% to 95% relative humidity (non-condensing)
Environmental Air	No corrosive gases. Environmental pollution level is 2 (UL840)
Vibration	MIL STD 810C, Method 514.2, EC60068-2-6 JIS C60068-2-6 (Sine wave vibration test)
Shock	MIL STD 810C, Method 516.2, IEC60068-2-27, JIS C60068-2-27
Noise Immunity	Comply with NEMA ICS3-304, Impulse noise 1µs, 1000V EN61000-4-2 (ESD), EN61000-4-3 (RFI), EN61000-4-4 (FTB) EN61000-4-5 (Surge), EN61000-4-6 (Conducted) EN61000-4-8 (Power frequency magnetic field immunity) RFI: No interference measured at 150 and 450 MHz (5w/15cm)
Emissions	EN55011:1998 Class A
Agency Approvals	UL508 (File No. E157382, E316037); CE (EN61131-2)
Other	RoHS



Wiring System for CLICK PLCs

Wiring Solutions using the ZIPLink Wiring System

ZIPLinks eliminate the normally tedious process of wiring between devices by utilizing prewired cables and DIN rail mount connector modules. It's as simple as plugging in a cable connector at either end or terminating wires at only one end. Prewired cables keep installation clean and efficient, using half the space at a fraction of the cost of standard terminal blocks.

ZIPLinks are available in a variety of styles to suit your needs, including feedthrough connector module. ZIPLinks are available for all Basic, Standard and Ethernet CLICK PLC units and most discrete and analog I/O modules. Pre-printed I/O-specific adhesive label strips for quick marking of ZIPLink modules are provided with ZIPLink cables.



Solution 1: CLICK PLC and I/O Modules to ZIPLink Connector Modules

When looking for quick and easy I/O-to-field termination, a ZIPLink connector module used in conjunction with a prewired ZIPLink cable, consisting of an I/O terminal block at one end and a multi-pin connector at the other end, is the best solution.

Use the "CLICK PLC Unit ZIPLink Selector" table and CLICK I/O ZIPLink selector tables located in this section:

1. Locate your PLC or I/O module.
2. Select a ZIPLink Module.
3. Select a corresponding ZIPLink Cable.

Solution 2: CLICK PLC and I/O Modules to 3rd Party Devices

When wanting to connect I/O to another device within close proximity of the I/O modules, no extra terminal blocks are necessary when using the ZIPLink Pigtail Cables. ZIPLink Pigtail Cables are prewired to an I/O terminal block with color-coded pigtail with soldered-tip wires on the other end.

Use the I/O Modules to 3rd Party Devices selector tables located in the ZIPLink section:

1. Locate your PLC or I/O module.
2. Select a ZIPLink Pigtail Cable that is compatible with your 3rd party device.



Solution 3: GS Series and DuraPulse Drives Communication Cables

Need to communicate via Modbus RTU to a drive or a network of drives?

ZIPLink cables are available in a wide range of configurations for connecting to PLCs and SureServo, SureStep, Stellar Soft Starter and AC drives. Add a ZIPLink communications module to quickly and easily set up a multi-device network.

Use the Drives Communication selector tables located in the ZIPLink section:

1. Locate your Drive and type of communications.
2. Select a ZIPLink cable and other associated hardware.



Solution 4: Serial Communications Cables

ZIPLink offers communications cables for use with CLICK PLCs that can also be used with other communications devices. Connections include a 6-pin RJ12 connector which can be used in conjunction with the RJ12 Feedthrough module.

Use the Serial Communications Cables selector table located in the ZIPLink section:

1. Locate your connector type
2. Select a cable.



Wiring System for CLICK PLCs

CLICK PLC ZI/Link Selector				
PLC		ZI/Link		
PLC Unit	# of Terms	Component	Module Part No.	Cable Part No.
CO-00DD1-D	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
CO-00DD2-D				
CO-00DR-D				
CO-00AR-D				
CO-01DD1-D				
CO-01DD2-D				
CO-01DR-D				
CO-01AR-D				
CO-10DD1E-D				
CO-10DD2E-D				
CO-10DRE-D				
CO-10ARE-D				
CO-11DD1E-D				
CO-11DD2E-D				
CO-11DRE-D				
CO-11ARE-D				
CO-02DD1-D	20	No ZI/Links are available for analog PLC Units.		
CO-02DD2-D				
CO-02DR-D				

CLICK PLC Discrete Input Module ZIPLink Selector				
I/O Module		ZIPLink		
Input Module	# of Terms	Component	Module Part No.	Cable Part No.
CO-08ND3	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-08ND3-1				
CO-08NE3				
CO-08NA				
CO-16ND3	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
		Sensor	ZL-LTB16-24	
CO-16NE3	20	Feedthrough	ZL-RTB20	
		Sensor	ZL-LTB16-24	

¹ Note: The CO-04TRS relay output is derated not to exceed 2A per point maximum when used with the ZIPLink wiring system.

² Note: Fuses (5 x 20 mm) are not included. See Edison Electronic Fuse section for (5 x 20 mm) fuse. S500 and GMA electronic circuit protection for fast-acting maximum protection. S506 and GMC electronic circuit protection for time-delay performance. Ideal for inductive circuits. To ensure proper operation, do not exceed the voltage and current rating of ZIPLink module. ZL-RFU20 = 2A per circuit.

CLICK PLC Discrete Output Module ZIPLink Selector				
I/O Module		ZIPLink		
Output Module	# of Terms	Component	Module Part No.	Cable Part No.
CO-08TD1	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-08TD2				
CO-08TR				
CO-08TA				
CO-16TD1	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
		Fuse	ZL-RFU20 ²	
		Relay (sinking)	ZL-RL16-24-1	
CO-16TD2	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
		Fuse	ZL-RFU20 ²	
		Relay (sourcing)	ZL-RL16-24-2	
CO-04TRS ¹	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *

CLICK PLC Combo I/O Module ZIPLink Selector				
I/O Module		ZIPLink		
Combo Module	# of Terms	Component	Module Part No.	Cable Part No.
CO-16CDD1	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
CO-16CDD2				
CO-08CDR	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *

CLICK PLC Analog I/O Module ZIPLink Selector				
I/O Module		ZIPLink		
Analog Module	# of Terms	Component	Module Part No.	Cable Part No.
CO-04AD-1	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-04AD-2	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-04RTD	20	No ZIPLinks are available for RTD and thermocouple modules.		
CO-04THM	11			
CO-04DA-1	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-04DA-2	11	Feedthrough	ZL-RTB20	ZL-CO-CBL11 *
CO-4AD2DA-1	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *
CO-4AD2DA-2	20	Feedthrough	ZL-RTB20	ZL-CO-CBL20 *

* Select the cable length by replacing the * with: Blank = 0.5m, -1 = 1.0m, or -2 = 2.0m.