


Field process area

Field Panel FP-X

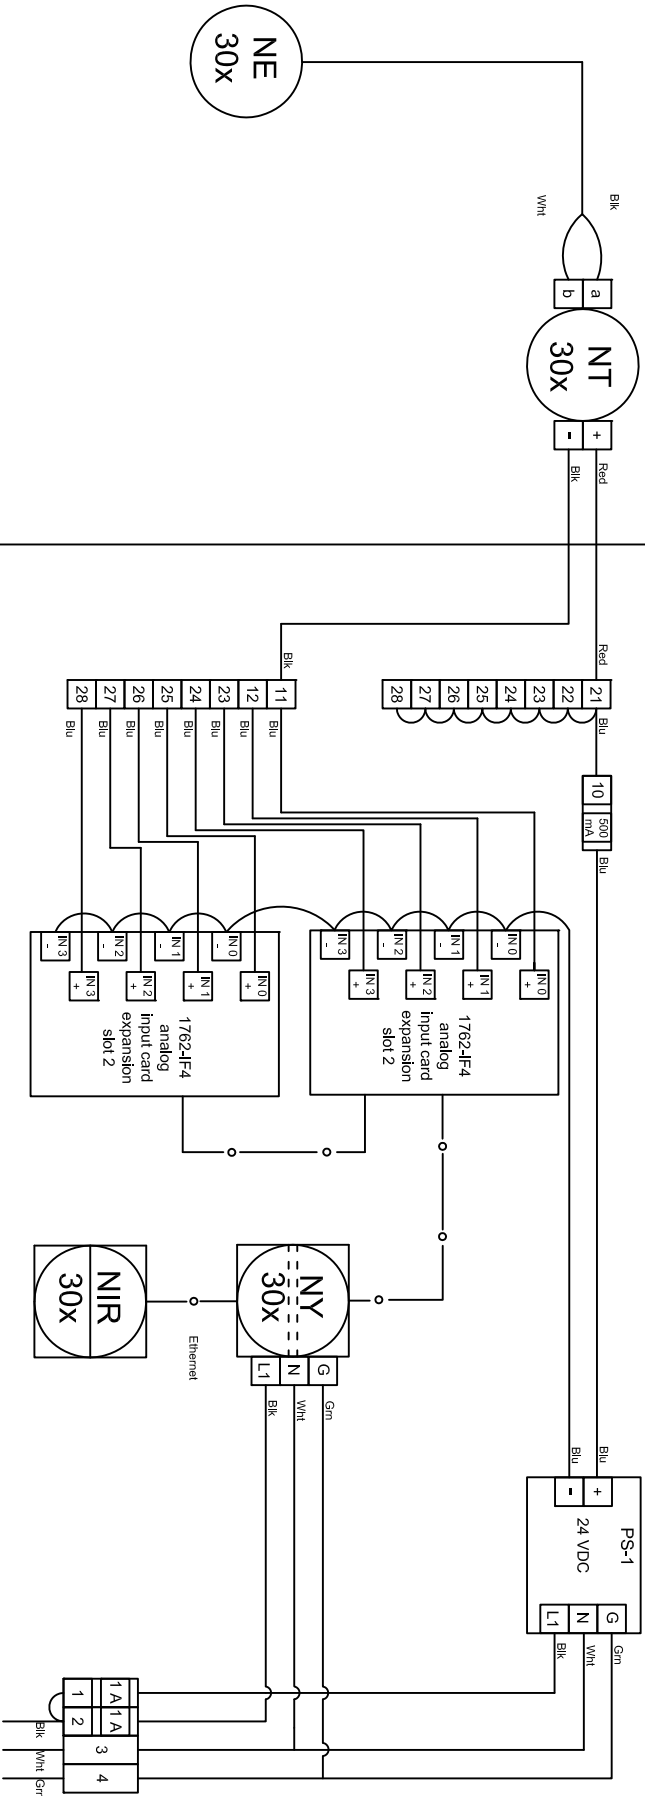

ES 120 VAC
From field
panel disconnect

Tag #	Description	Manufacturer	Model	Input range	Output range	Notes
NE-30x	Sensing element					
NT-30x	Transmitter	Rosemount			4-20 mA	
NY-30x	PLC	Allen-Bradley	ML1100	4-20 mA		IP=169.25.10.x Mask=255.255.0.0
NIR-30x	HMI touch-panel	Automation Direct	C-More			