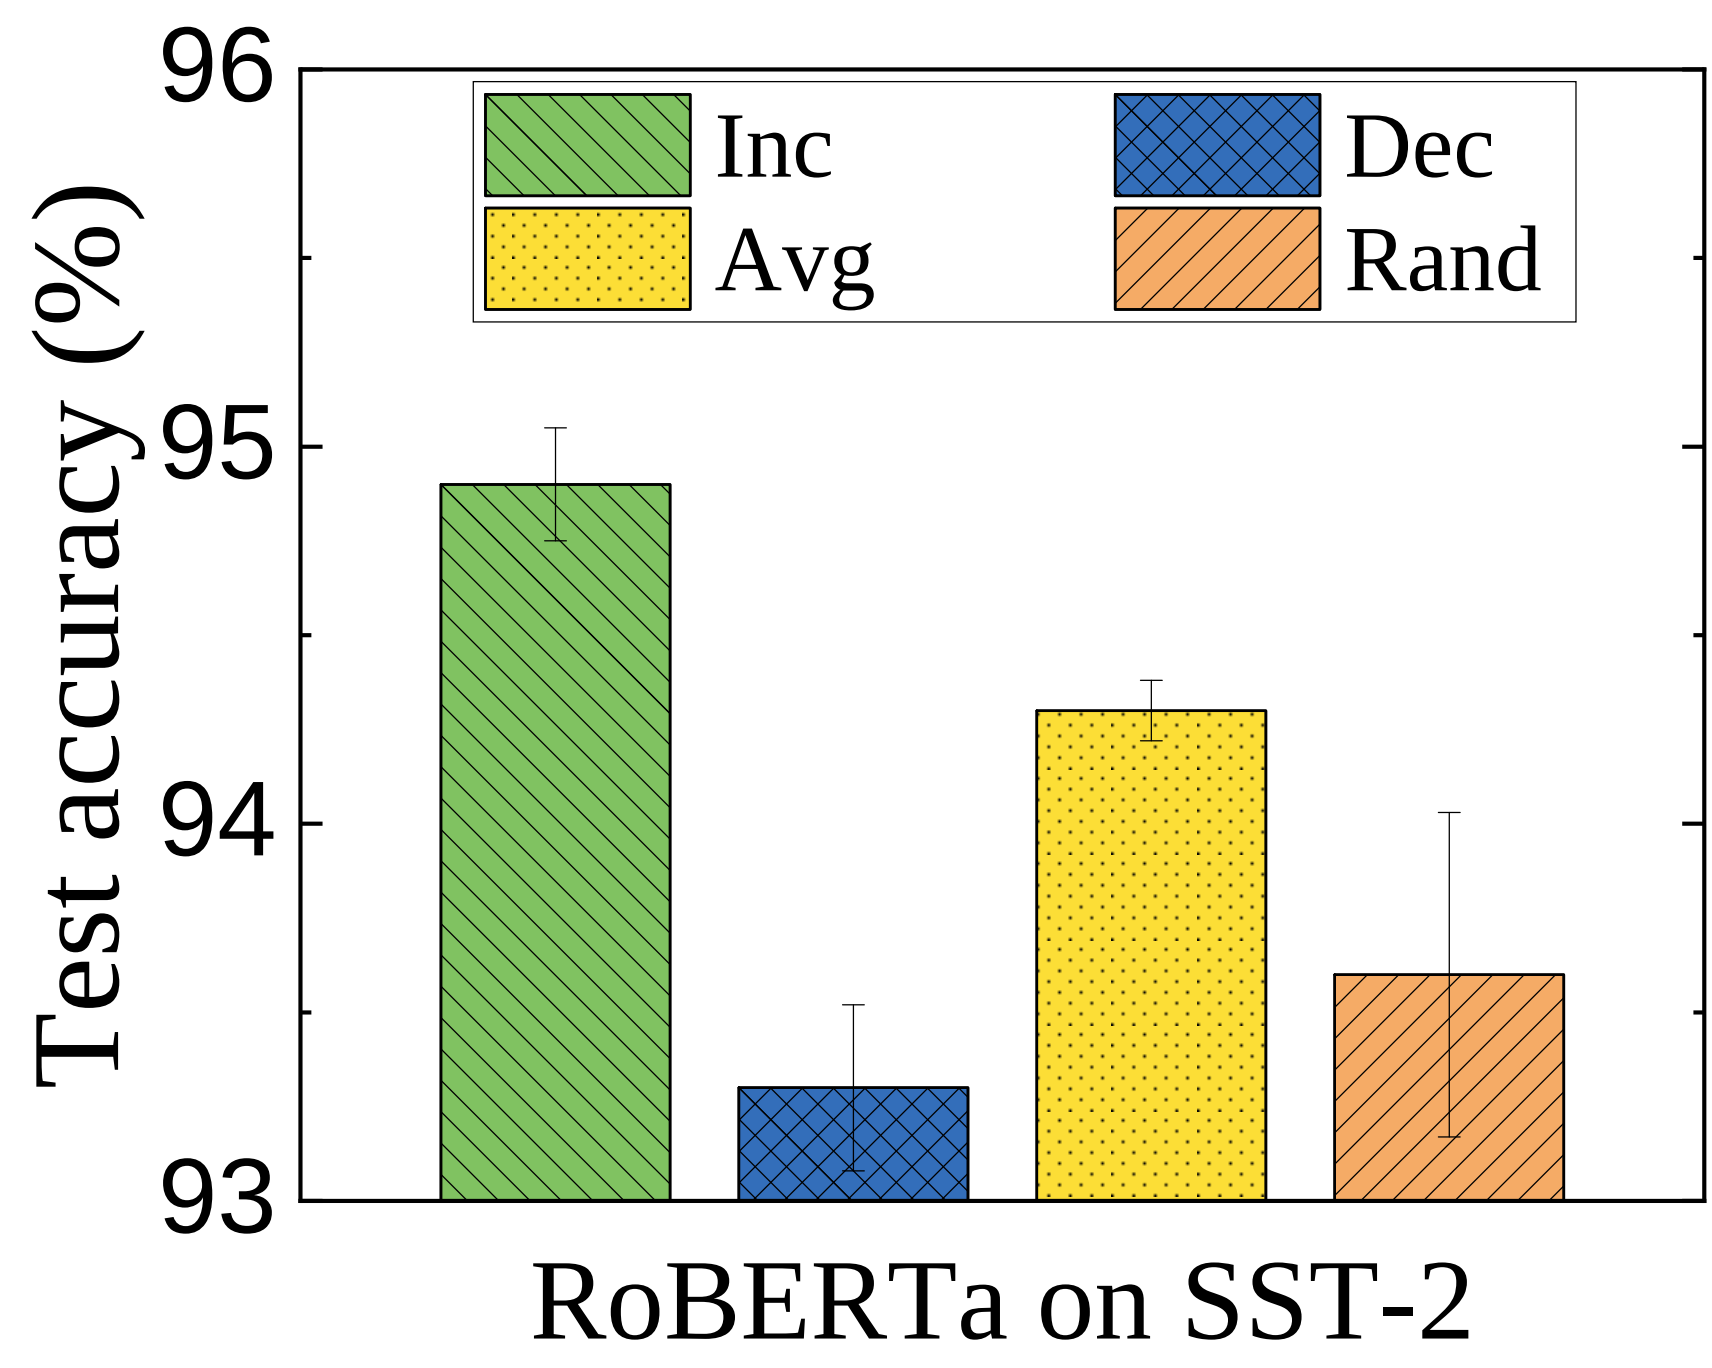
96
95
94
93
Test accuracy (%)
Inc
Dec
Avg
Rand
RoBERTa on SST-2