PID Tuner (sistema1/Hipertenso/PID Controller)

PID TUNER

Plant | Type PIDF | Form Parallel | Options | Domain: Time | Add Plot | Slower / Response Time (seconds) / Faster | Aggressive / Transient Behavior / Robust | 0.001817 | 0.9 | Reset Design | Show Parameters | Update Block

PLANT | CONTROLLER | DESIGN | TUNING TOOLS | RESULTS

Plant List

Step Plot: Reference tracking


Show

Controller Parameters

	Tuned	Block
P	10.3498	10.3498
I	2937.959	2937.959
D	0.0018189	0.0018189
N	2977.4136	2977.4136

Performance and Robustness

	Tuned	B
Rise time	0.00169 seconds	0
Settling time	0.00977 seconds	0
Overshoot	7.78 %	7

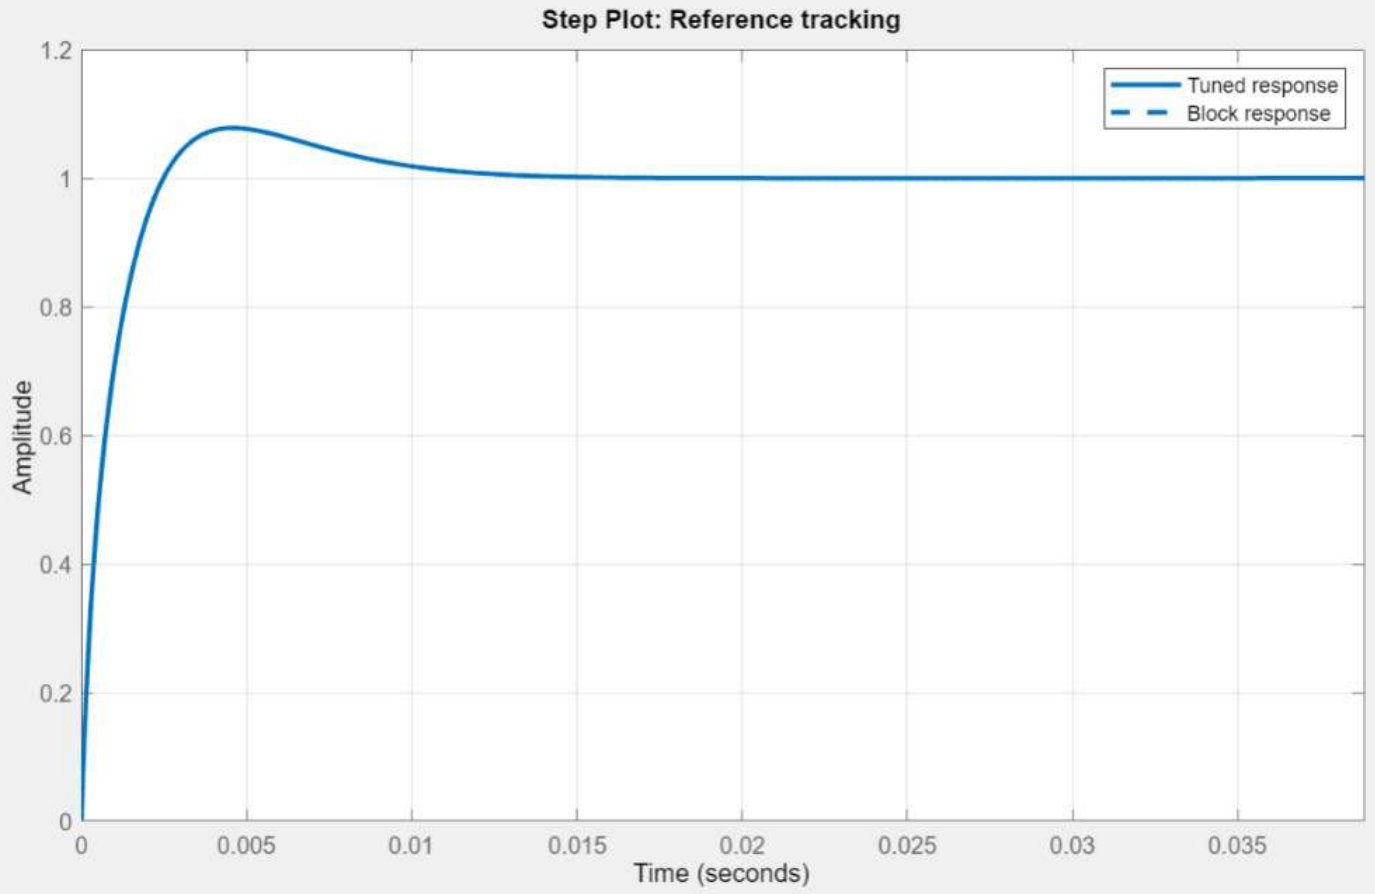

PID gains applied to block and block response updated

Controller Parameters: P = 10.35, I = 2938, D = 0.001819, N = 2977