PID Tuner (sistema1/Hipotenso/PID Controller)

PID TUNER

Plant | Type PIDF | Form Parallel | Options | Domain: Time | Add Plot | Slower / Response Time (seconds) / Faster | Aggressive / Transient Behavior / Robust | 0.0015 | 0.9 | Reset Design | Show Parameters | Update Block

PLANT | CONTROLLER | DESIGN | TUNING TOOLS | RESULTS

Plant List

Step Plot: Reference tracking


Show

Controller Parameters

	Tuned	Block
P	45.4906	45.4906
I	10942.5878	10942.5878
D	0.0058593	0.0058593
N	4951.5602	4951.5602

Performance and Robustness

	Tuned	Bl
Rise time	0.00135 seconds	0.(
Settling time	0.00998 seconds	0.(
Overshoot	9.27 %	9.2
Peak	1.09	1.(
Gain margin	Inf dB @ NaN rad/s	Inf

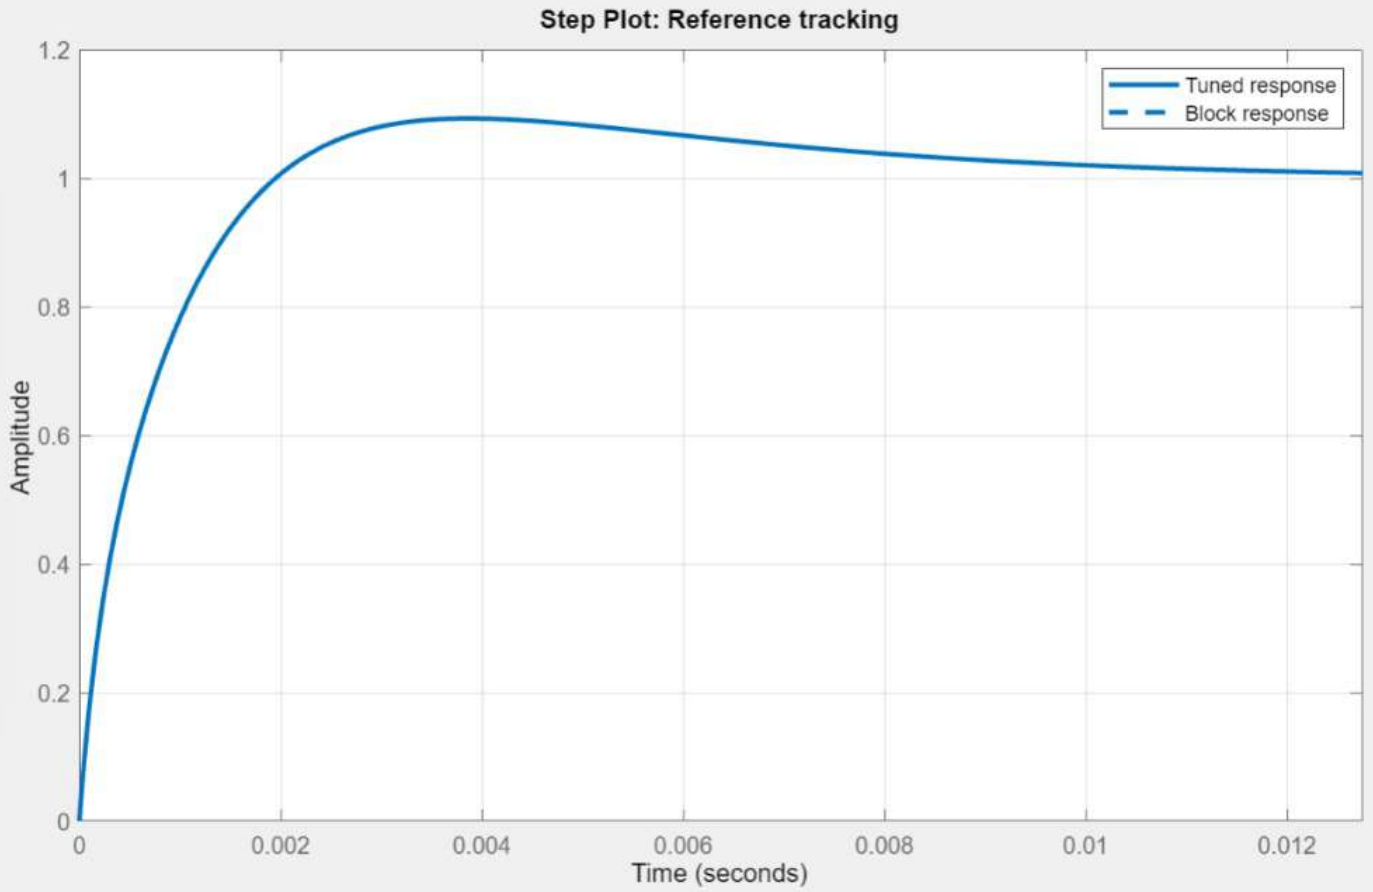

PID gains applied to block and block response updated

Controller Parameters: P = 45.49, I = 1.094e+04, D = 0.005859, N = 4952