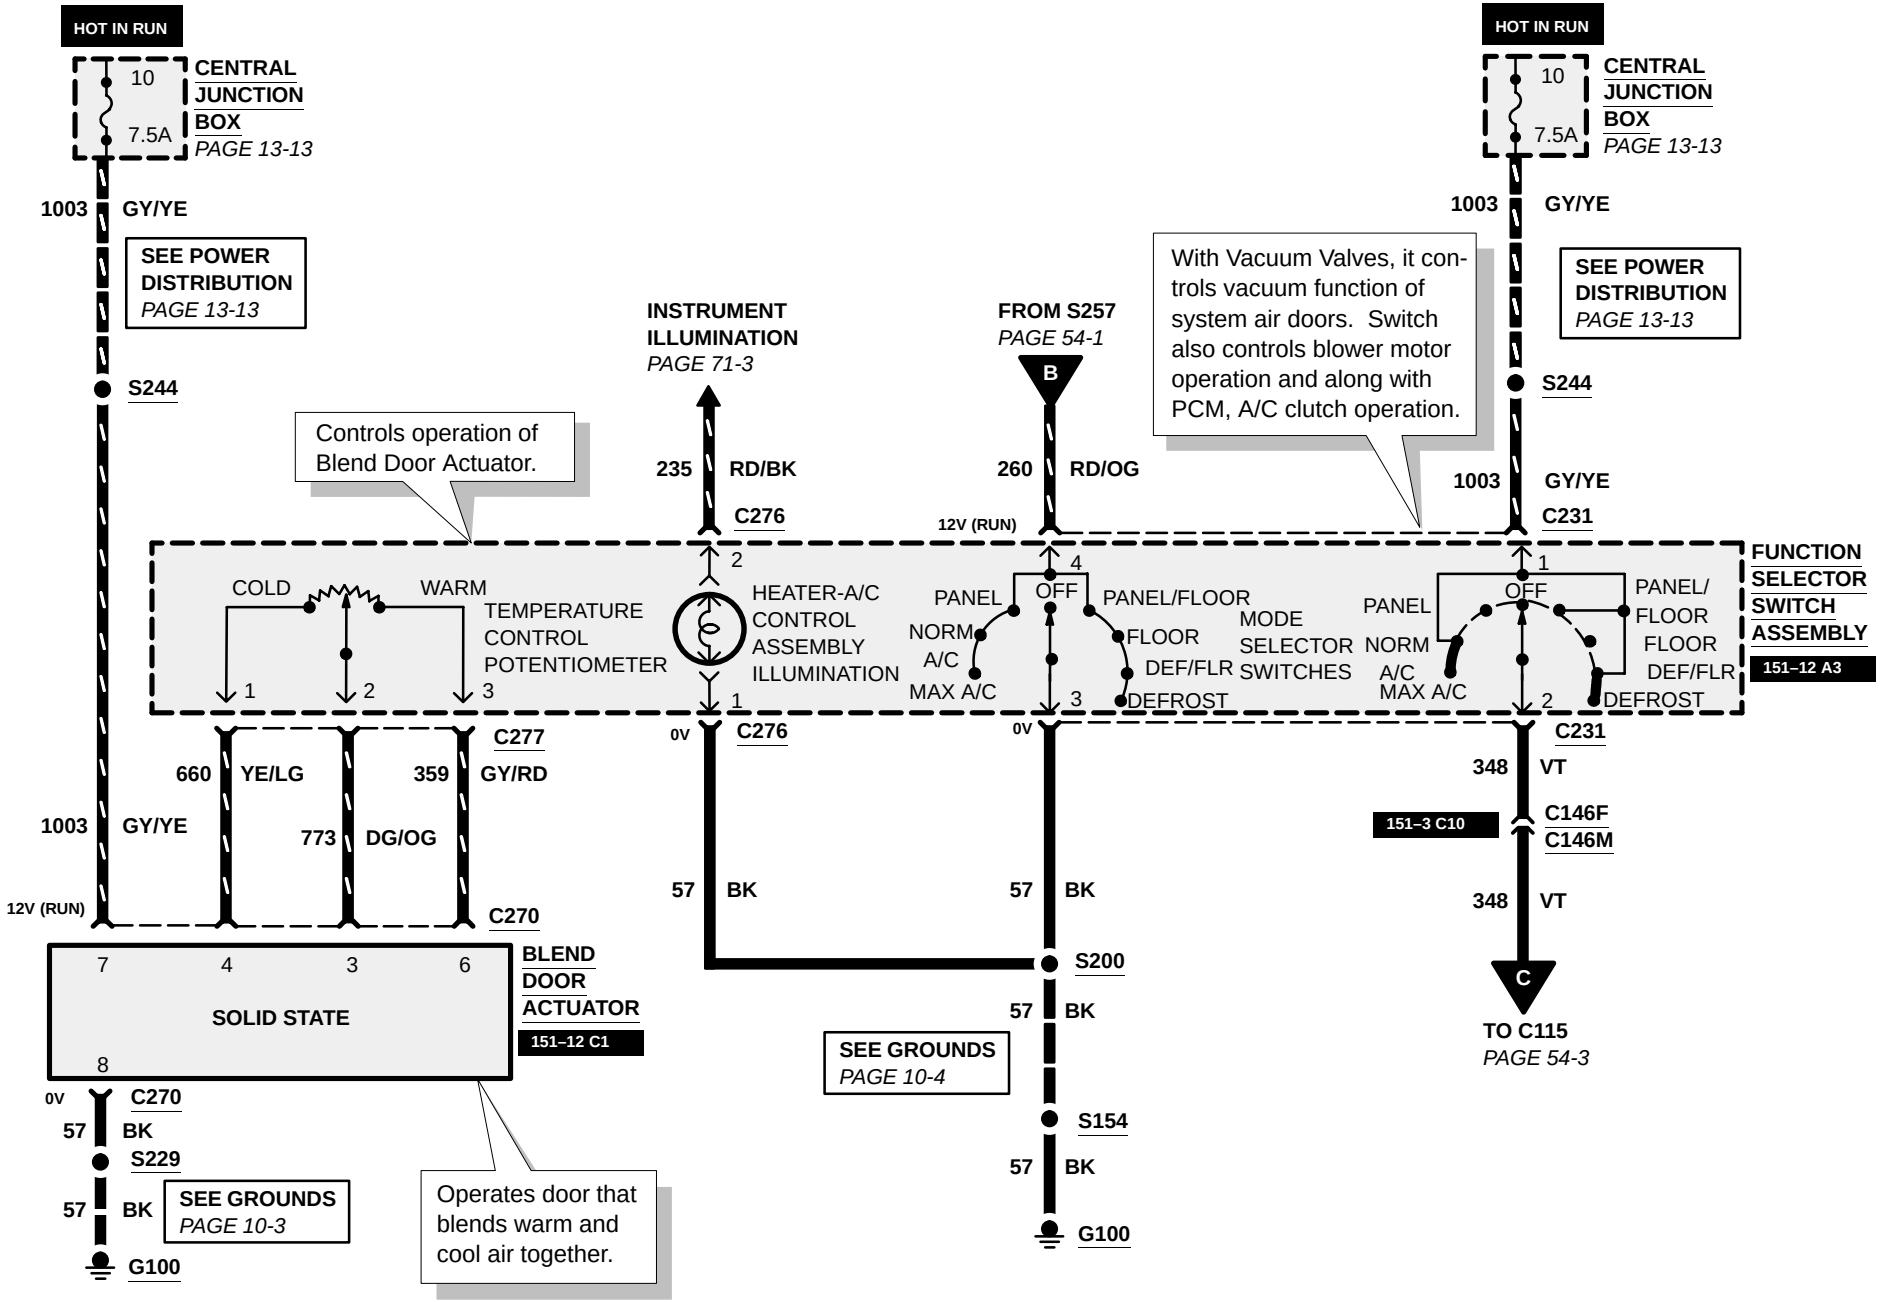
HOT IN RUN
10
7.5A
CENTRAL JUNCTION BOX
PAGE 13-13
1003 GY/YE
SEE POWER DISTRIBUTION
PAGE 13-13
S244
Controls operation of Blend Door Actuator.
INSTRUMENT ILLUMINATION
PAGE 71-3
235 RD/BK
C276
FROM S257
PAGE 54-1
B
260 RD/OG
12V (RUN)
With Vacuum Valves, it controls vacuum function of system air doors. Switch also controls blower motor operation and along with PCM, A/C clutch operation.
1003 GY/YE
C231
FUNCTION SELECTOR SWITCH ASSEMBLY
151–12 A3
COLD
WARM
TEMPERATURE CONTROL POTENTIOMETER
HEATER-A/C CONTROL ASSEMBLY ILLUMINATION
PANEL
OFF
PANEL/FLOOR
NORM A/C
FLOOR
DEF/FLR
MAX A/C
DEFROST
MODE SELECTOR SWITCHES
PANEL/ FLOOR
660 YE/LG
359 GY/RD
773 DG/OG
C277
C270
0V
57 BK
S200
S154
G100
348 VT
C146F
C146M
151–3 C10
TO C115
PAGE 54-3
SOLID STATE
BLEND DOOR ACTUATOR
151–12 C1
SEE GROUNDS
PAGE 10-4
SEE GROUNDS
PAGE 10-3
Operates door that blends warm and cool air together.