-2

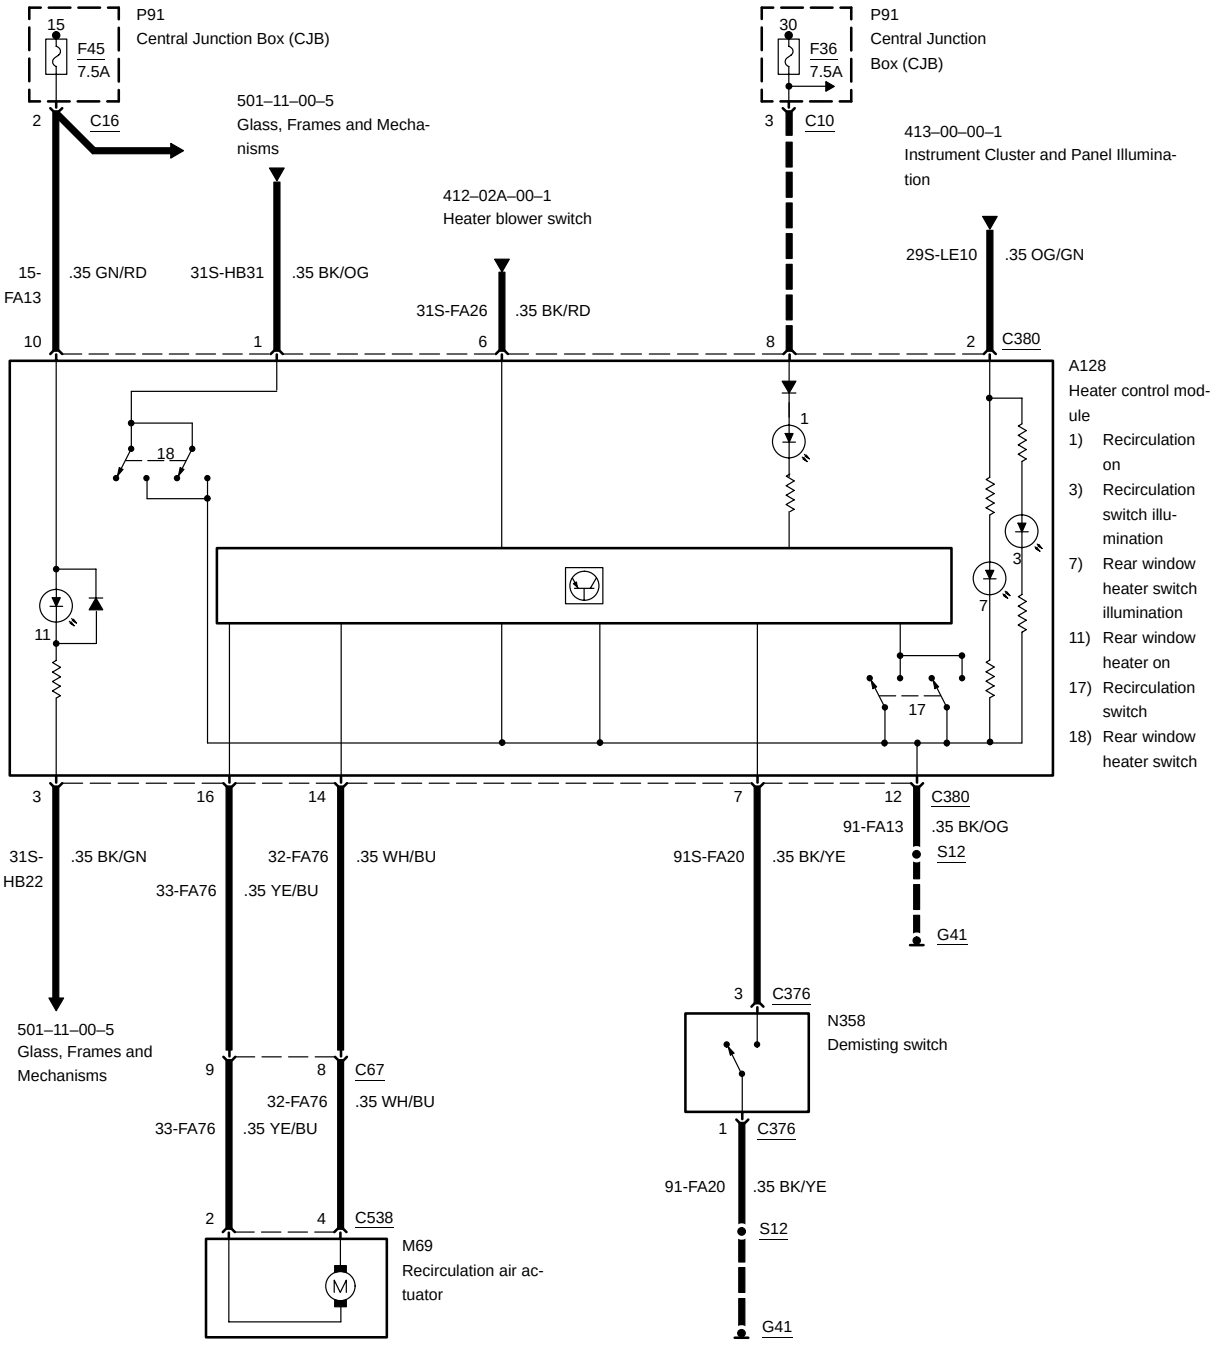
15
F45
7.5A
P91
Central Junction Box (CJB)
2
C16
501–11–00–5
Glass, Frames and Mechanisms
30
F36
7.5A
P91
Central Junction Box (CJB)
3
C10
413–00–00–1
Instrument Cluster and Panel Illumination
412–02A–00–1
Heater blower switch
15-FA13 .35 GN/RD
31S-HB31 .35 BK/OG
31S-FA26 .35 BK/RD
29S-LE10 .35 OG/GN
10
1
6
8
2
C380
A128
Heater control module
1) Recirculation on
3) Recirculation switch illumination
7) Rear window heater switch illumination
11) Rear window heater on
17) Recirculation switch
18) Rear window heater switch
18
1
3
7
11
17
3
16
14
7
12
C380
91-FA13 .35 BK/OG
31S-HB22 .35 BK/GN
32-FA76 .35 WH/BU
33-FA76 .35 YE/BU
91S-FA20 .35 BK/YE
S12
G41
501–11–00–5
Glass, Frames and Mechanisms
3
C376
N358
Demisting switch
9
8
C67
32-FA76 .35 WH/BU
33-FA76 .35 YE/BU
1
C376
91-FA20 .35 BK/YE
S12
G41
2
4
C538
M69
Recirculation air actuator
M