F228

-14

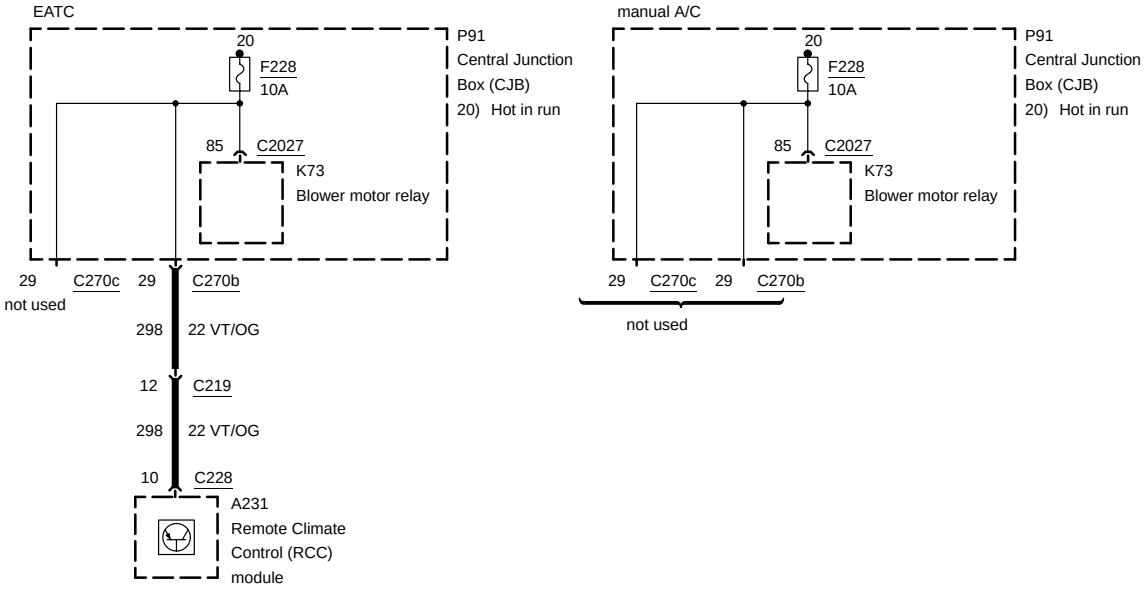
EATC
20
F228
10A
P91
Central Junction
Box (CJB)
20) Hot in run
85
C2027
K73
Blower motor relay
29
not used
C270c
29
C270b
298
22 VT/OG
12
C219
298
22 VT/OG
10
C228
A231
Remote Climate
Control (RCC)
module
manual A/C
20
F228
10A
P91
Central Junction
Box (CJB)
20) Hot in run
85
C2027
K73
Blower motor relay
29
C270c
29
C270b
not used