-2

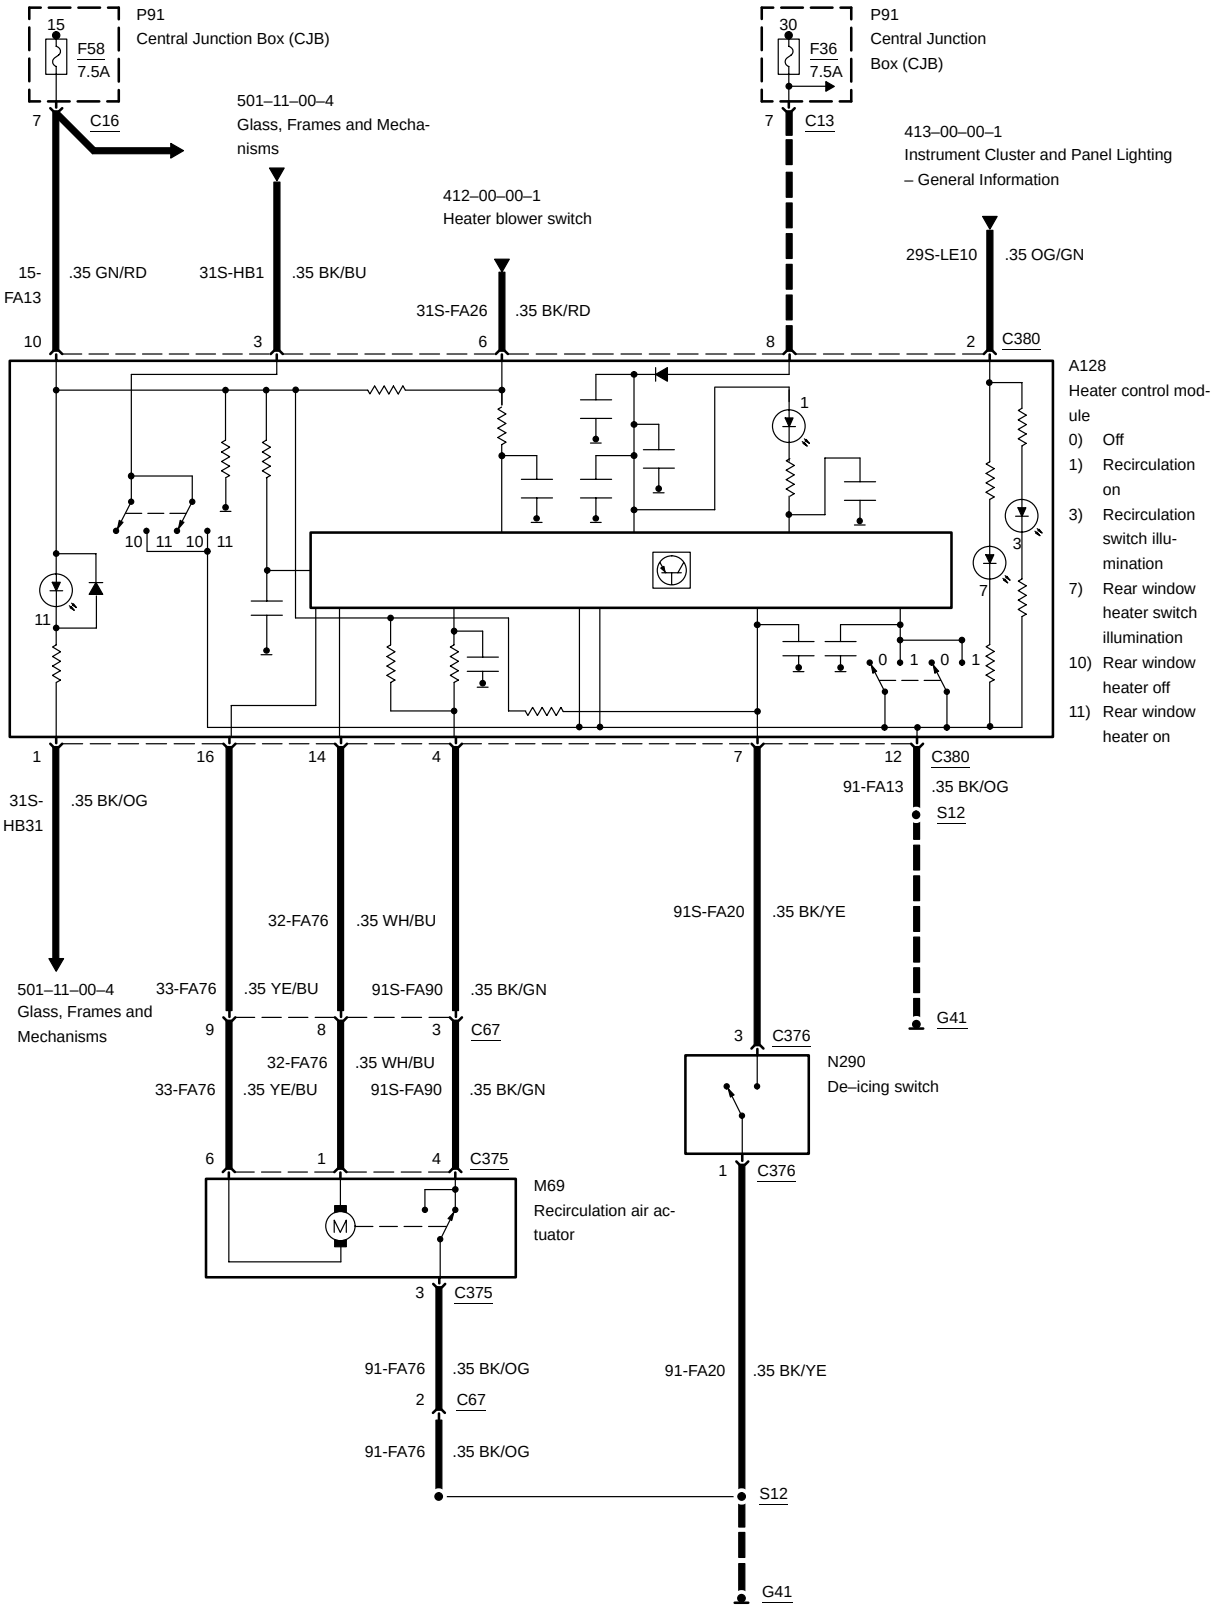
P91
Central Junction Box (CJB)
15
F58
7.5A
7
C16
501–11–00–4
Glass, Frames and Mechanisms
P91
Central Junction Box (CJB)
30
F36
7.5A
7
C13
413–00–00–1
Instrument Cluster and Panel Lighting – General Information
412–00–00–1
Heater blower switch
15-FA13 .35 GN/RD
31S-HB1 .35 BK/BU
31S-FA26 .35 BK/RD
29S-LE10 .35 OG/GN
10
3
6
8
2
C380
A128
Heater control module
0) Off
1) Recirculation on
3) Recirculation switch illumination
7) Rear window heater switch illumination
10) Rear window heater off
11) Rear window heater on
1
16
14
4
7
12
C380
31S-HB31 .35 BK/OG
91-FA13 .35 BK/OG
S12
32-FA76 .35 WH/BU
91S-FA20 .35 BK/YE
501–11–00–4
Glass, Frames and Mechanisms
33-FA76 .35 YE/BU
91S-FA90 .35 BK/GN
9
8
3
C67
G41
3
C376
N290
De–icing switch
32-FA76 .35 WH/BU
33-FA76 .35 YE/BU
91S-FA90 .35 BK/GN
6
1
4
C375
1
C376
M69
Recirculation air actuator
3
C375
91-FA76 .35 BK/OG
91-FA20 .35 BK/YE
2
C67
91-FA76 .35 BK/OG
S12
G41