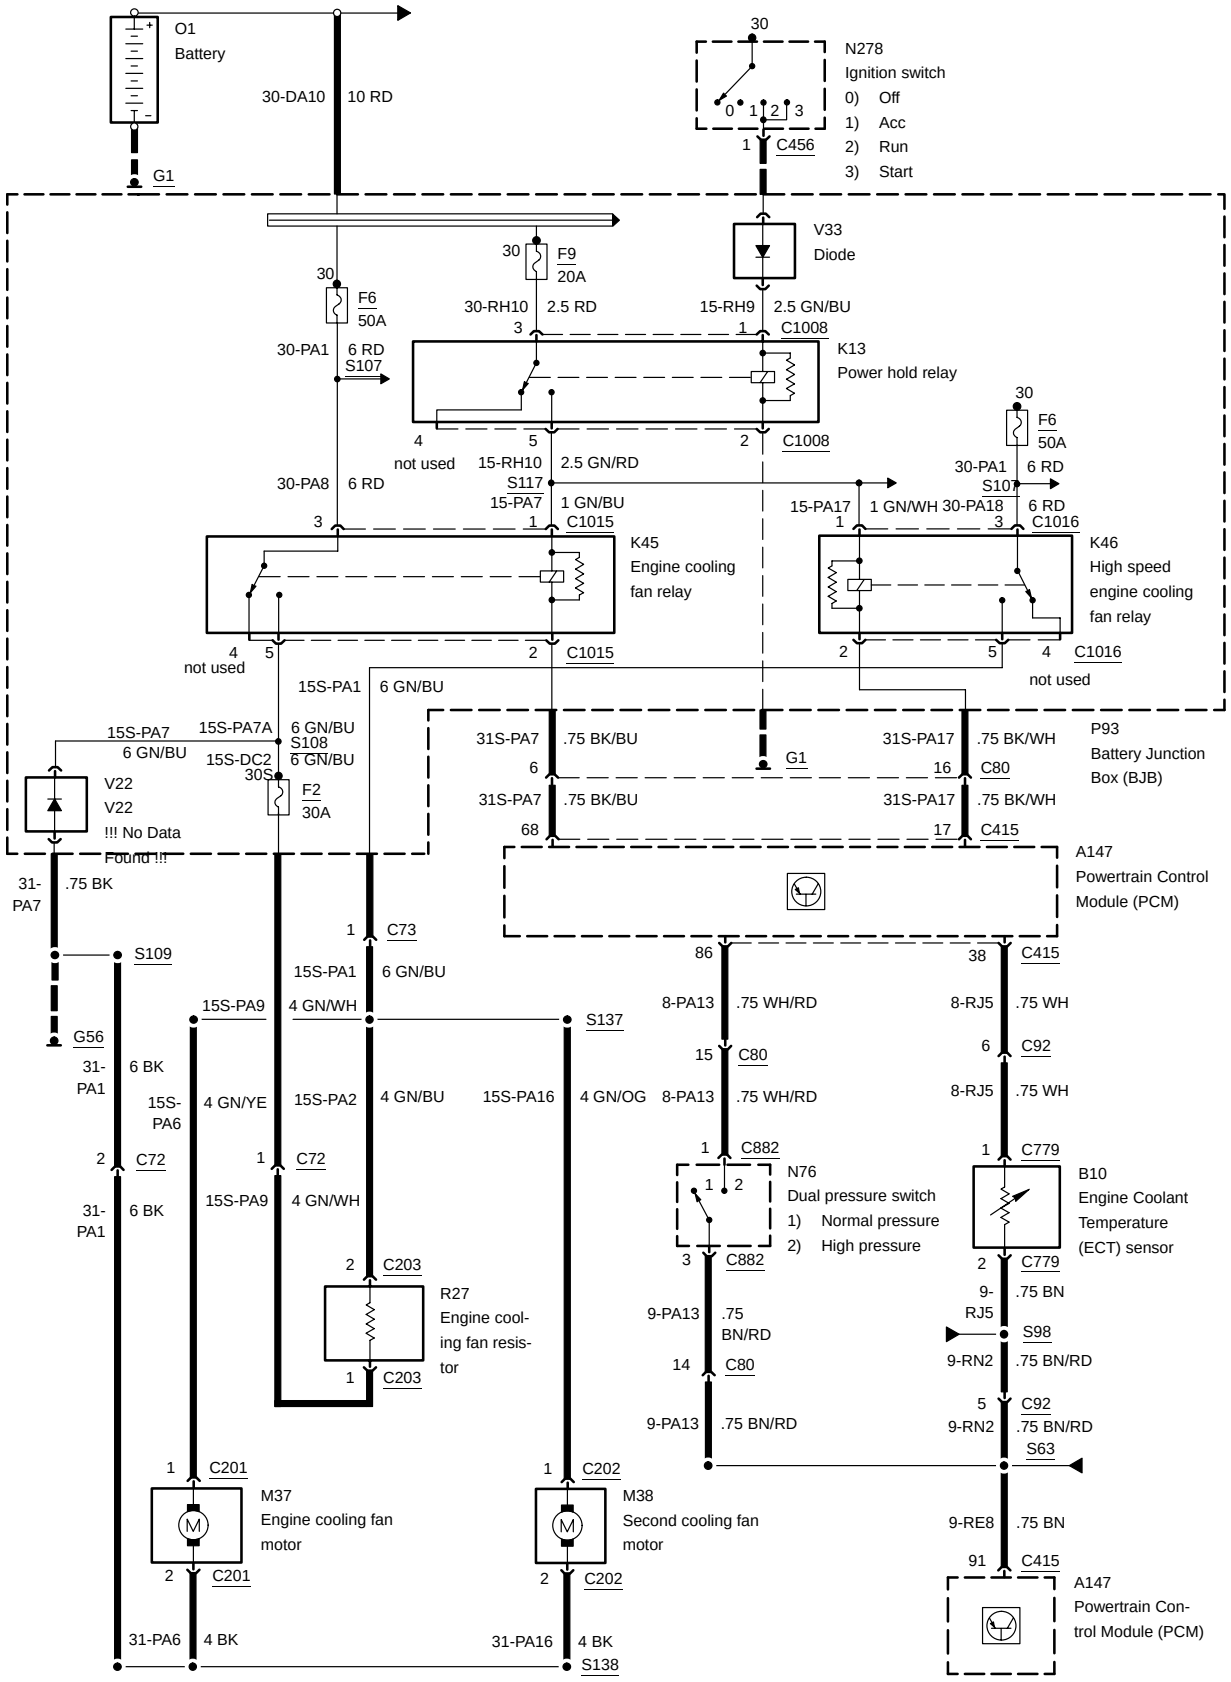Air conditioning, SPI -5