

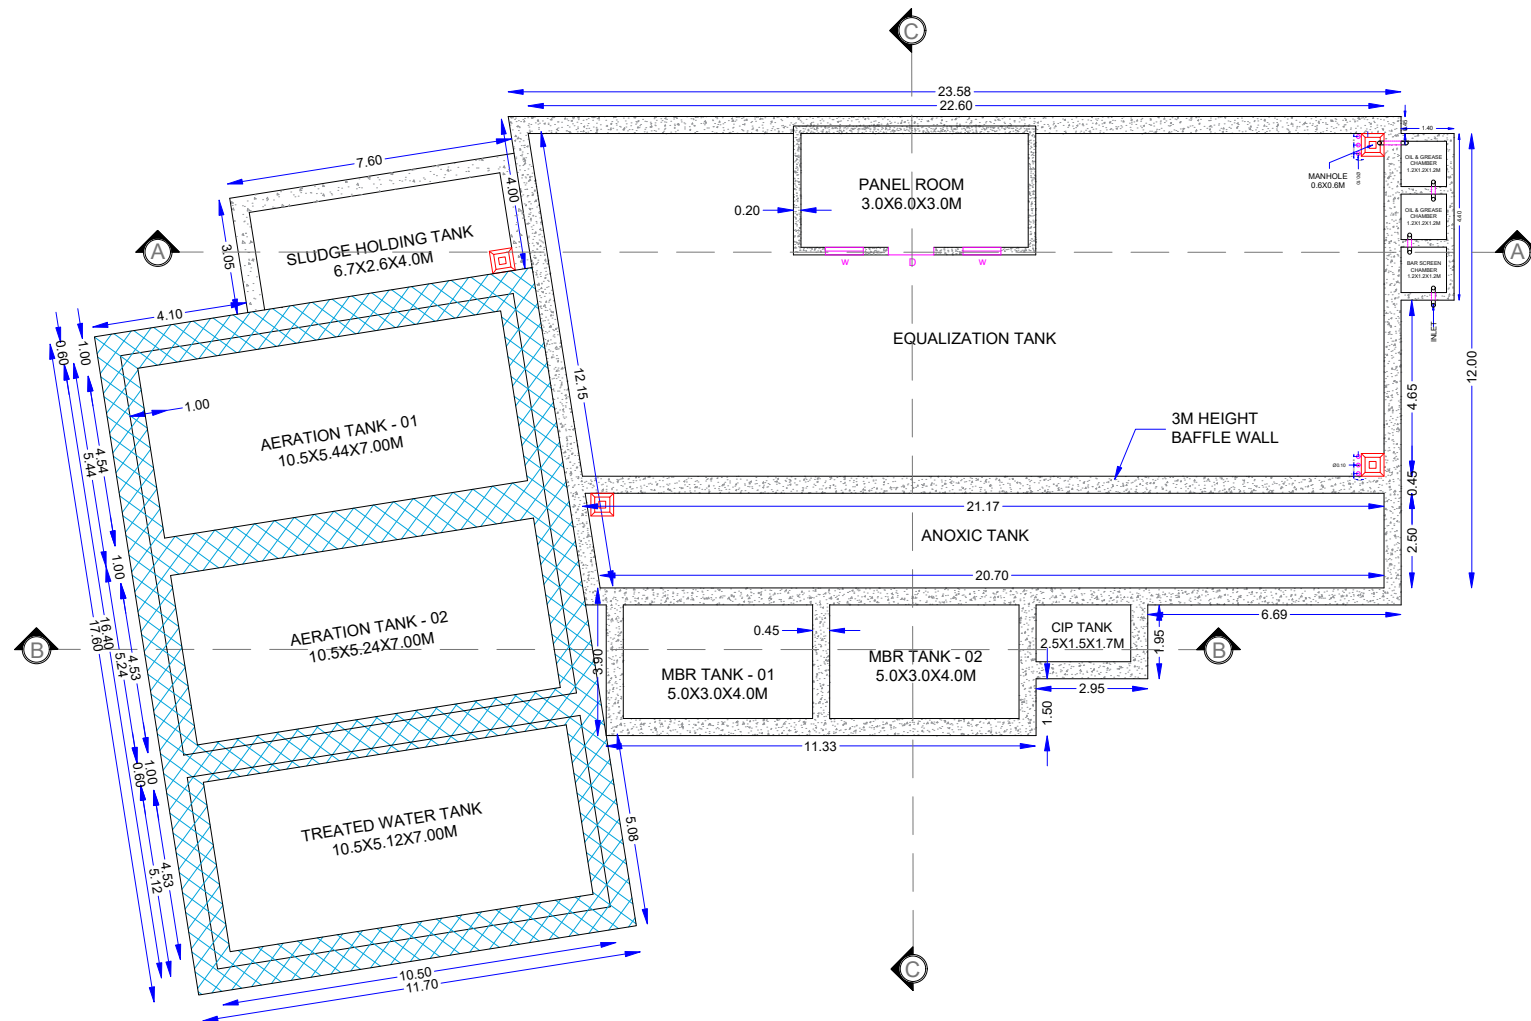


1.5MLD MBR BASED STP TENTATIVE PLAN, K.V.G. MEDICAL COLLEGE & HOSPITAL, SULLIA



PLAN

KEY PLAN:



GENERAL NOTES:

- THIS DRAWING IS THE PROPERTY OF AAPAAVANI. DUPLICATION OF THESE DRAWINGS IN ANY MODEL IS PROHIBITED.
- DO NOT SCALE THE DRAWINGS, READ THE WRITTEN DIMENSIONS.
- ANY DISCREPANCY HAS TO BE REPORTED TO THE CONSULTANTS.
- PLAN MAY CHANGE AS PER SITE CONDITIONS.

FOR APPROVAL

REV	DATE	REMARK
(R1)		
(R2)		
(R3)		
(R4)		

LEGEND

---	GUIDE LINE
---	CORE CUTTING

DATE: 25/08/2026 SCALE: NTS

DWG NO: AES/KVG/STP/PLN-01

ALL DIMENSIONS ARE IN METER

PROJECT TITLE:

GENERAL ARRANGEMENT DRAWING

DRAWN BY: PRP

DESIGNED BY: PRP




CONSULTANTS:

 AAPAAVANI ENVIRONMENTAL SOLUTIONS PVT LTD
SHED NO C-51, INDUSTRIAL AREA
BEHIND BANK OF BARODA,
BAIKAMPADY, MANGALORE DK-575011
Phone: 9980584372, 8147901288
E-mail: projects@aapaavani.com


CLIENT:

K.V.G. MEDICAL COLLEGE & HOSPITAL,
SULLIA

1.5MLD MBR BASED STP TENTATIVE PLAN, K.V.G. MEDICAL COLLEGE & HOSPITAL, SULLIA

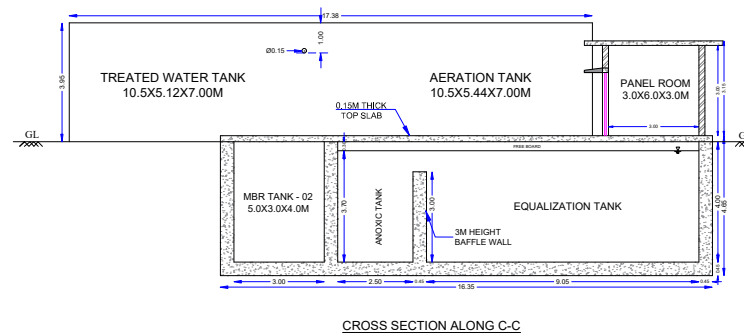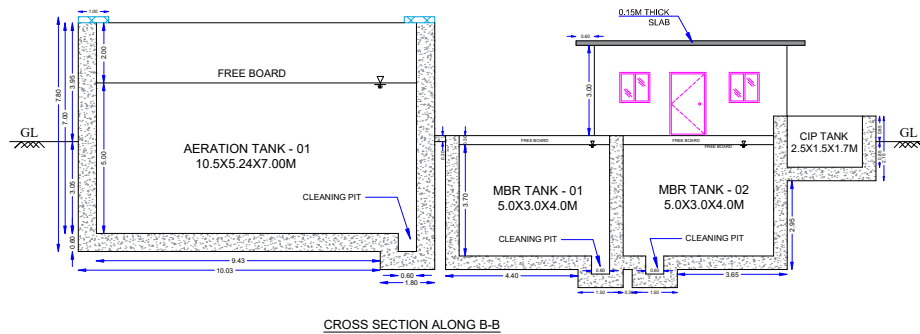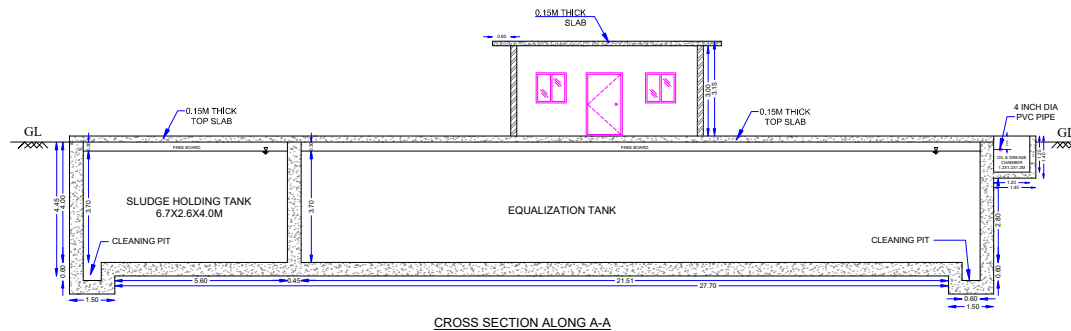

KEY PLAN:

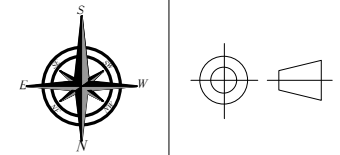

GENERAL NOTES:

- THIS DRAWING IS THE PROPERTY OF AAPAAVANI. DUPLICATION OF THESE DRAWINGS IN ANY MODEL IS PROHIBITED.
- DO NOT SCALE THE DRAWINGS, READ THE WRITTEN DIMENSIONS.
- ANY DISCREPANCY HAS TO BE REPORTED TO THE CONSULTANTS.
- PLAN MAY CHANGE AS PER SITE CONDITIONS.

FOR APPROVAL

REV	DATE	REMARK
(R1)		
(R2)		
(R3)		
(R4)		

LEGEND

---	GUIDE LINE
---	CORE CUTTING

DATE: 25/08/2026

SCALE: NTS

NOTES:

- All dimensions are in Meter, No dimension shall be scaled from the drawing.
- Reinforcement shall be HYSD bars of Min grade Fe550 conforming to IS:1786-1985. Grade of concrete M30 conforming to IS: 456.
- Reinforcement should be checked by structural engineer before concreting.
- Any discrepancies should be brought to the notice of structural engineer before concreting.
- All reinforcement shall have adequate development length.
- Minimum depth of excavation shall be 3meter from Natural ground level otherwise till the availability of Hard soil.
- SBC considered for foundation design is 120KN/Sqm.
- Provide 150mm thick PCC bed for all footings with 75mm offset on all side.
- Compaction of concrete shall be done by mechanical vibrator, Proper care shall be taken to avoid segregation and honeycombing.
- The side wall shall be cast not more than the 1.2m at one pour of concrete.
- In case of side wall are cast more than one time it is advised to provide water beading of approved make.
- Bar screen and oil & grease chambers are open type. Provide removable top cover (MS or suitable rigid material) for easy cleaning.

DWG NO: AES/KVG/STP/PLN-01

ALL DIMENSIONS ARE IN METER

PROJECT TITLE:

GENERAL ARRANGEMENT DRAWING

DRAWN BY:	PRP
DESIGNED BY:	PRP

CONSULTANTS:



AAPAAVANI ENVIRONMENTAL SOLUTIONS PVT LTD
SHED NO C-51, INDUSTRIAL AREA
BEHIND BANK OF BARODA,
BAIKAMPADY, MANGALORE DK-575011
Phone: 9980584372, 8147901288
E-mail: projects@aapaavani.com

CLIENT:

K.V.G. MEDICAL COLLEGE & HOSPITAL,
SULLIA