VESTIBULAR technologies

CAPS EQ™

Tuesday, May 20, 2025

Subject's Information

Name: (Hidden)
ID: xx
Notes:

Gender: Female
Date of Birth: 1/11/1974

Table of Contents

Balance Test 1 - Test Type: PSEC, Test Date: 5/20/2025, Test Name: Foam Eyes Closed HN
Balance Test 1 - Test Type: PSEC, Test Date: 5/20/2025, Test Name: Foam Eyes Closed HN
Balance Test 1 - Test Type: PSEC, Test Date: 5/20/2025, Test Name: Foam Eyes Closed HN
Balance Test 1 - Test Type: PSEC, Test Date: 5/20/2025, Test Name: Foam Eyes Closed HN
Balance Tests Comparison

Evaluation

Intervention


David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com

VESTIBULAR technologies

Subject's ID: xx
51 Years Old Female
Tuesday, May 20, 2025

CAPS EQ™

Computerized Posturography Results

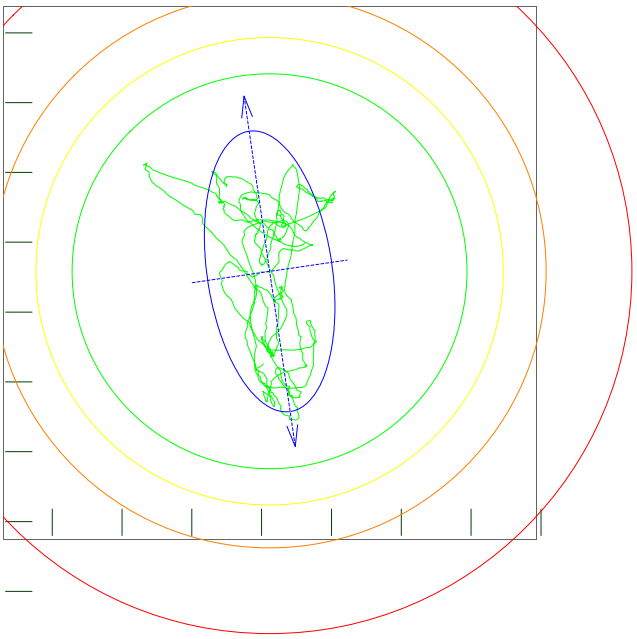

Divisions Interval 0.394" or 10.0 mm

Test Name	Foam Eyes Closed HN
Test Type	PSEC
Test Date	5/20/2025 02:17 PM
Test Parameters	19.997s @ 64.011 Hz
Samples: Total & Valid	1280 & 1280
Test Status	Completed
Sway Center [Xo, Yo]	[0.0611 m, 0.0658 m]
Max Theoretical Sway (LoS)	0.1952 m
ML Sway: Max & 95% Conf.	0.0064 m & 0.0187 m
AP Sway: Max & 95% Conf.	0.0179 m & 0.0402 m
95% Conf. Sway: Max & Min	0.0406 m & 0.0179 m
Actual Sway: Max & Ave	0.0236 m & 0.0102 m
Sway Velocity: Max & Ave	0.081 m/s & 0.022 m/s
Sway Acceler.: Max & Ave	1.527 m/s² & 0.323 m/s²
Sway Path Length	0.4302 m
Area 95% Conf. Ellipse	0.0005714 m²
Stability Score	**79.2%**
Stability Class	**Healthy Balance**
Pred. Direction of Sway	-81.7 deg
Directionality	56%
Fatigue Ratio	34.5%
Adaptation Ratio	0.0%
Parameter p	7.3
Height	1.63 m
Weight	206 lb 3 oz
Body Mass Index	35.2
Body Mass Index Class	Obese

Stability Level:	**Healthy Balance**	Mildly Reduced	Moderately Reduced	Severely Reduced	Profoundly Reduced
Reference Values:	**>= 71.0%**	65.7-70.9%	59.4-65.6%	46.8-59.3%	<= 46.7%

Results Interpretation

According to CDC guidelines the patient is obese.
According to independent peer-reviewed age-based reference studies the patient has a healthy balance/stability.

Notes


David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com

VESTIBULAR technologies

Subject's ID: xx
51 Years Old Female
Tuesday, May 20, 2025

CAPS EQ™

Computerized Posturography Results

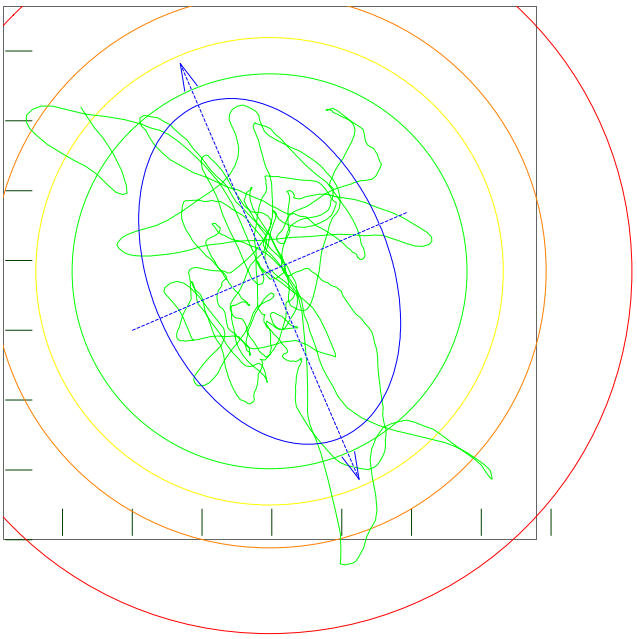

Divisions Interval 0.394" or 10.0 mm

Test Name	Foam Eyes Closed HN
Test Type	PSEC
Test Date	5/20/2025 02:17 PM
Test Parameters	19.997s @ 64.011 Hz
Samples: Total & Valid	1280 & 1280
Test Status	Completed
Sway Center [Xo, Yo]	[0.0597 m, 0.0584 m]
Max Theoretical Sway (LoS)	0.1952 m
ML Sway: Max & 95% Conf.	0.0180 m & 0.0375 m
AP Sway: Max & 95% Conf.	0.0347 m & 0.0495 m
95% Conf. Sway: Max & Min	0.0519 m & 0.0342 m
Actual Sway: Max & Ave	0.0436 m & 0.0134 m
Sway Velocity: Max & Ave	0.272 m/s & 0.053 m/s
Sway Acceler.: Max & Ave	5.254 m/s² & 0.754 m/s²
Sway Path Length	1.0631 m
Area 95% Conf. Ellipse	0.0013933 m²
Stability Score	**73.4%**
Stability Class	**Healthy Balance**
Pred. Direction of Sway	-66.7 deg
Directionality	34%
Fatigue Ratio	24.2%
Adaptation Ratio	0.0%
Parameter p	3.6
Height	1.63 m
Weight	207 lb 5 oz
Body Mass Index	35.4
Body Mass Index Class	Obese

Stability Level:	**Healthy Balance**	Mildly Reduced	Moderately Reduced	Severely Reduced	Profoundly Reduced
Reference Values:	**>= 71.0%**	65.7-70.9%	59.4-65.6%	46.8-59.3%	<= 46.7%

Results Interpretation

According to CDC guidelines the patient is obese.
According to independent peer-reviewed age-based reference studies the patient has a healthy balance/stability.

Notes


David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com

VESTIBULAR technologies

Subject's ID: xx
51 Years Old Female
Tuesday, May 20, 2025

CAPS EQ™

Computerized Posturography Results

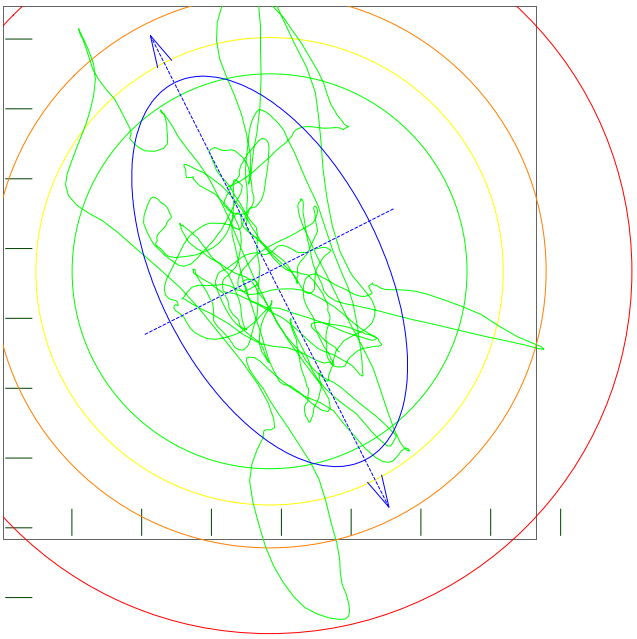

Divisions Interval 0.394" or 10.0 mm

Test Name	Foam Eyes Closed HN
Test Type	PSEC
Test Date	5/20/2025 02:19 PM
Test Parameters	19.997s @ 64.011 Hz
Samples: Total & Valid	1280 & 1280
Test Status	Completed
Sway Center [Xo, Yo]	[0.0483 m, 0.0667 m]
Max Theoretical Sway (LoS)	0.1952 m
ML Sway: Max & 95% Conf.	0.0174 m & 0.0395 m
AP Sway: Max & 95% Conf.	0.0245 m & 0.0559 m
95% Conf. Sway: Max & Min	0.0605 m & 0.0320 m
Actual Sway: Max & Ave	0.0510 m & 0.0148 m
Sway Velocity: Max & Ave	0.321 m/s & 0.064 m/s
Sway Acceler.: Max & Ave	5.154 m/s² & 0.888 m/s²
Sway Path Length	1.2743 m
Area 95% Conf. Ellipse	0.0015197 m²
Stability Score	**69.0%**
Stability Class	**Mildly Reduced**
Pred. Direction of Sway	-63.2 deg
Directionality	47%
Fatigue Ratio	23.4%
Adaptation Ratio	0.0%
Parameter p	3.3
Height	1.63 m
Weight	205 lb 6 oz
Body Mass Index	35.1
Body Mass Index Class	Obese

Stability Level:	Healthy Balance	Mildly Reduced	Moderately Reduced	Severely Reduced	Profoundly Reduced
Reference Values:	>= 71.0%	65.7-70.9%	59.4-65.6%	46.8-59.3%	<= 46.7%

Results Interpretation

According to CDC guidelines the patient is obese.
According to independent peer-reviewed age-based reference studies the patient's balance/stability is mildly impaired. Further evaluations may be warranted.

Notes


David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com

VESTIBULAR technologies

Subject's ID: xx
51 Years Old Female
Tuesday, May 20, 2025

CAPS EQ™

Computerized Posturography Results

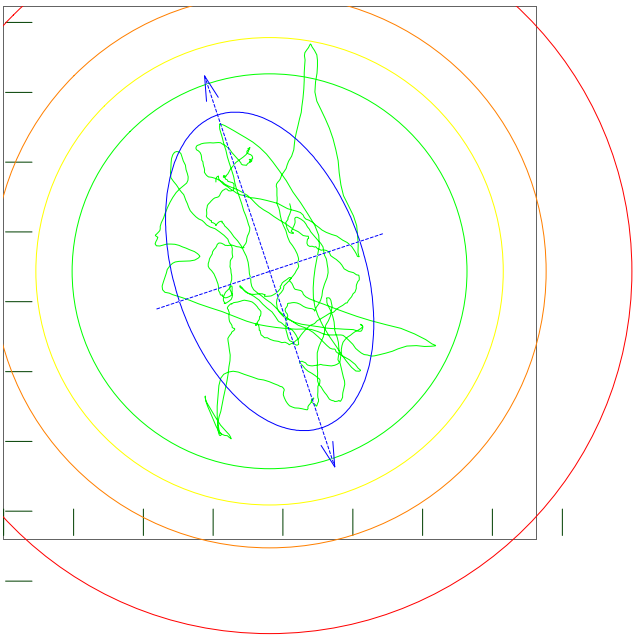

Divisions Interval 0.394" or 10.0 mm

Test Name	Foam Eyes Closed HN
Test Type	PSEC
Test Date	5/20/2025 02:20 PM
Test Parameters	19.997s @ 64.011 Hz
Samples: Total & Valid	1280 & 1280
Test Status	Completed
Sway Center [Xo, Yo]	[0.0481 m, 0.0544 m]
Max Theoretical Sway (LoS)	0.1952 m
ML Sway: Max & 95% Conf.	0.0113 m & 0.0298 m
AP Sway: Max & 95% Conf.	0.0029 m & 0.0456 m
95% Conf. Sway: Max & Min	0.0472 m & 0.0272 m
Actual Sway: Max & Ave	0.0331 m & 0.0126 m
Sway Velocity: Max & Ave	0.142 m/s & 0.031 m/s
Sway Acceler.: Max & Ave	2.392 m/s² & 0.422 m/s²
Sway Path Length	0.6096 m
Area 95% Conf. Ellipse	0.0010098 m²
Stability Score	**75.8%**
Stability Class	**Healthy Balance**
Pred. Direction of Sway	-71.6 deg
Directionality	42%
Fatigue Ratio	32.8%
Adaptation Ratio	0.0%
Parameter p	5.7
Height	1.63 m
Weight	205 lb 14 oz
Body Mass Index	35.2
Body Mass Index Class	Obese

Stability Level:	**Healthy Balance**	Mildly Reduced	Moderately Reduced	Severely Reduced	Profoundly Reduced
Reference Values:	**>= 71.0%**	65.7-70.9%	59.4-65.6%	46.8-59.3%	<= 46.7%

Results Interpretation

According to CDC guidelines the patient is obese.
According to independent peer-reviewed age-based reference studies the patient has a healthy balance/stability.

Notes

David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com

VESTIBULAR technologies


Subject's ID: xx
51 Years Old Female
Tuesday, May 20, 2025

CAPS EQ™

Computerized Posturography Results Comparison


	Test 1	Test 2	Test 3	Test 4
Test Name	Foam Eyes Closed HN	Foam Eyes Closed HN	Foam Eyes Closed HN	Foam Eyes Closed HN
Test Type	PSEC	PSEC	PSEC	PSEC
Test Date	5/20/2025 02:17 PM	5/20/2025 02:17 PM	5/20/2025 02:19 PM	5/20/2025 02:20 PM
Test Parameters	19.997s @ 64.011 Hz	19.997s @ 64.011 Hz	19.997s @ 64.011 Hz	19.997s @ 64.011 Hz
Samples: Total & Valid	1280 & 1280	1280 & 1280	1280 & 1280	1280 & 1280
Test Status	Completed	Completed	Completed	Completed
Sway Center [Xo, Yo]	[0.0611 m, 0.0658 m]	[0.0597 m, 0.0584 m]	[0.0483 m, 0.0667 m]	[0.0481 m, 0.0544 m]
Max Theoretical Sway (LoS)	0.1952 m	0.1952 m	0.1952 m	0.1952 m
ML Sway: Max & 95% Conf.	0.0064 m & 0.0187 m	0.0180 m & 0.0375 m	0.0174 m & 0.0395 m	0.0113 m & 0.0298 m
AP Sway: Max & 95% Conf.	0.0179 m & 0.0402 m	0.0347 m & 0.0495 m	0.0245 m & 0.0559 m	0.0029 m & 0.0456 m
95% Conf. Sway: Max & Min	0.0406 m & 0.0179 m	0.0519 m & 0.0342 m	0.0605 m & 0.0320 m	0.0472 m & 0.0272 m
Actual Sway: Max & Ave	0.0236 m & 0.0102 m	0.0436 m & 0.0134 m	0.0510 m & 0.0148 m	0.0331 m & 0.0126 m
Sway Velocity: Max & Ave	0.081 m/s & 0.022 m/s	0.272 m/s & 0.053 m/s	0.321 m/s & 0.064 m/s	0.142 m/s & 0.031 m/s
Sway Acceler.: Max & Ave	1.527 m/s² & 0.323 m/s²	5.254 m/s² & 0.754 m/s²	5.154 m/s² & 0.888 m/s²	2.392 m/s² & 0.422 m/s²
Sway Path Length	0.4302 m	1.0631 m	1.2743 m	0.6096 m
Area 95% Conf. Ellipse	0.0005714 m²	0.0013933 m²	0.0015197 m²	0.0010098 m²
Stability Score	**79.2%**	**73.4%**	**69.0%**	**75.8%**
Stability Class	**Healthy Balance**	**Healthy Balance**	**Mildly Reduced**	**Healthy Balance**
Pred. Direction of Sway	-81.7 deg	-66.7 deg	-63.2 deg	-71.6 deg
Directionality	56%	34%	47%	42%
Fatigue Ratio	34.5%	24.2%	23.4%	32.8%
Adaptation Ratio	0.0%	0.0%	0.0%	0.0%
Parameter p	7.3	3.6	3.3	5.7
Height	1.63 m	1.63 m	1.63 m	1.63 m
Weight	206 lb 3 oz	207 lb 5 oz	205 lb 6 oz	205 lb 14 oz
Body Mass Index	35.2	35.4	35.1	35.2
Body Mass Index Class	Obese	Obese	Obese	Obese

Test 1




Divisions Interval 0.394" or 10.0 mm

Test 2




Divisions Interval 0.394" or 10.0 mm

Test 3



Divisions Interval 0.394" or 10.0 mm

Test 4



Divisions Interval 0.394" or 10.0 mm

Visual Dep. (0% = no dependency): Romberg Ratio: N/A Stability Ratio: N/A

Perturb. Dep. (0% = no dependency): Romberg Ratio: N/A Stability Ratio: N/A

David W. Burns
TBI NW
14205 SE 36th St. Ste 123
Bellevue, WA 98006
www.TBINW.com
Ph: 800-688-1183 - Email: drburns@tbinw.com