

237.4kWp (DC) PHOTOVOLTAIC SYSTEM

CONSISTING OF 654 WAAREE MODULES



EARTH STRIP INSTALLATION GUIDE:-

1. EARTH STRIP SHOULD BE WELDED AND BOLTED AT EVERY EARTH STRIP JOINTS
2. EARTH STRIP SHOULD BE WELDED AND BOLTED WITH EQUIPMENTS FOR EQUIPMENT GROUNDING. IF MANUFACTURER OF THE EQUIPMENT DO NOT ALLOW TO WELD THEN EARTH STRIP SHOULD BE TIGHTLY BOLTED WITH EQUIPMENT AT LEAST
3. TOTALLY THERE ARE 6 DC EARTH PITS.


NOTES:-

1. EQUIPMENT GROUNDING AND SYSTEM GROUNDING CONDUCTORS SHALL HAVE SHORTEST DISTANCE TO EARTH PIT WITH MINIMUM NUMBER OF BENDS /TURNS
2. NON-CURRENT CARRYING METAL PARTS SHALL BE CONNECTED TO NEAR BY EARTH STRIP.
3. EPOXY PAINT TO BE APPLIED AT THE PLACE OF WELDING.
4. CONNECTION OF EARTH STRIP WITH EARTH ELECTRODE SHALL BE WITH SS 304 NUT,BOLT AND WASHER.
5. ALL BOLTED CONNECTION SHALL HAVE SPRING AND FLAT WASHER.
6. BASED ON THE TYPE OF AVAILABLE EARTH ELECTRODE,CONNECTION OF EARTH STRIP WITH ELECTRODE TO BE DONE. REFER EARTH PIT TYPE-1.
7. SEPARATION BETWEEN TWO EARTH RODS SHALL BE MORE THAN THE LENGTH OF THE ELECTRODE AND IDEALLY DOUBLE THE ELECTRODE LENGTH. EARTH ROD SHALL NOT BE LOCATED CLOSER THAN 1.5M FROM ANY BUILDING.


Earthing Details

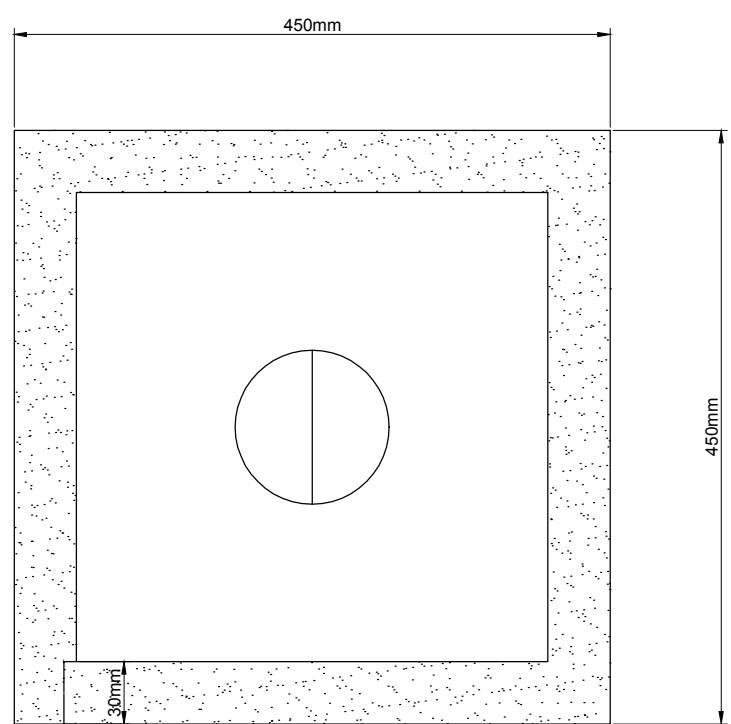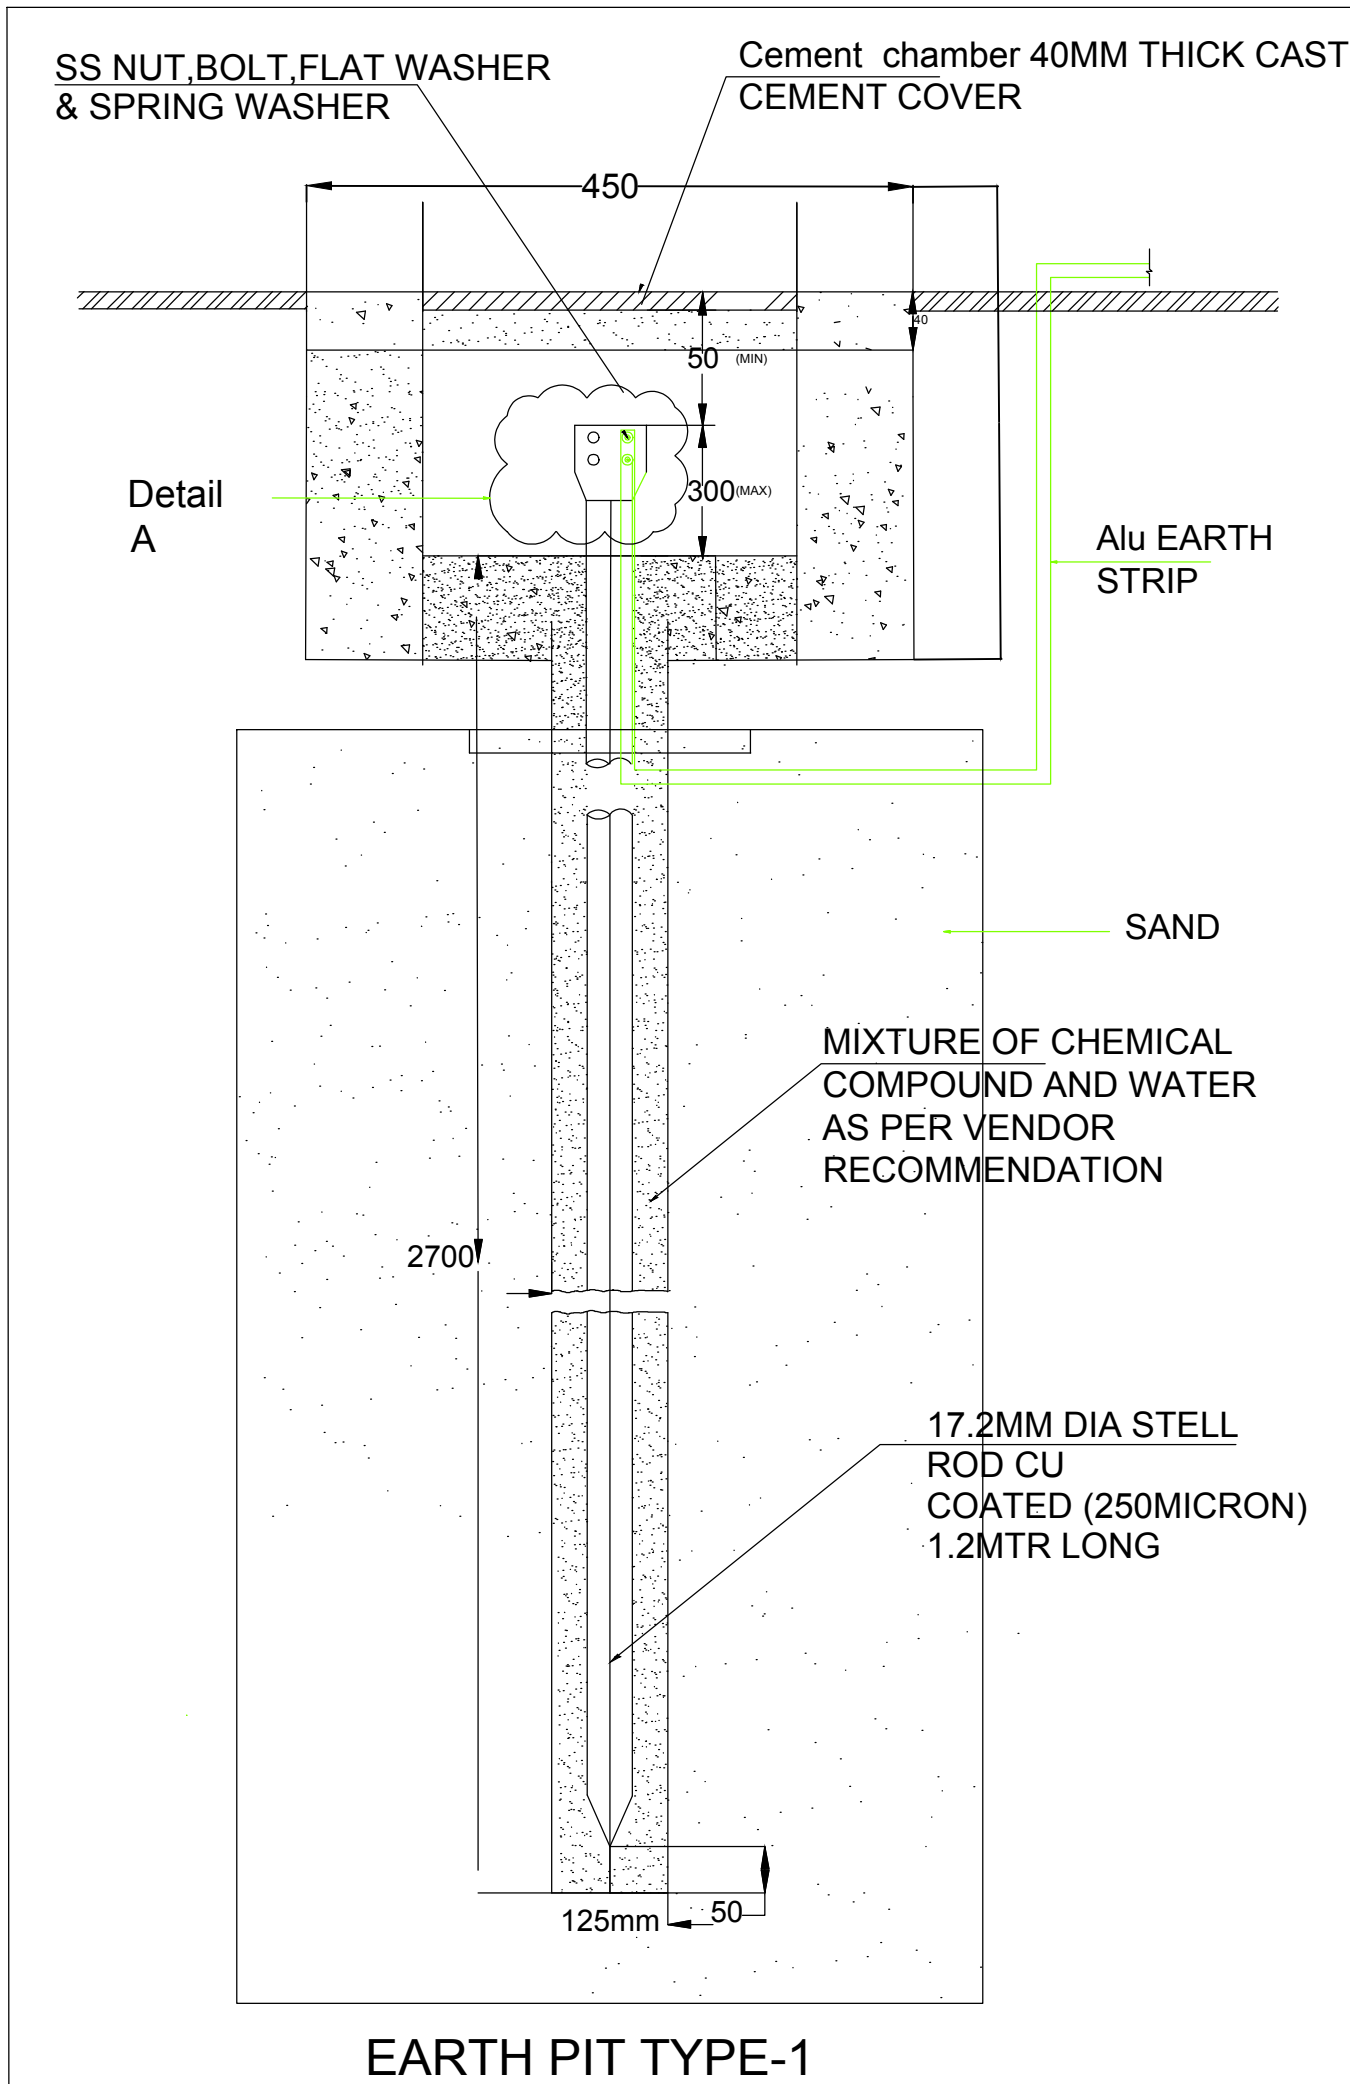

EARTHING CHAMBER COVER- Top View

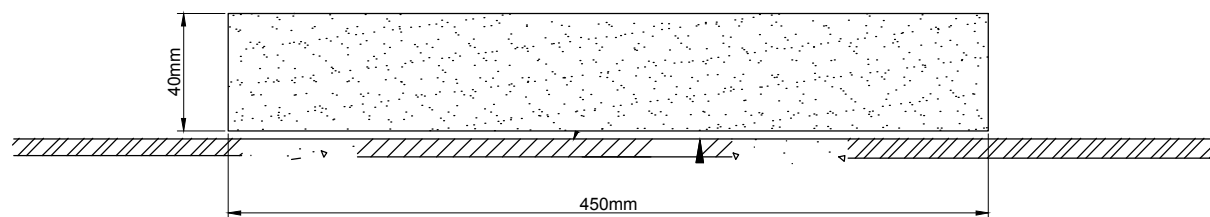

EARTHING CHAMBER COVER- SIDE VIEW

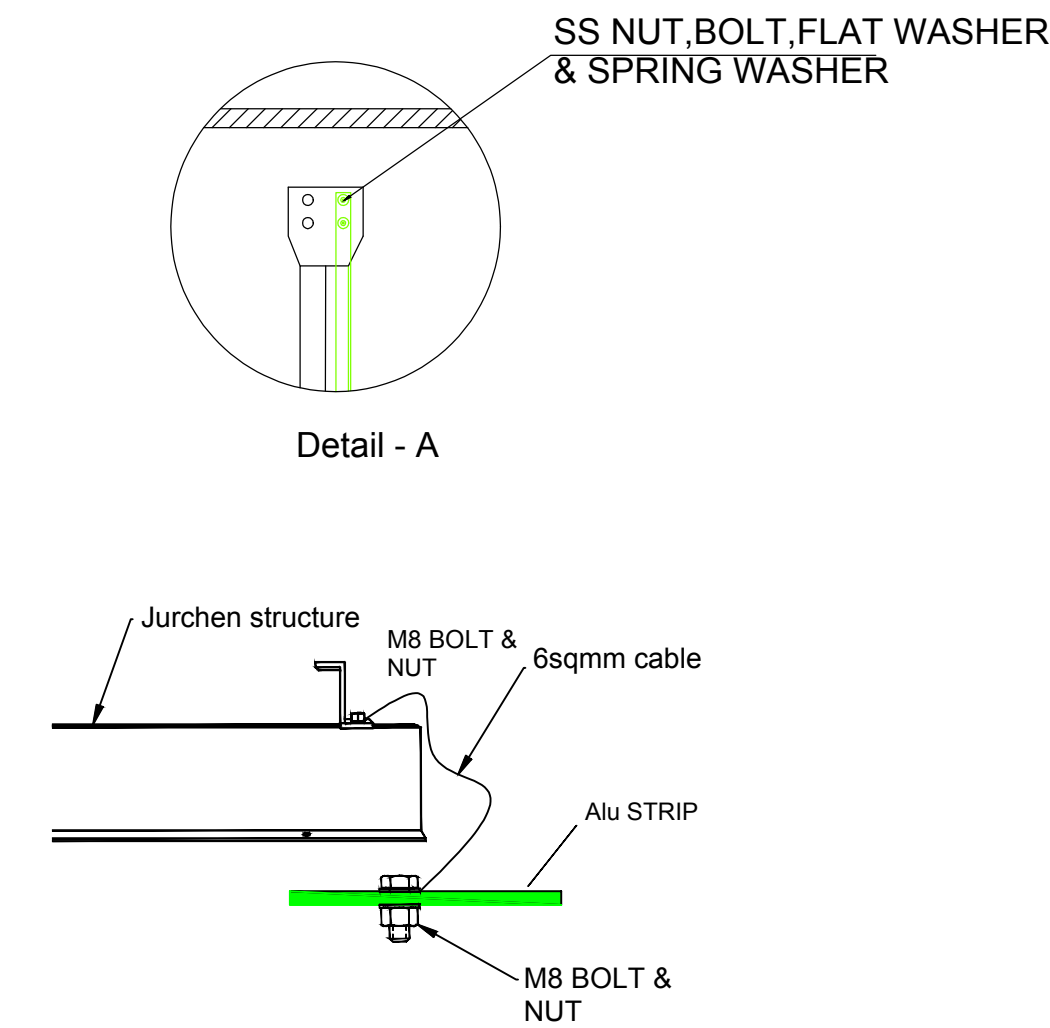

JOINTING DETAIL OF ALU STRIP

237.4kWp On - Grid system Mangomist Resort
Anekal Taluk,Banglore.

Itemref	Quantity	Title/Name, designation, material, dimension etc			Article No./Reference	
Designed by Lakshmi	Checked by	Approved by - date	Filename EL - 003	Date 07/01/2020	Scale N/A	
EcoSoch Solar Pvt Ltd			EARTHING STRIP AND PIT DETAILS			
			DWG - EL - 003		Edition 03	Sheet 1/1