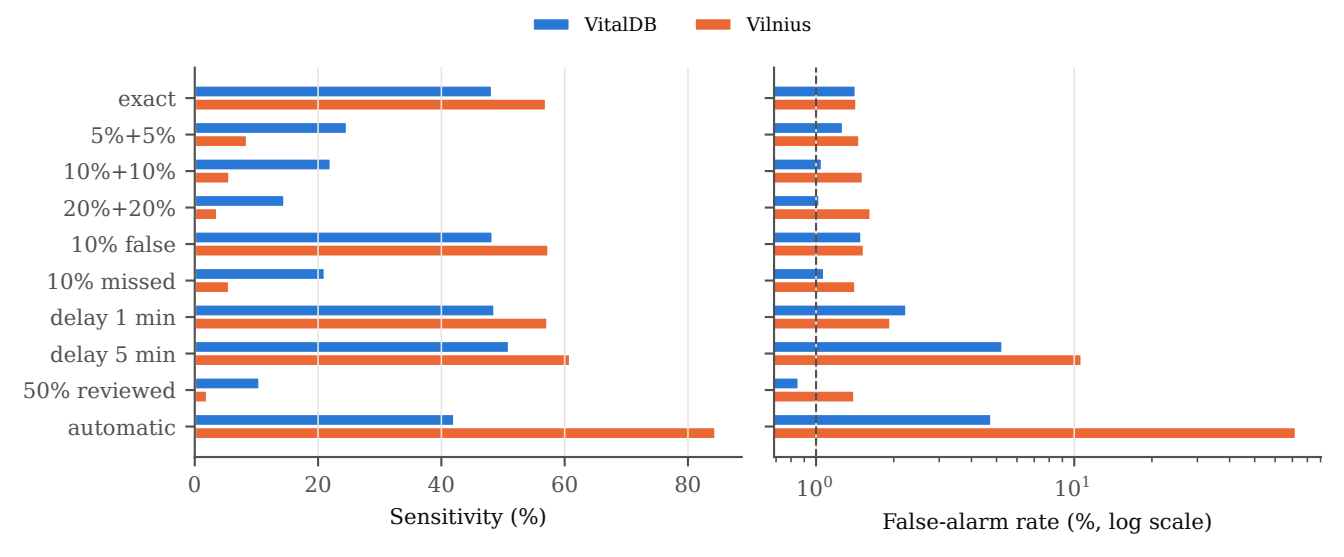
VitalDB
Vilnius
exact
5%+5%
10%+10%
20%+20%
10% false
10% missed
delay 1 min
delay 5 min
50% reviewed
automatic
0
20
40
60
80
Sensitivity (%)
10^0
10^1
False-alarm rate (%, log scale)