




NOTES:

1. FOR NEW CONSTRUCTION, A 6" CURB REVEAL SHALL BE MAINTAINED. MATCH EXISTING REVEAL FOR CURB REPLACEMENT OR RESETTING.

NO SCALE

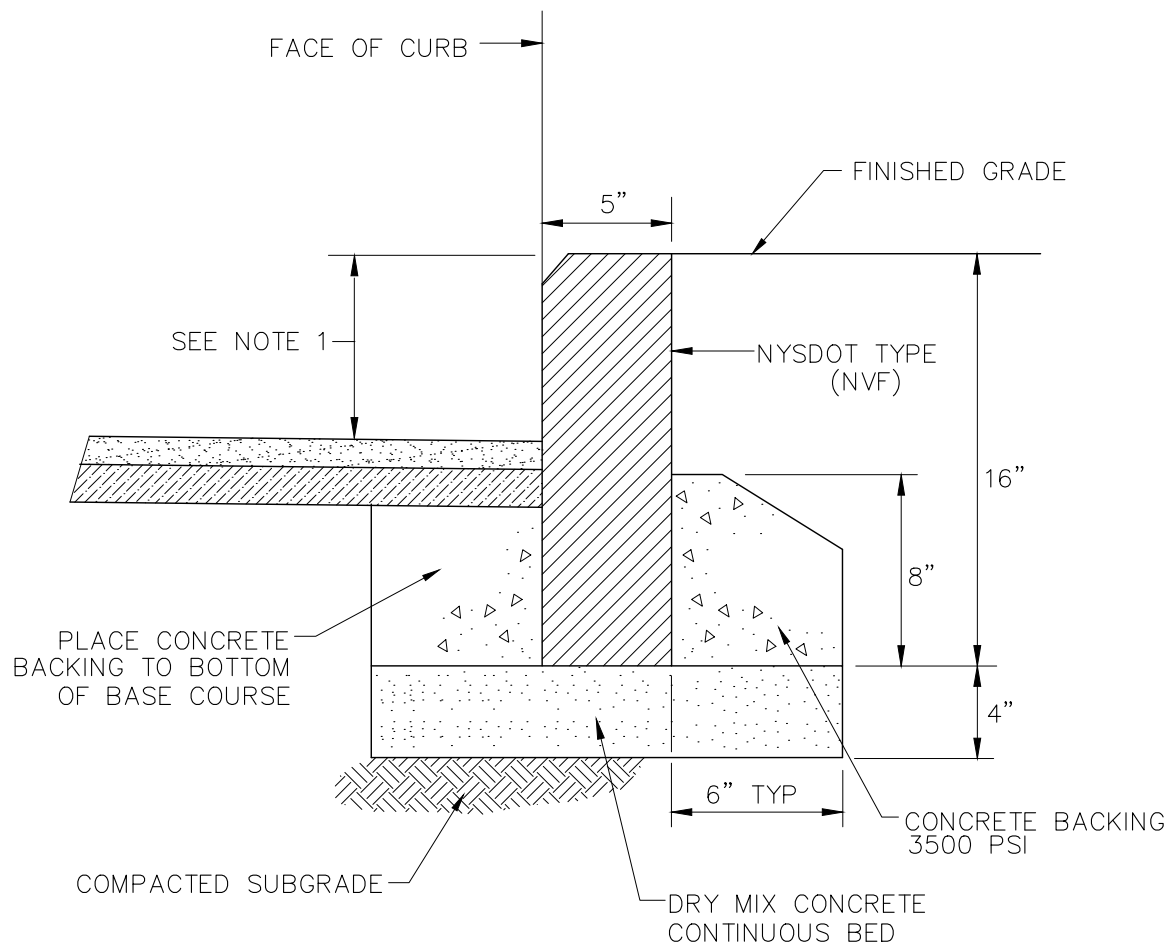

Katherine M. Sheehan, Mayor
Howard M. Goebel P.E. City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

GRANITE CURB INSTALLATION DETAIL

DETAIL No.

C-1

FILE NAME:


C-1.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/26/24

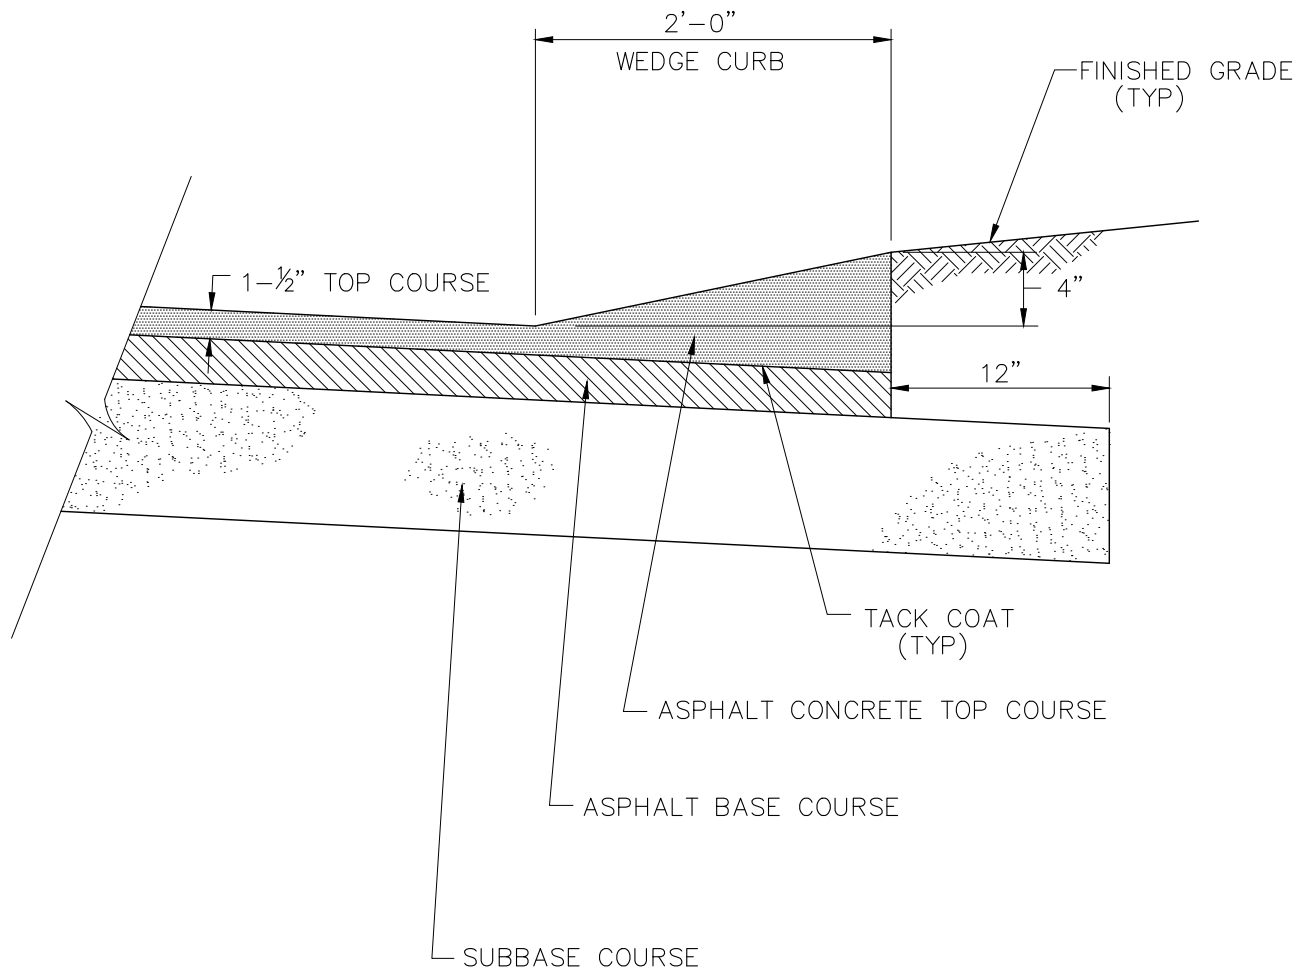

NOTES:

1. MAINTAIN EXISTING TRAVEL LANE(S) WIDTH PER TRAFFIC ENGINEERING.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

ASPHALT WEDGE CURB
DETAIL

DETAIL No.

C-2

FILE NAME:


C-2.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/26/24

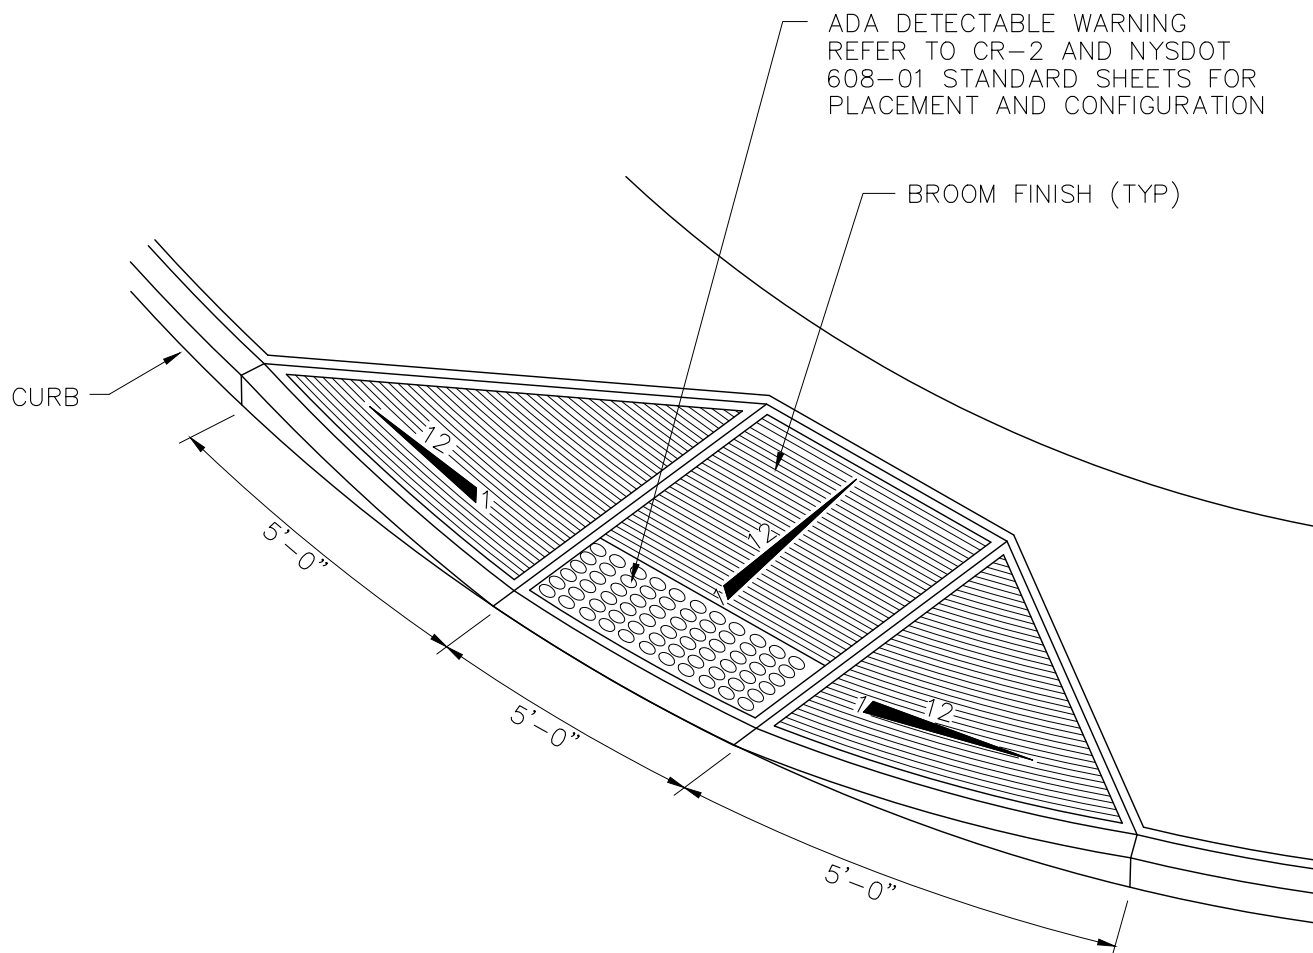

NOTE:

1. CURB SHALL BE FLUSH WITH PAVEMENT AT ROADWAY.
2. SEE STANDARD DETAILS FOR CURB AND SIDEWALK INSTALLATION.
3. SEE STANDARD DETAIL FOR ADA DETECTABLE WARNING STRIP INSTALLATION.
4. INSTALLATION SHALL MEET ALL APPLICABLE ADA CODES AND STANDARDS.
5. REFER TO NYSDOT 608-01 STANDARD SHEETS FOR APPLICABLE CURB RAMP LAYOUT FOR EACH INDIVIDUAL CURB RAMP

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

ADA CURB RAMP DETAIL

DETAIL No.

CR-1

FILE NAME:


CR-1.DWG

DATE ISSUED


05/01/02

REVISION DATE

03/08/24

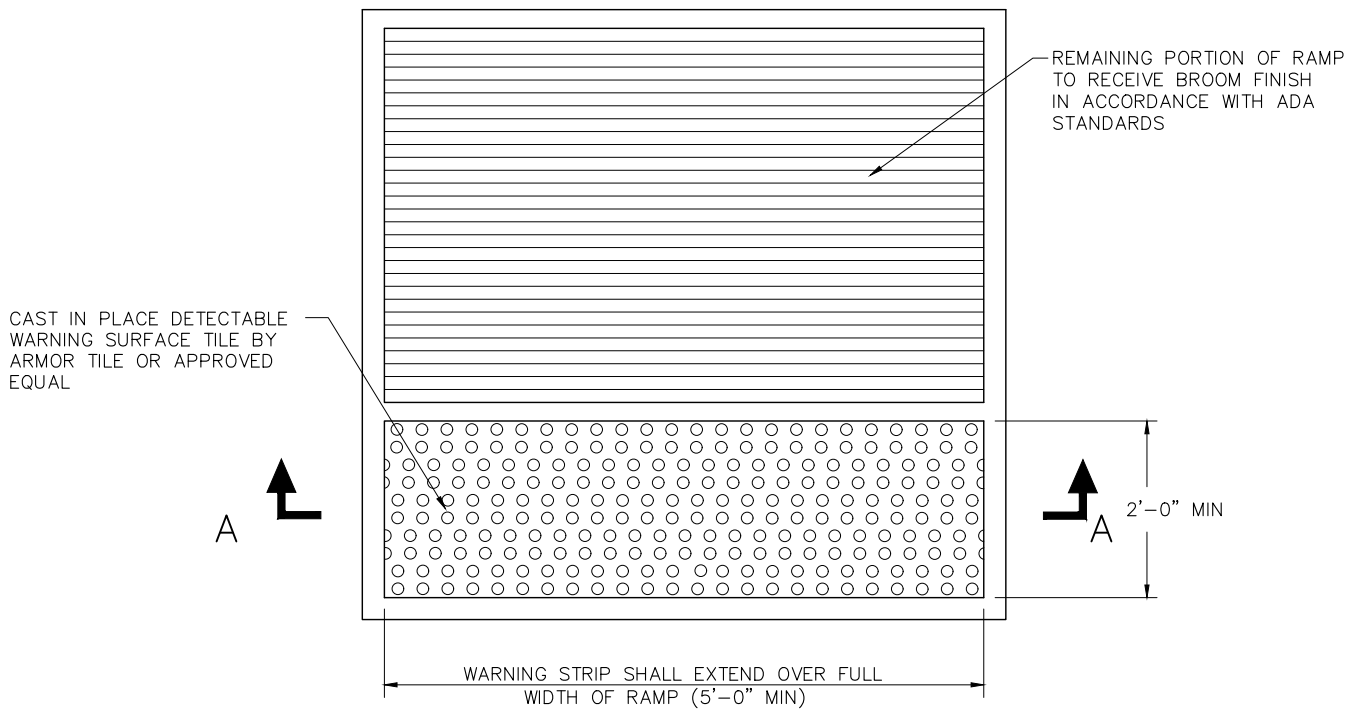

PLAN

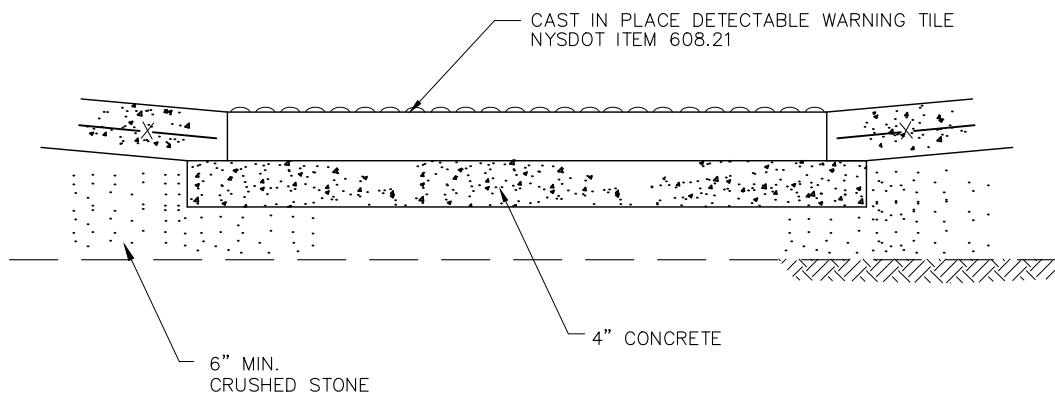

SECTION A-A

NOTES:

1. THE COLOR OF THE DETECTABLE WARNING SURFACE SHALL BE DARK GRAY, MUNSELL BOOK NOTATION BG-PB 3/5. THIS COLOR IS THE CITY OF ALBANY STANDARD COLOR FOR DETECTABLE WARNING SURFACES.
2. SEE STANDARD DETAILS FOR CURB, SIDEWALK, AND SIDEWALK RAMP INSTALLATION.
3. INSTALLATION SHALL MEET ALL APPLICABLE ADA CODES AND STANDARDS.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

ADA DETECTABLE WARNING
STRIP DETAIL

DETAIL No.

CR-2

FILE NAME:


CR-2.DWG

DATE ISSUED

09/16/03

REVISION DATE

03/08/24

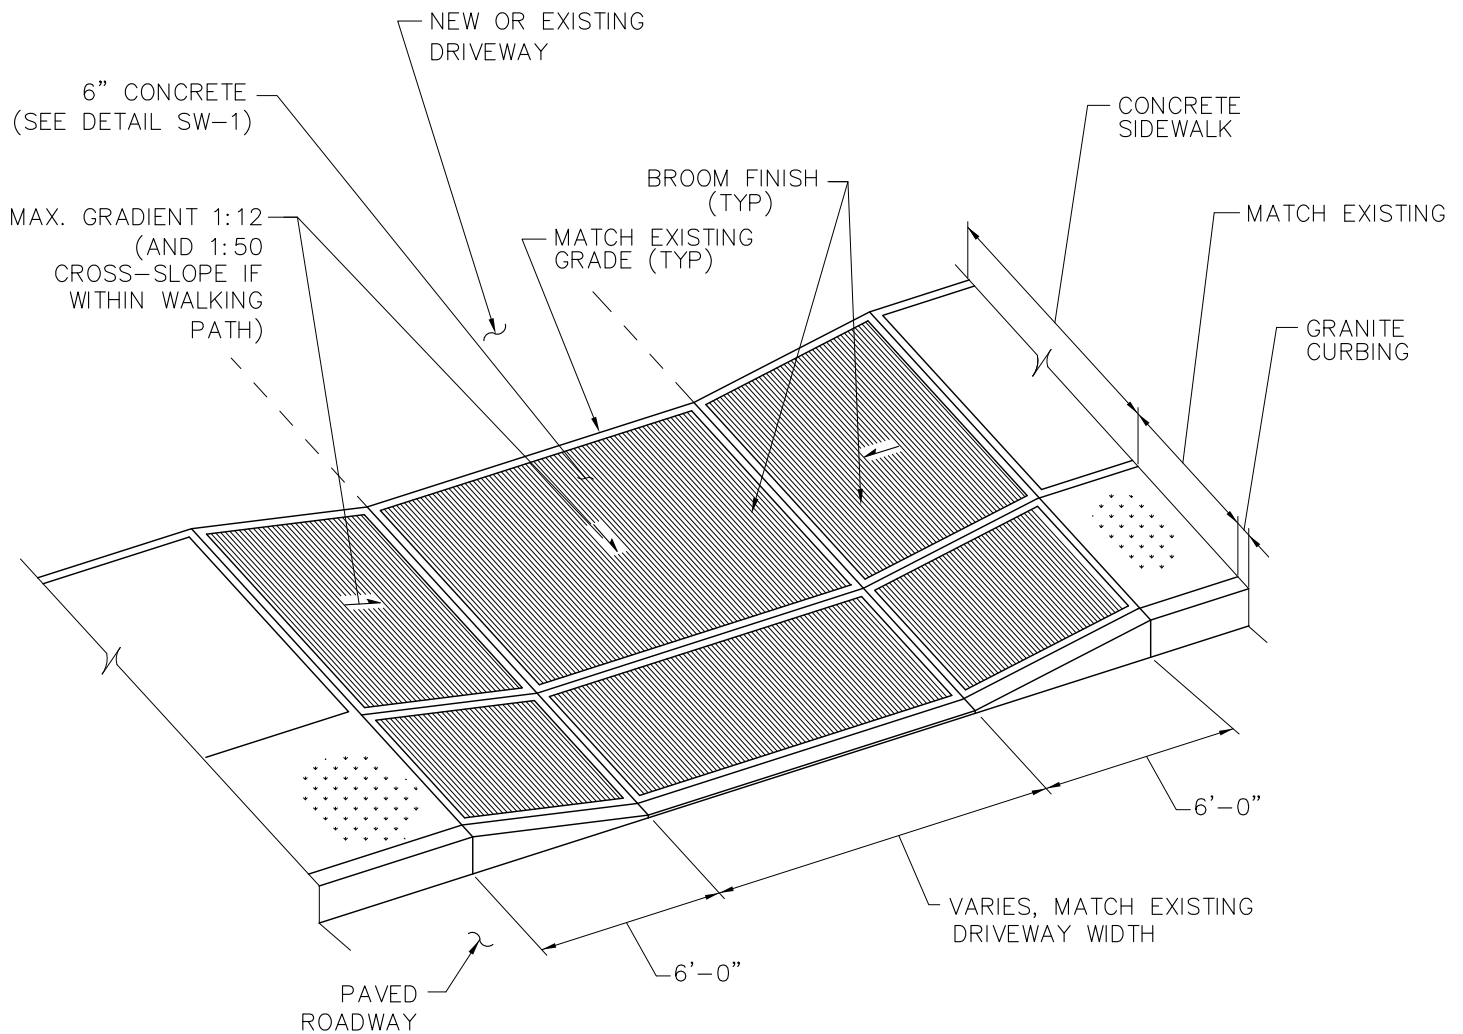

NOTE:

1. CURB REVEALS SHALL BE 1/2" MAX WHERE RAMP MEETS PAVEMENT AT ROADWAY.
2. SIDEWALK SHALL BE INSTALLED FLUSH WITH EXISTING DRIVEWAY.
3. SEE STANDARD SIDEWALK DETAIL FOR SIDEWALK INSTALLATION.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

DRIVEWAY/SIDEWALK DROP CURB

DETAIL No.

DW-1

FILE NAME:


DW-1.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/08/24

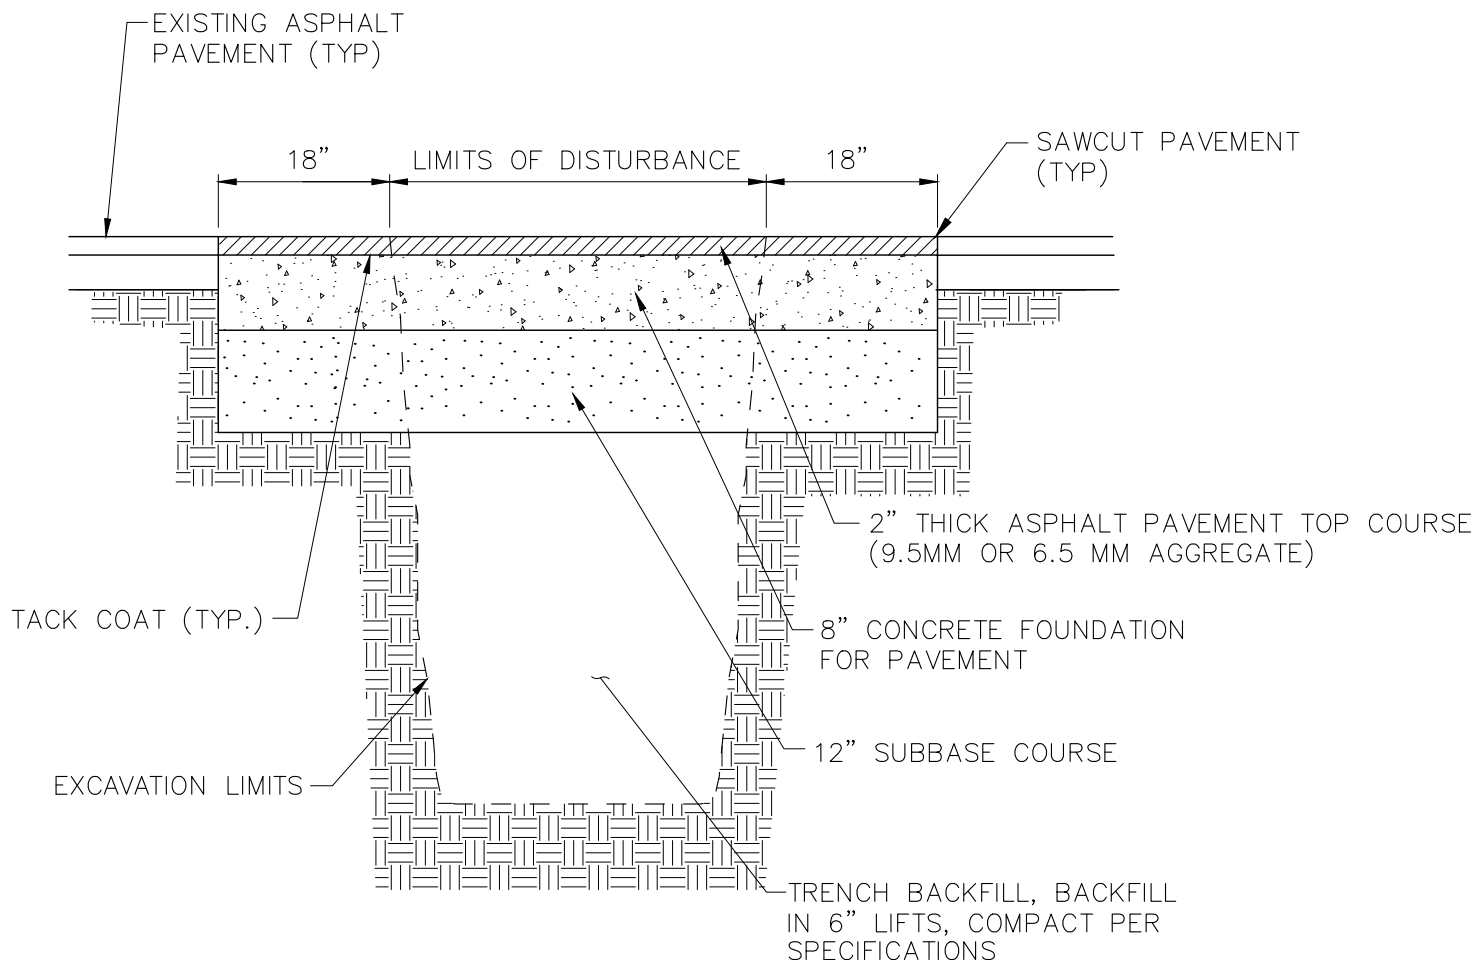

NOTE:

1. IF LIMITS OF TRENCHING EXCEEDS 50 FEET, CONTRACTOR SHALL COMPLETE CURB TO CURB MILLING PER CITY DETAIL SR-3; UNLESS OTHERWISE ORDERED BY CITY OF ALBANY DEPARTMENT OF GENERAL SERVICES.
2. ALL PAVEMENT MARKINGS DISTURBED SHALL BE RESTORED TO THE SATISFACTION OF THE CITY OF ALBANY DIVISION OF TRAFFIC ENGINEERING.
3. ALL JOINTS TO BE SEALED WITH ASPHALT EMULSION (AC-20)
4. ASPHALT, CONCRETE TACK COAT, TRENCH BACKFILL AND OTHER MATERIALS AND OPERATIONS SHALL CONFORM TO NYSDOT STANDARDS AND SPECIFICATIONS UNLESS NOTED OR DIRECTED OTHERWISE BY THE CITY.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

STREET RESTORATION
DETAIL

DETAIL No.

SR-1

FILE NAME:


SR-1.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/08/24

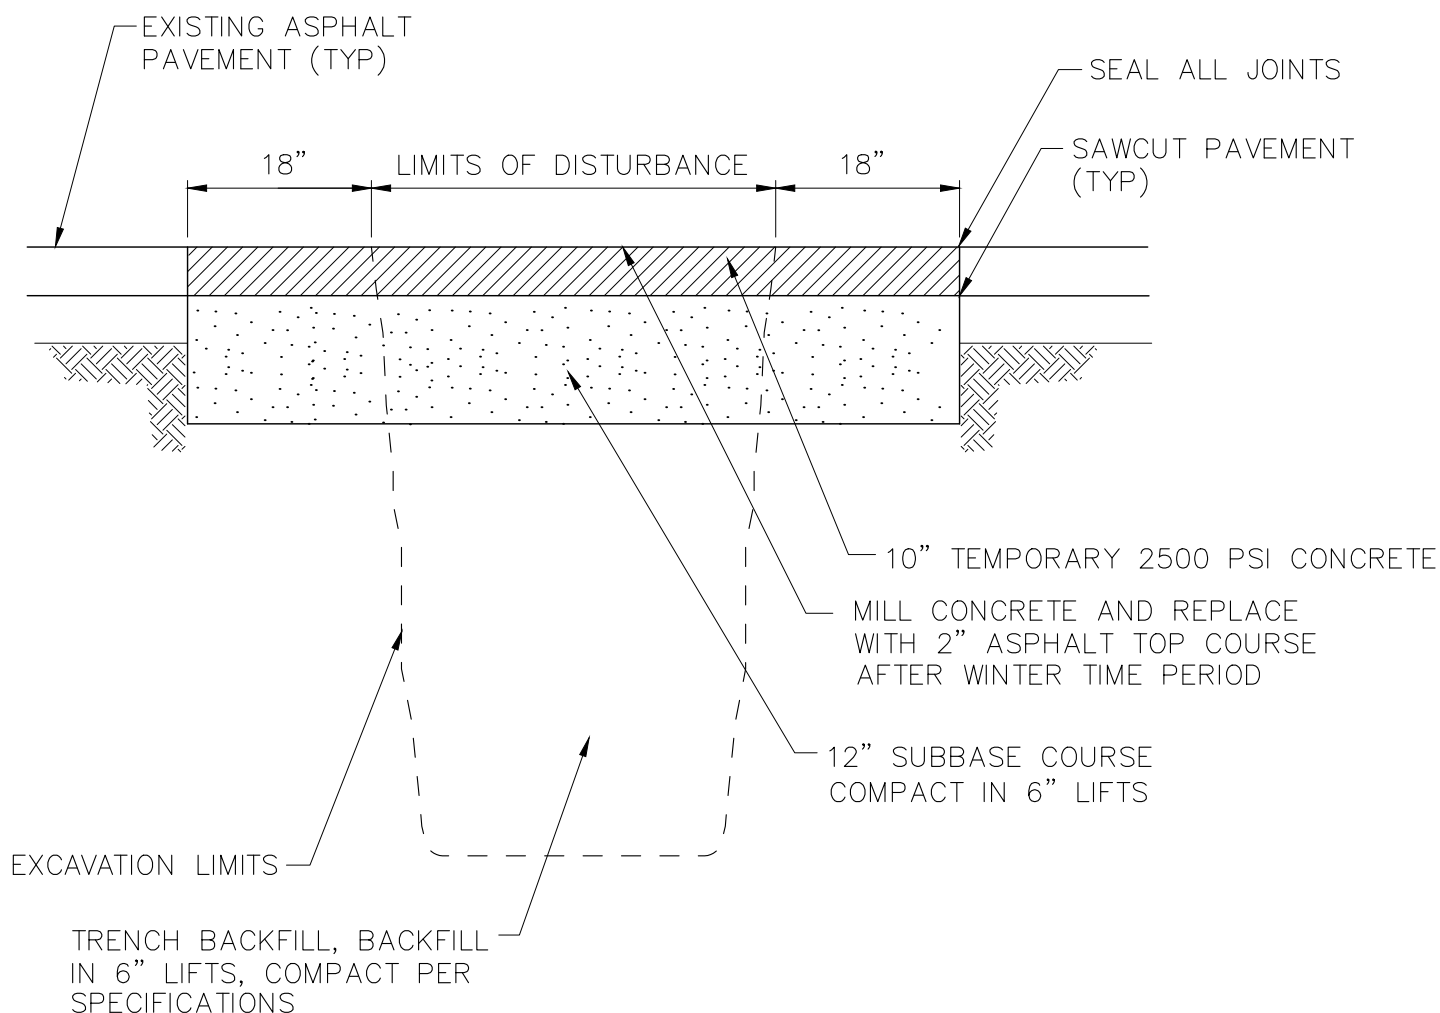

NOTES:

1. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING TEMPORARY WEARING SURFACE UNTIL PERMANENT PAVEMENT IS IN PLACE. TEMPORARY CONCRETE WEARING SURFACE SHALL BE REMOVED AND PERMANENT PAVEMENT RESTORATION COMPLETED NO LATER THAN MAY 15. PERMANENT PAVEMENT RESTORATION SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARD DETAILS AND TO THE SATISFACTION OF THE CITY OF ALBANY.
2. ALL JOINTS TO BE SEALED WITH ASPHALT EMULSION (AC-20)
3. ALL WORK SHALL BE INSPECTED AND APPROVED BY THE CITY.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

STREET RESTORATION – WINTER CONDITIONS
NOVEMBER 1 – APRIL 15

DETAIL No.

SR-2

FILE NAME:


SR-2.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/08/24

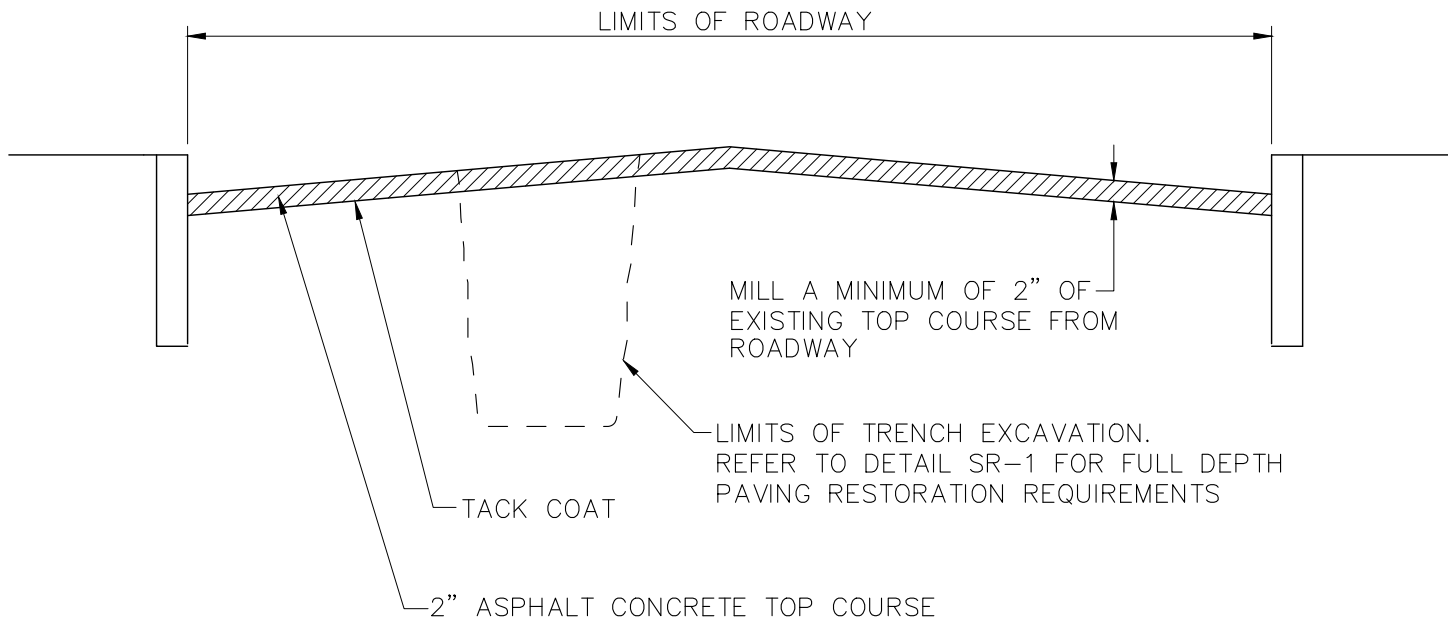

NOTE:

1. PAVEMENT MILLING OPERATION SHALL EXTEND 5 FEET BEYOND THE LIMITS OF TRENCHING OR AS ORDERED BY THE ENGINEER.
2. ALL JOINTS TO BE SEALED WITH ASPHALT EMULSION (AC-20)

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

PAVEMENT MILLING AND
STREET RESTORATION
(REQUIRED LIMITS OF WORK ARE CURB TO CURB)

DETAIL No.

SR-3

FILE NAME:


SR-3.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/08/24

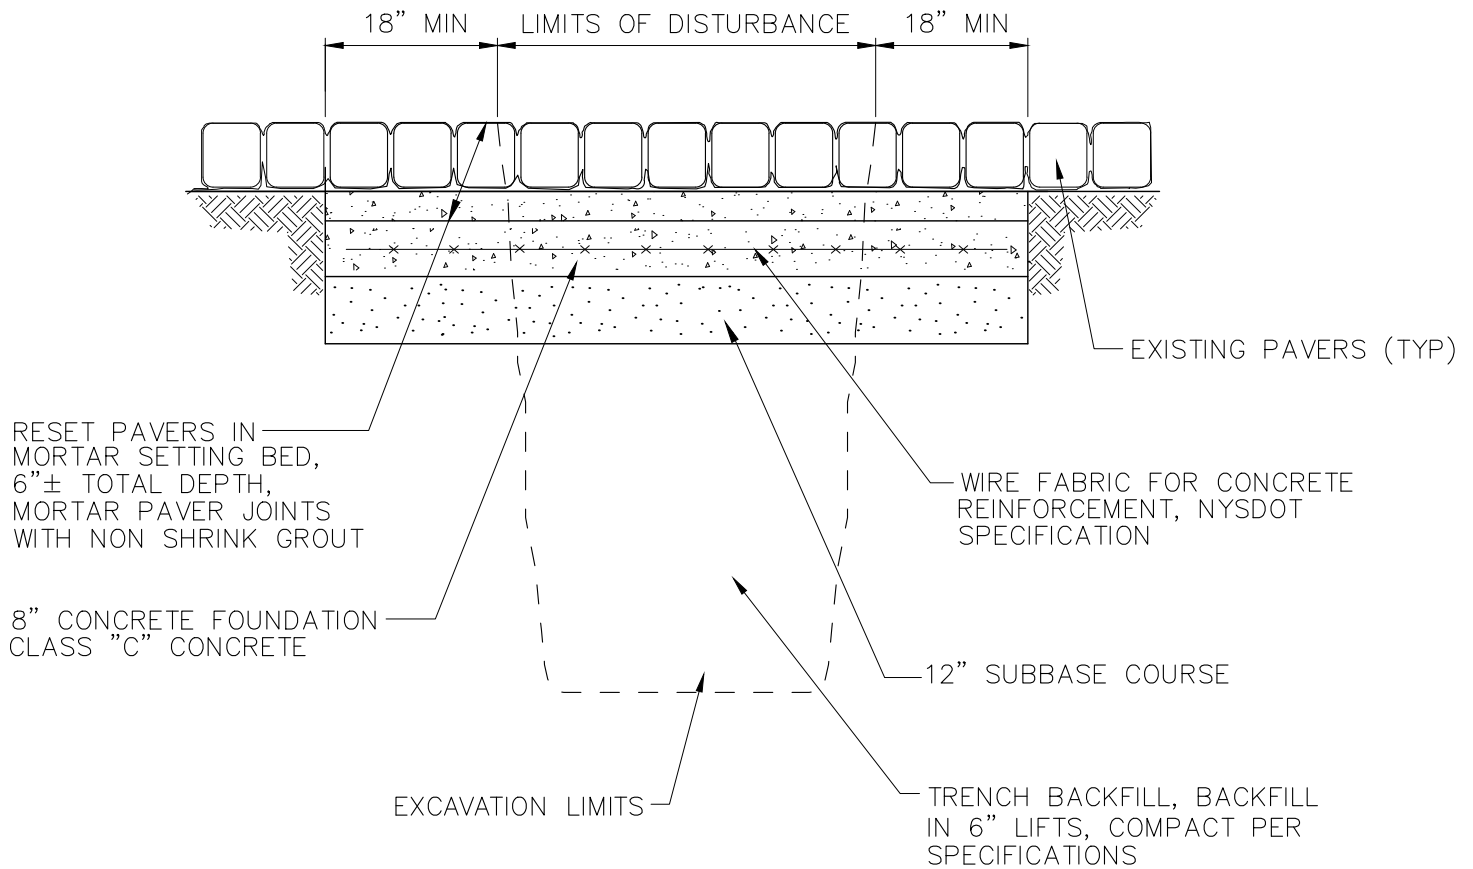

NOTE:

1. HISTORIC DISTRICT LIMITS:

MADISON AVENUE: LARK STREET TO THE HUDSON RIVER
 LARK STREET: MADISON AVENUE TO CLINTON AVENUE
 CLINTON AVENUE: LARK STREET TO HUDSON RIVER

2. CONTRACTOR SHALL NOTIFY CITY ENGINEER'S OFFICE 72 HOURS PRIOR TO COMMENCING RESTORATION FOR INSPECTION OF THE RESTORATION.

3. ALL WORK SHALL BE COMPLETED TO THE SATISFACTION OF THE CITY.

NO SCALE



Katherine M. Sheehan, Mayor
 Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

STREET RESTORATION – GRANITE/BRICK
 PAVEMENT WITHIN HISTORIC DISTRICT
 (EXPOSED COBBLES)

DETAIL No.

SR-4

FILE NAME:


SR-4.DWG

DATE ISSUED

03/21/04

REVISION DATE

03/08/24

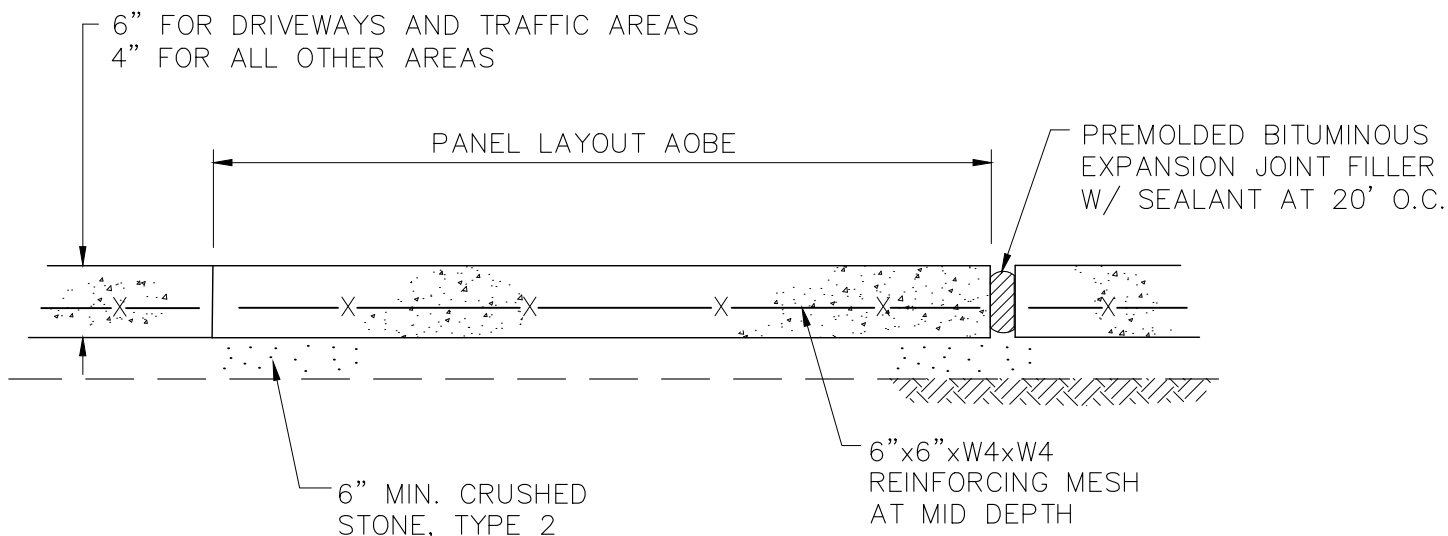

DESIGN ELEMENT TOLERANCES

ELEMENT	DESIGN AND FIELD LAYOUT LIMIT	LIMIT FOR WORK ACCEPTANCE
SIDEWALK CROSS SLOPE	1.5% MAX.	2.0% MAX.
SIDEWALK GRADE (RUNNING SLOPE)	4.5% MAX.	5.0% MAX.
CURB RAMP GRADE (RUNNING SLOPE)	7.5% MAX.	8.3% MAX.
BLENDED TRANSITION GRADE (RUNNING SLOPE)	4.5% MAX.	5.0% MAX.

NOTE: REFER TO NYSDOT STANDARD SHEETS 608-01.

NOTES:

1. THE CONCRETE USED SHALL BE PORTLAND CEMENT, AIR-ENTRAINED, CLASS "A" CONCRETE WITH AN AIR CONTENT OF 5%, MIN., TO 7%, MAX., AND A SLUMP OF THREE INCHES, MIN., TO FIVE INCHES, MAX. NO FLY ASH AND MIN. 4,000 PSI.
2. ALL SIDEWALKS SHALL BE FINISHED WITH A BROOM FINISH UNLESS DIRECTED OTHERWISE BY THE CITY.
3. EXPANSION JOINTS TO BE PLACED BETWEEN ADJACENT SLABS, AT BUILDING LINE, AT CURBS, OR AT PENETRATING STRUCTURES.
4. SIDEWALKS SHALL BE INSTALLED WITH A MAXIMUM CROSS SLOPE OF 2.0%
5. ALL SIDEWALKS PANEL REPLACEMENT SHALL BE UP TO THE NEAREST SIDEWALK JOINT. NO PARTIAL PANEL REPLACEMENT IS ALLOWED

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

SIDEWALK INSTALLATION DETAIL

DETAIL No.

SW-1

FILE NAME:


SW-1.DWG

DATE ISSUED

05/01/02

REVISION DATE

03/08/24

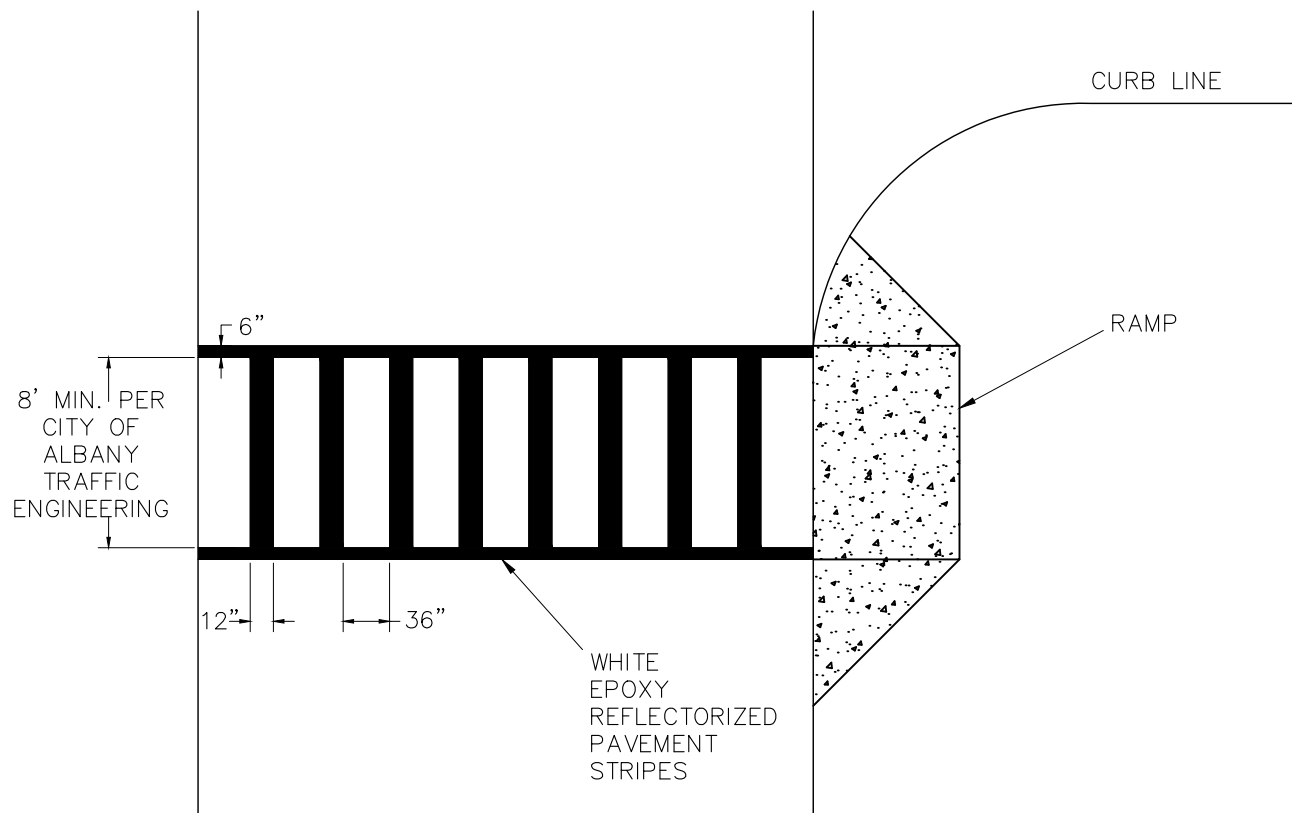

NOTE:

1. EPOXY TO COMPLY WITH NYSDOT STANDARDS
2. MUTCD MANUAL, SECTION 3B SHALL BE USED PER CITY OF ALBANY TRAFFIC ENGINEERING RECOMMENDATIONS.

NO SCALE



Katherine M. Sheehan, Mayor
Howard M. Goebel P.E., City Engineer

CITY OF ALBANY – DEPARTMENT OF ENGINEERING

DETAIL NAME:

CROSSWALK DETAIL

DETAIL No.

CW-1

FILE NAME:

CW-1.DWG

DATE ISSUED

12/9/03

REVISION DATE

03/08/24