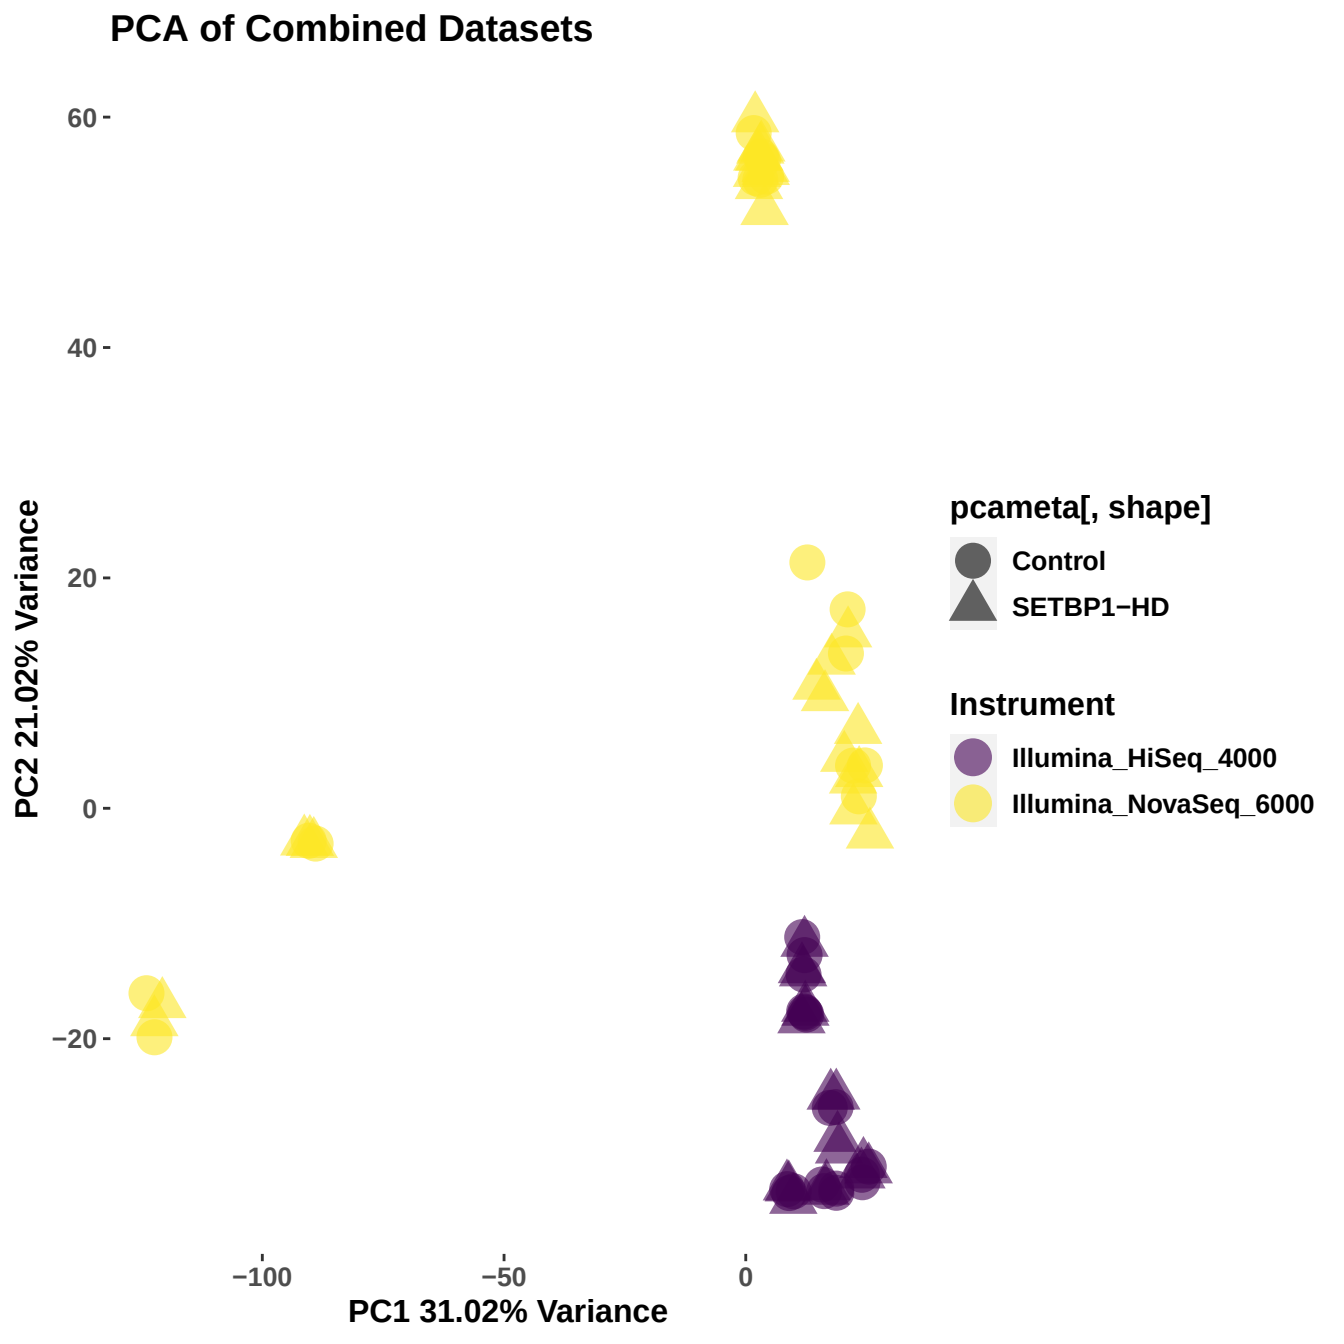
PCA of Combined Datasets
60
40
20
0
−20
PC2 21.02% Variance
−100
−50
0
PC1 31.02% Variance
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

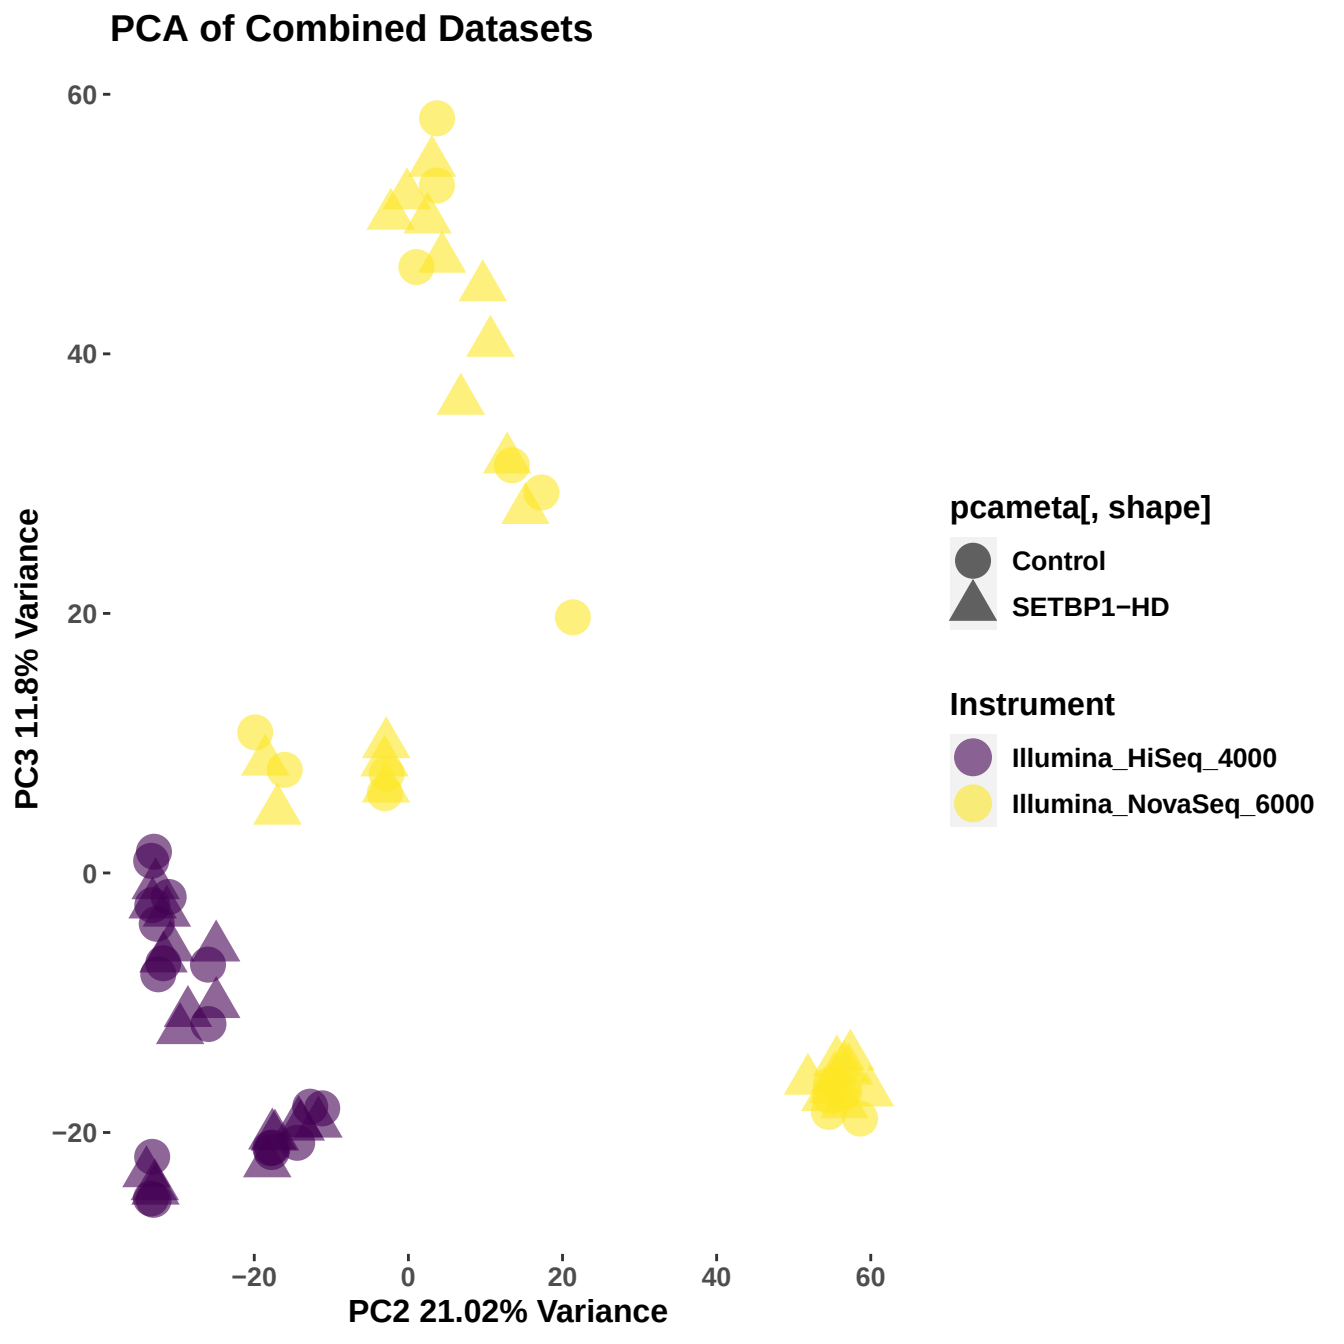
PCA of Combined Datasets
PC3 11.8% Variance
PC2 21.02% Variance
60
40
20
0
−20
−20
0
20
40
60
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

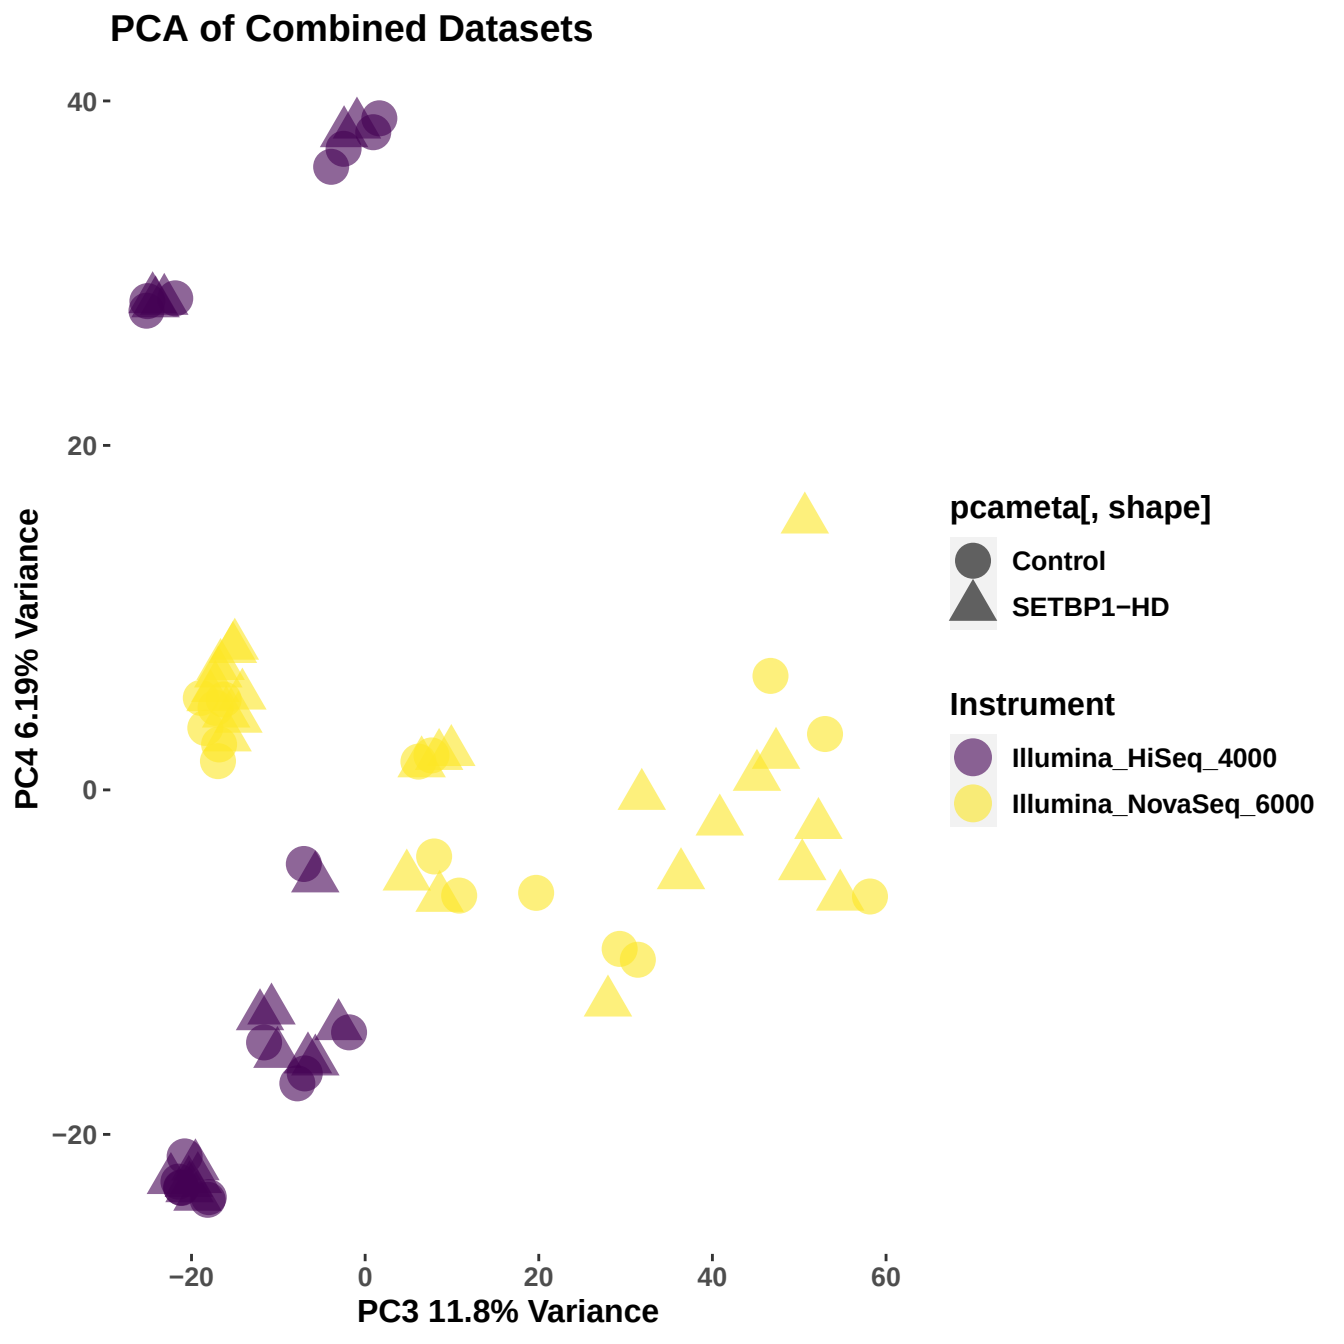
PCA of Combined Datasets
40
20
0
−20
PC4 6.19% Variance
−20
0
20
40
60
PC3 11.8% Variance
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

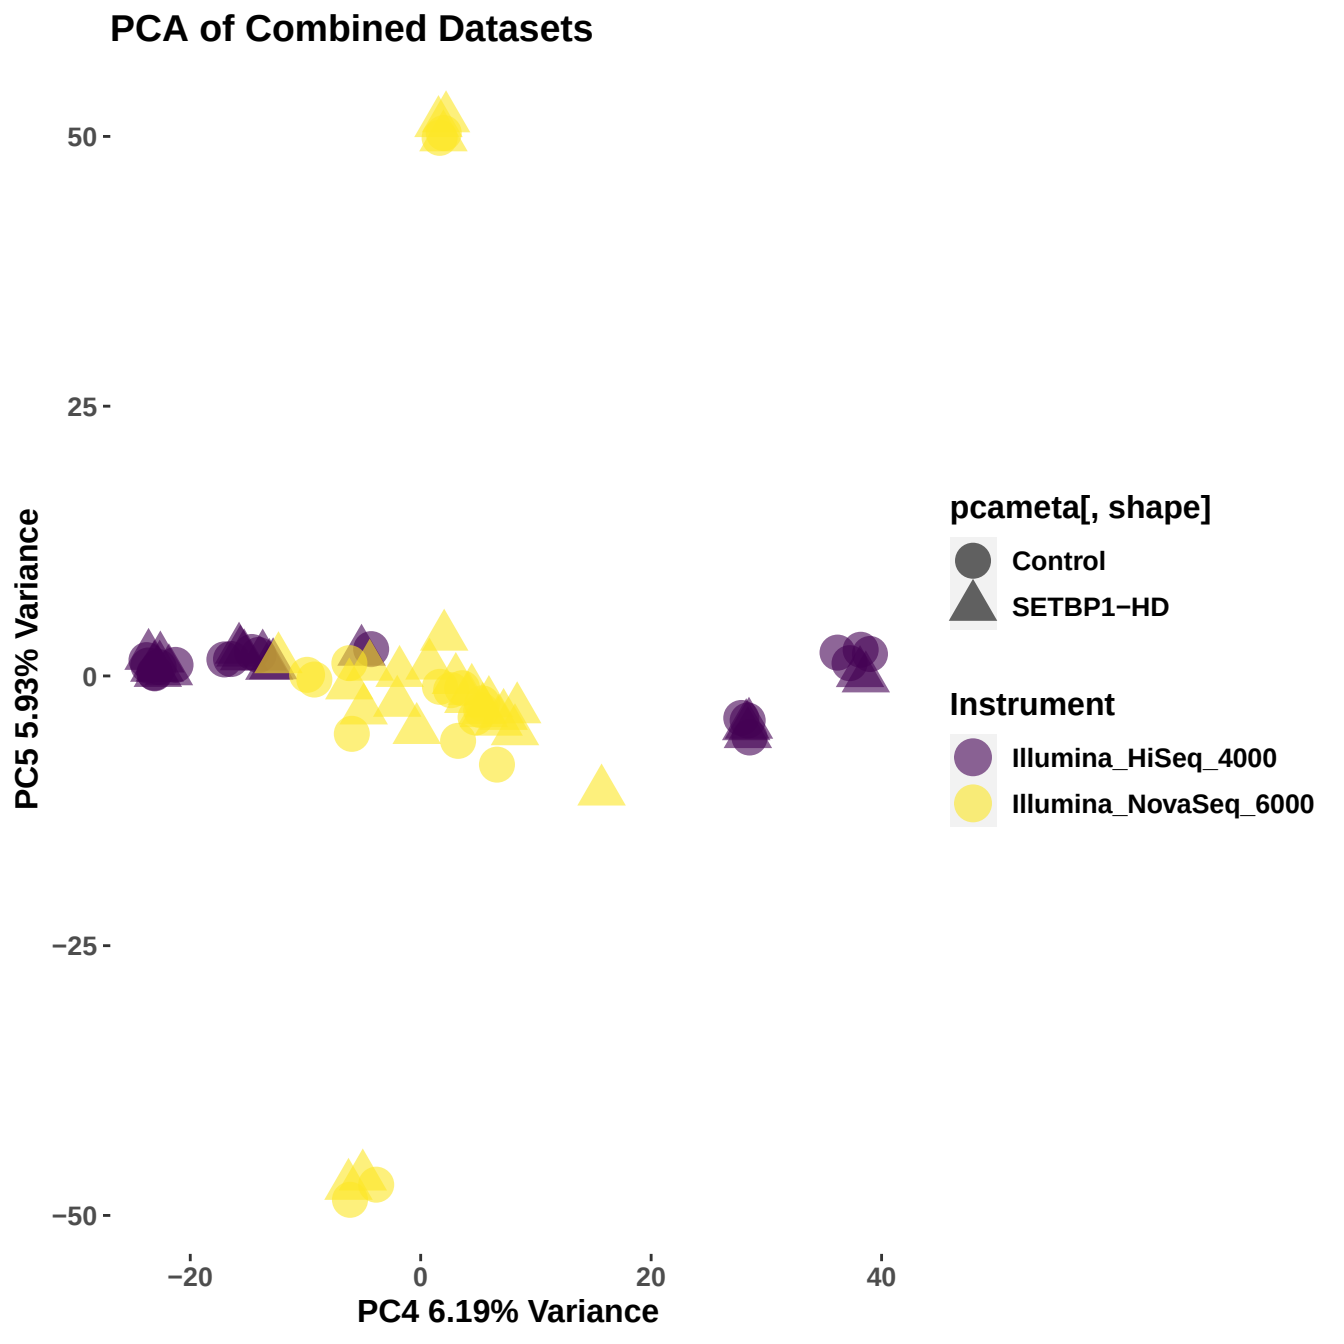
PCA of Combined Datasets
50
25
0
−25
−50
PC5 5.93% Variance
−20
0
20
40
PC4 6.19% Variance
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

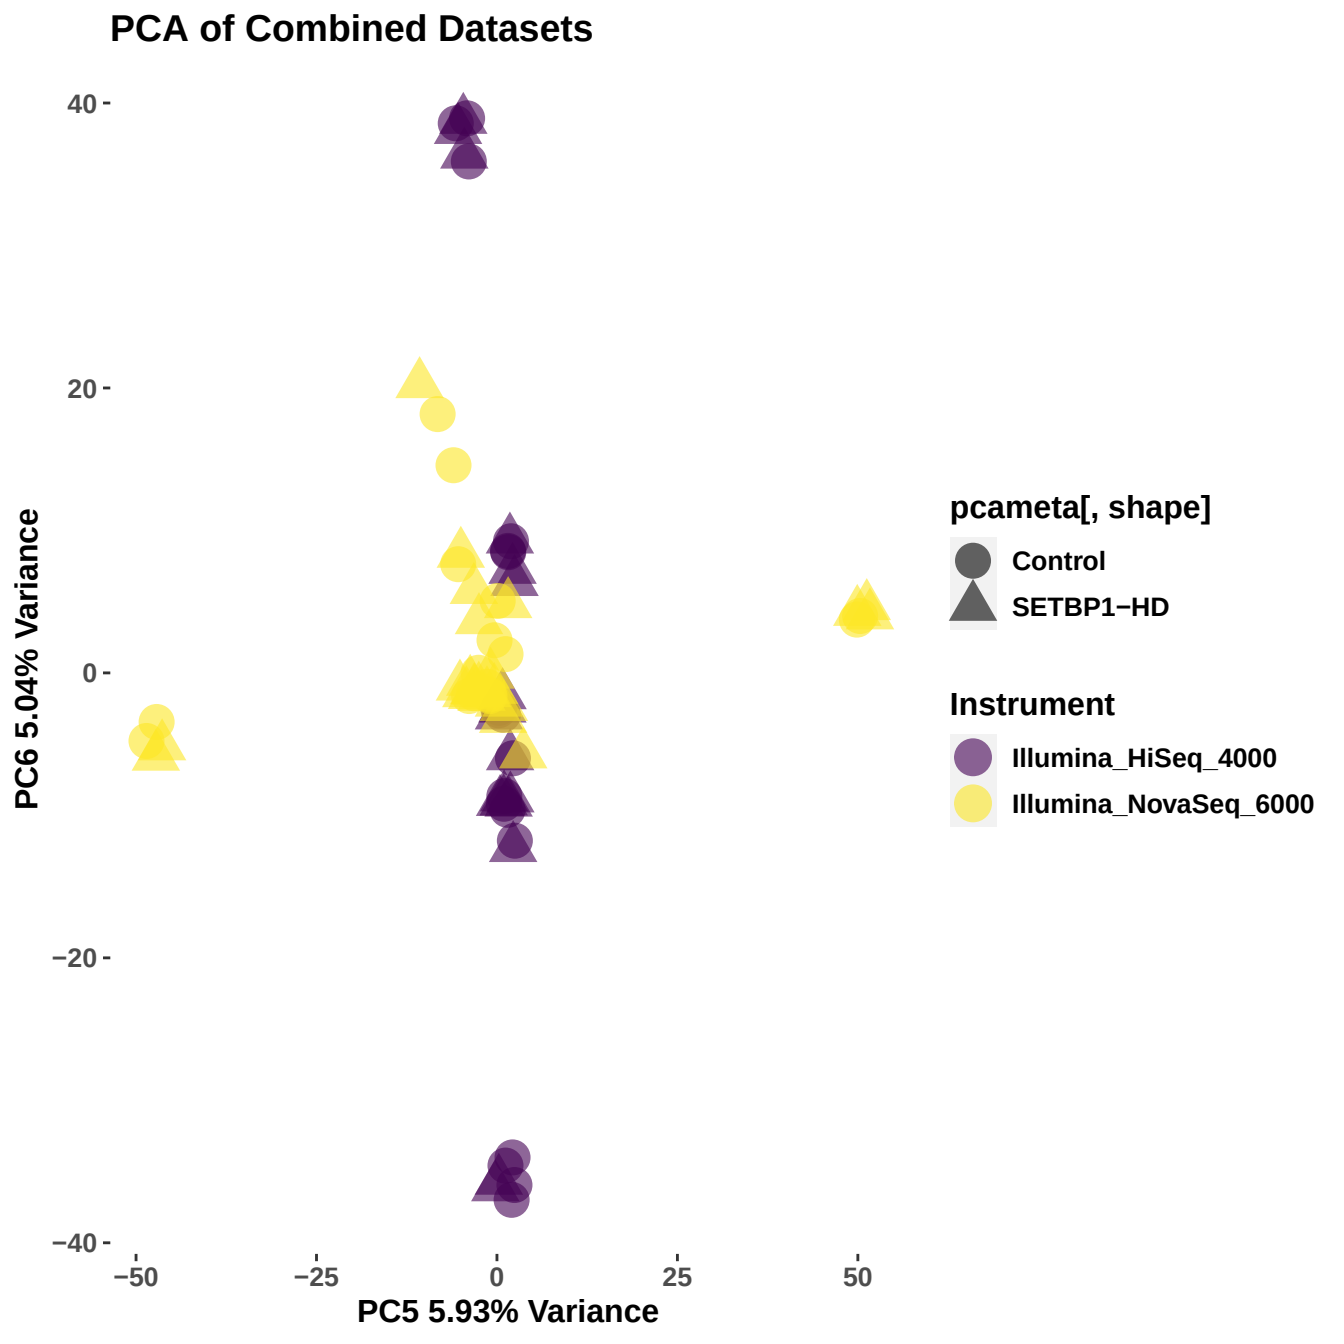
PCA of Combined Datasets
PC6 5.04% Variance
PC5 5.93% Variance
40
20
0
−20
−40
−50
−25
0
25
50
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

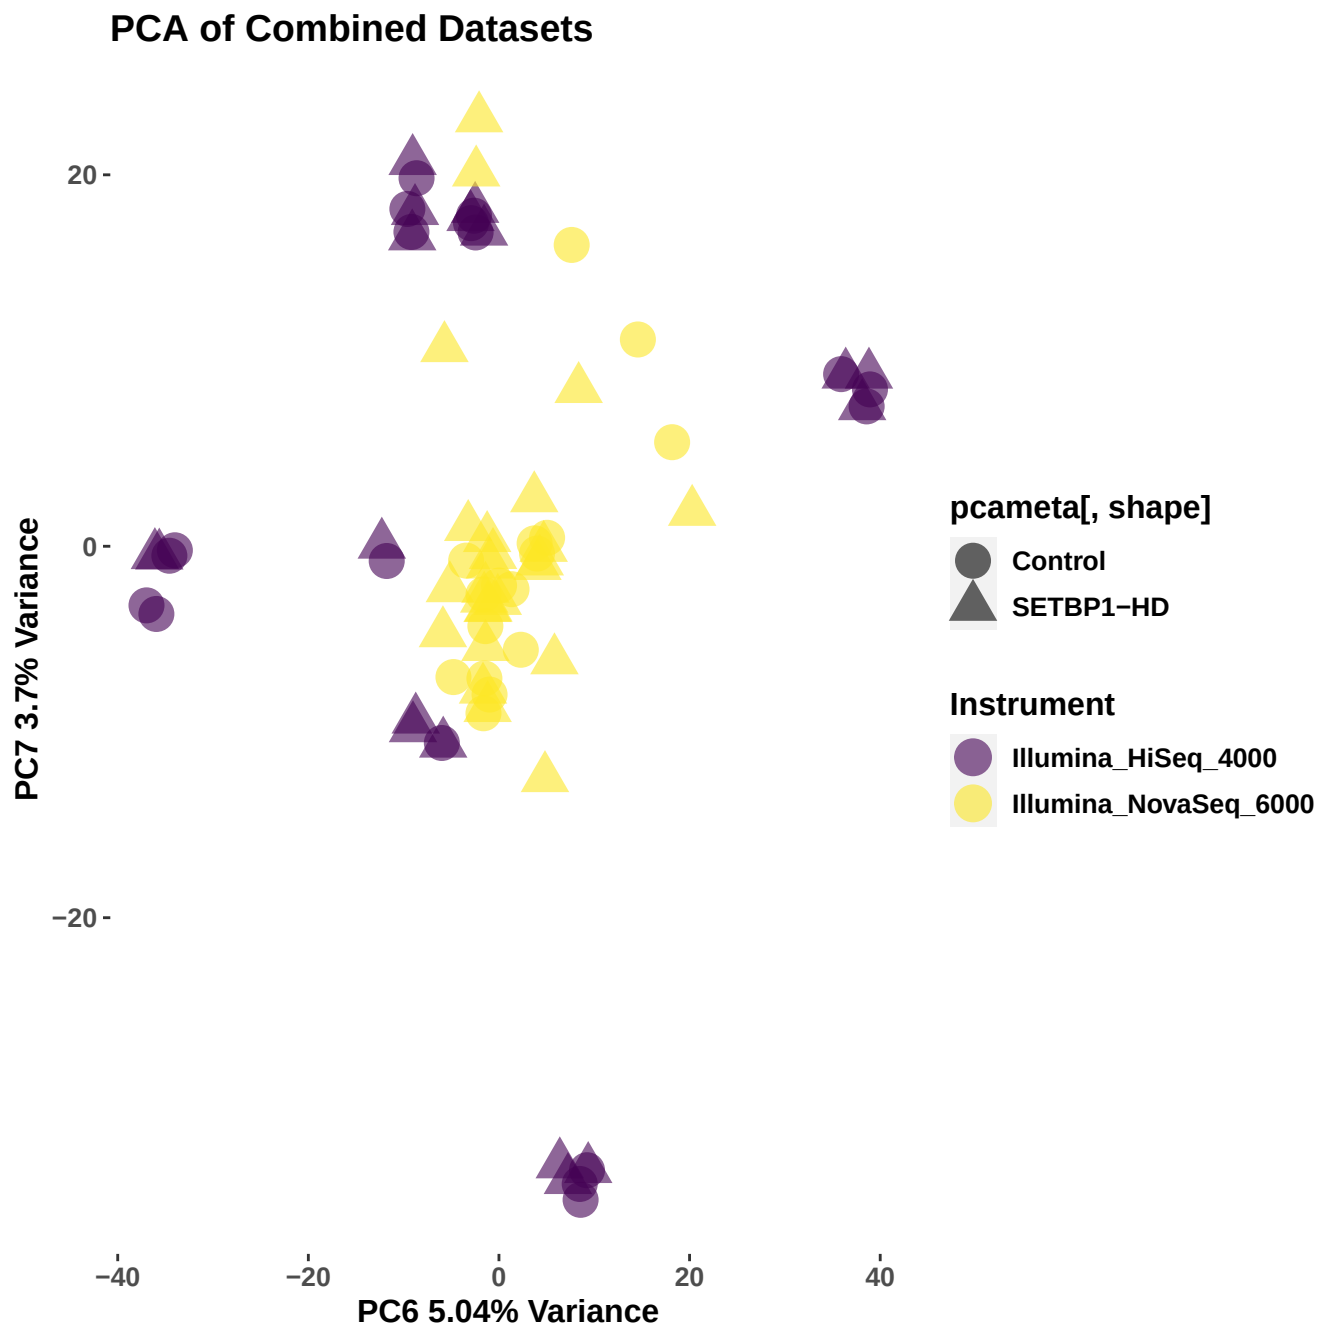
PCA of Combined Datasets
20
0
−20
PC7 3.7% Variance
−40
−20
0
20
40
PC6 5.04% Variance
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000

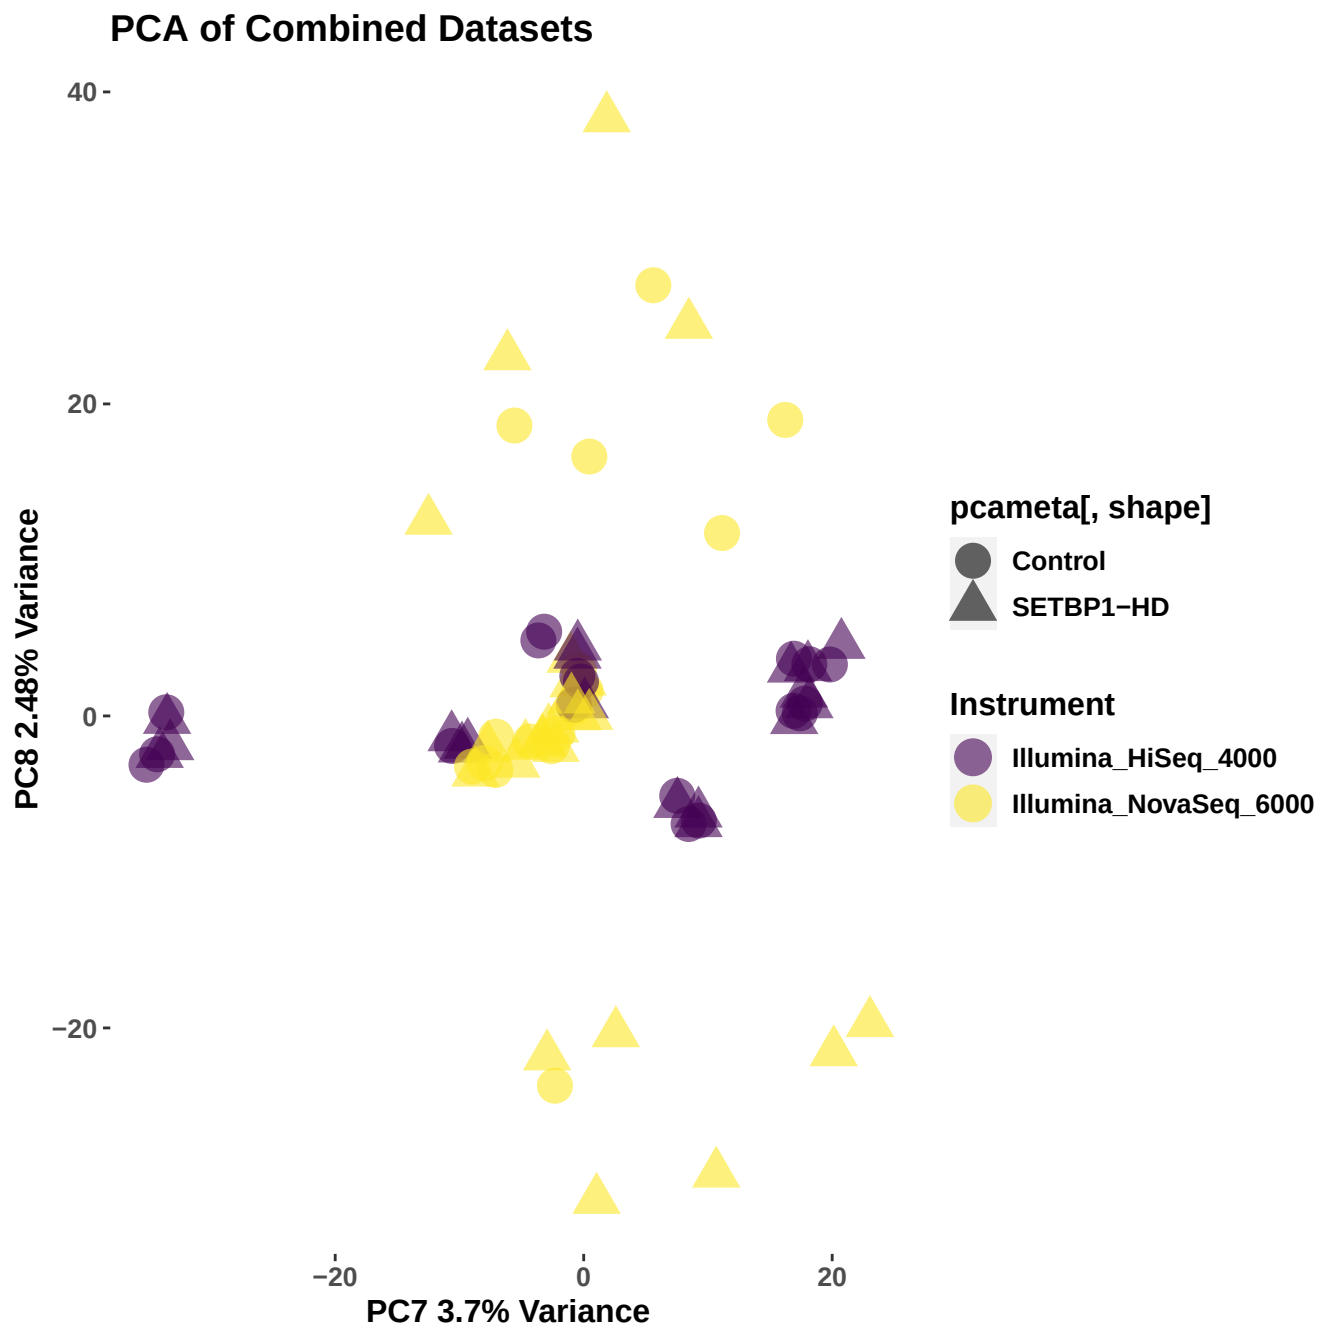
PCA of Combined Datasets
40
20
0
−20
PC8 2.48% Variance
−20
0
20
PC7 3.7% Variance
pcameta[, shape]
Control
SETBP1−HD
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000