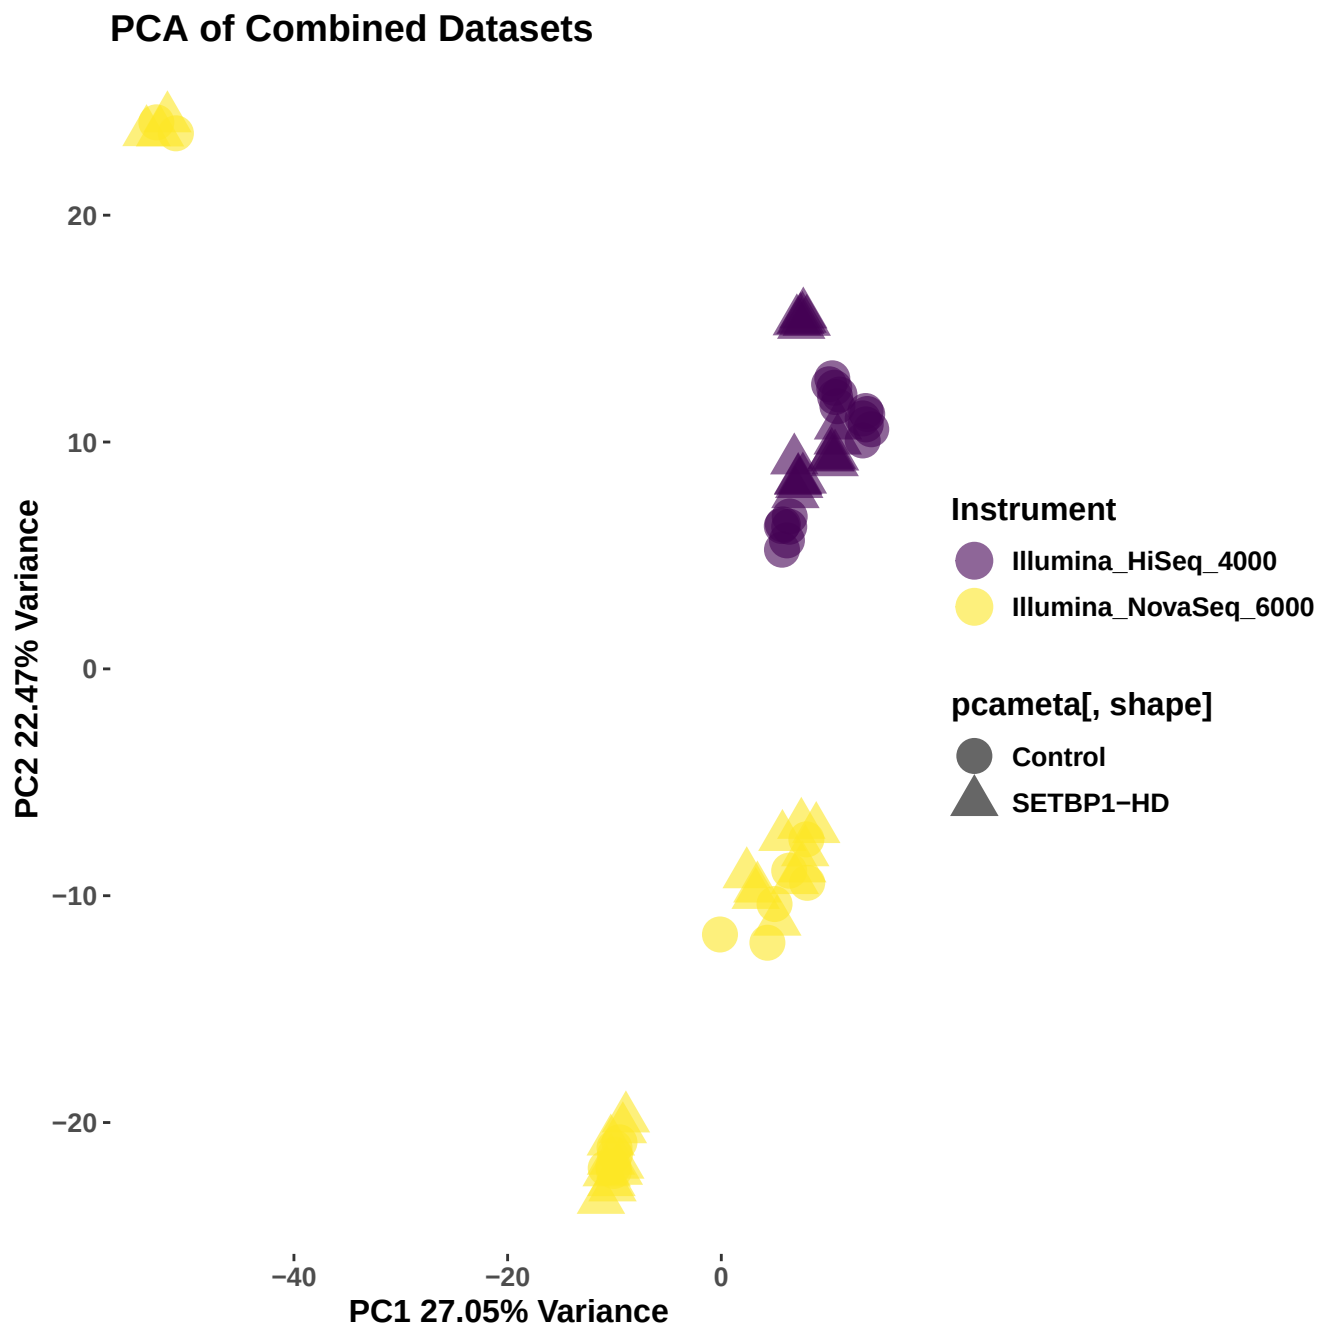
PCA of Combined Datasets
PC2 22.47% Variance
PC1 27.05% Variance
20
10
0
−10
−20
−40
−20
0
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD

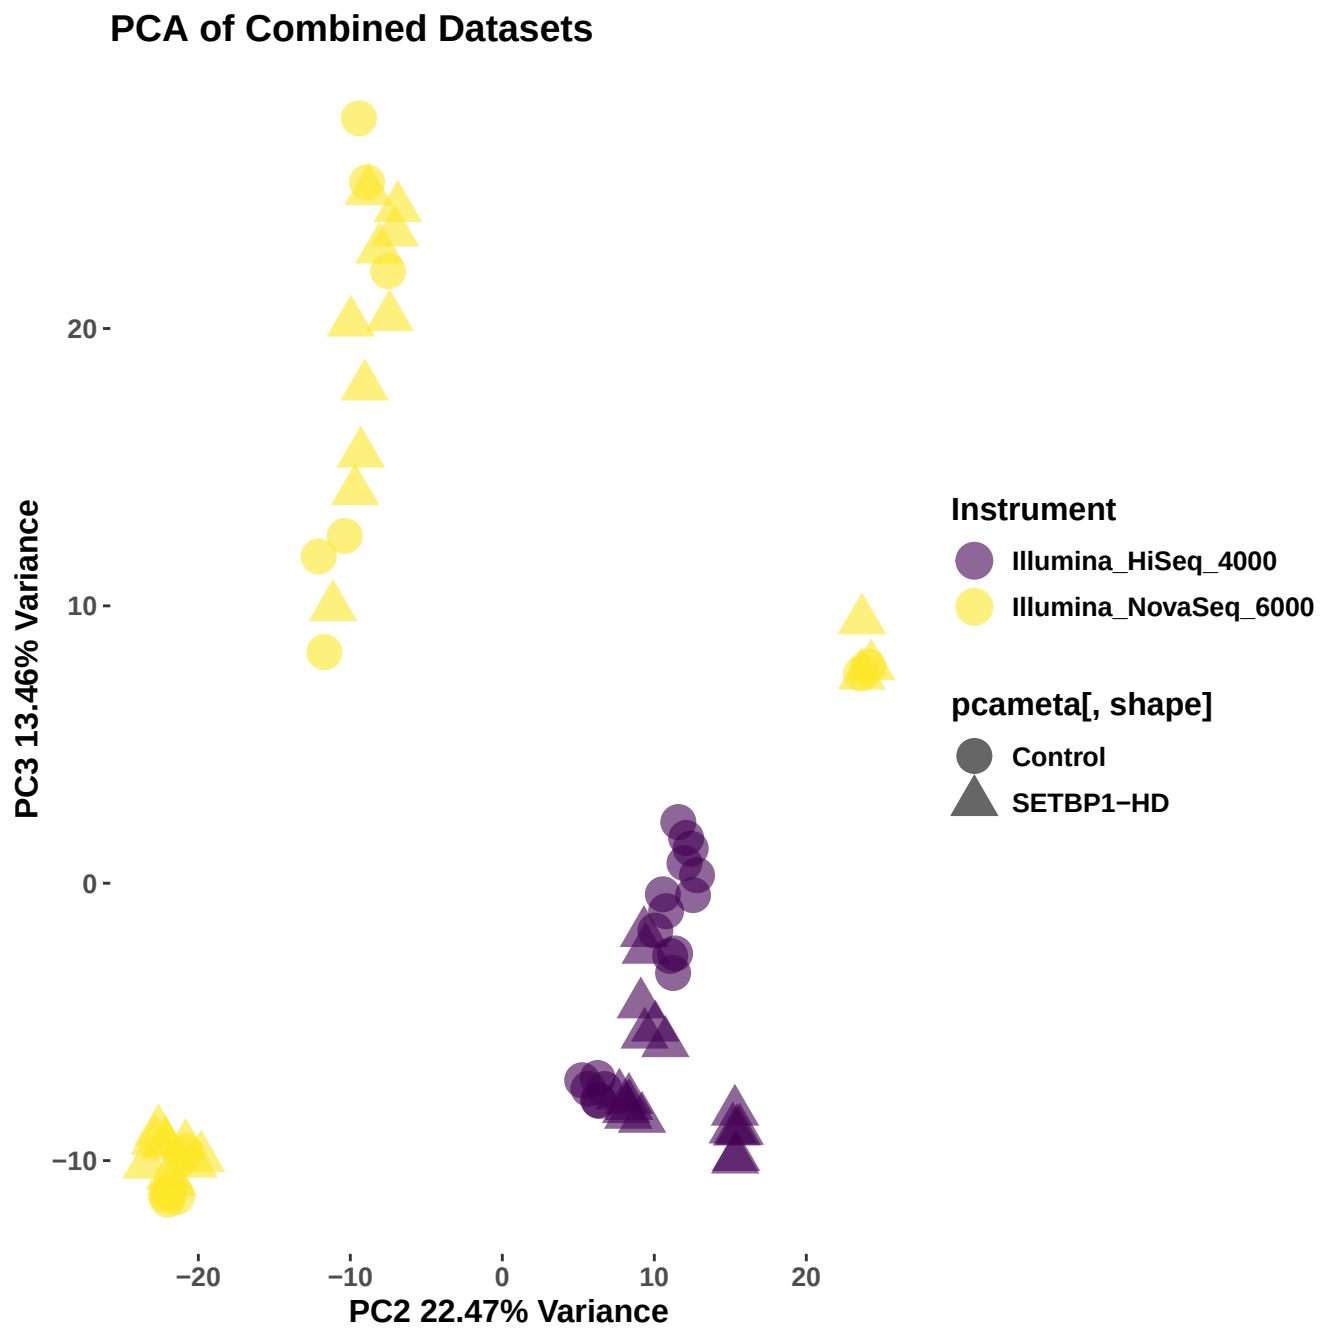
PCA of Combined Datasets
PC3 13.46% Variance
PC2 22.47% Variance
20
10
0
−10
−20
−10
0
10
20
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD

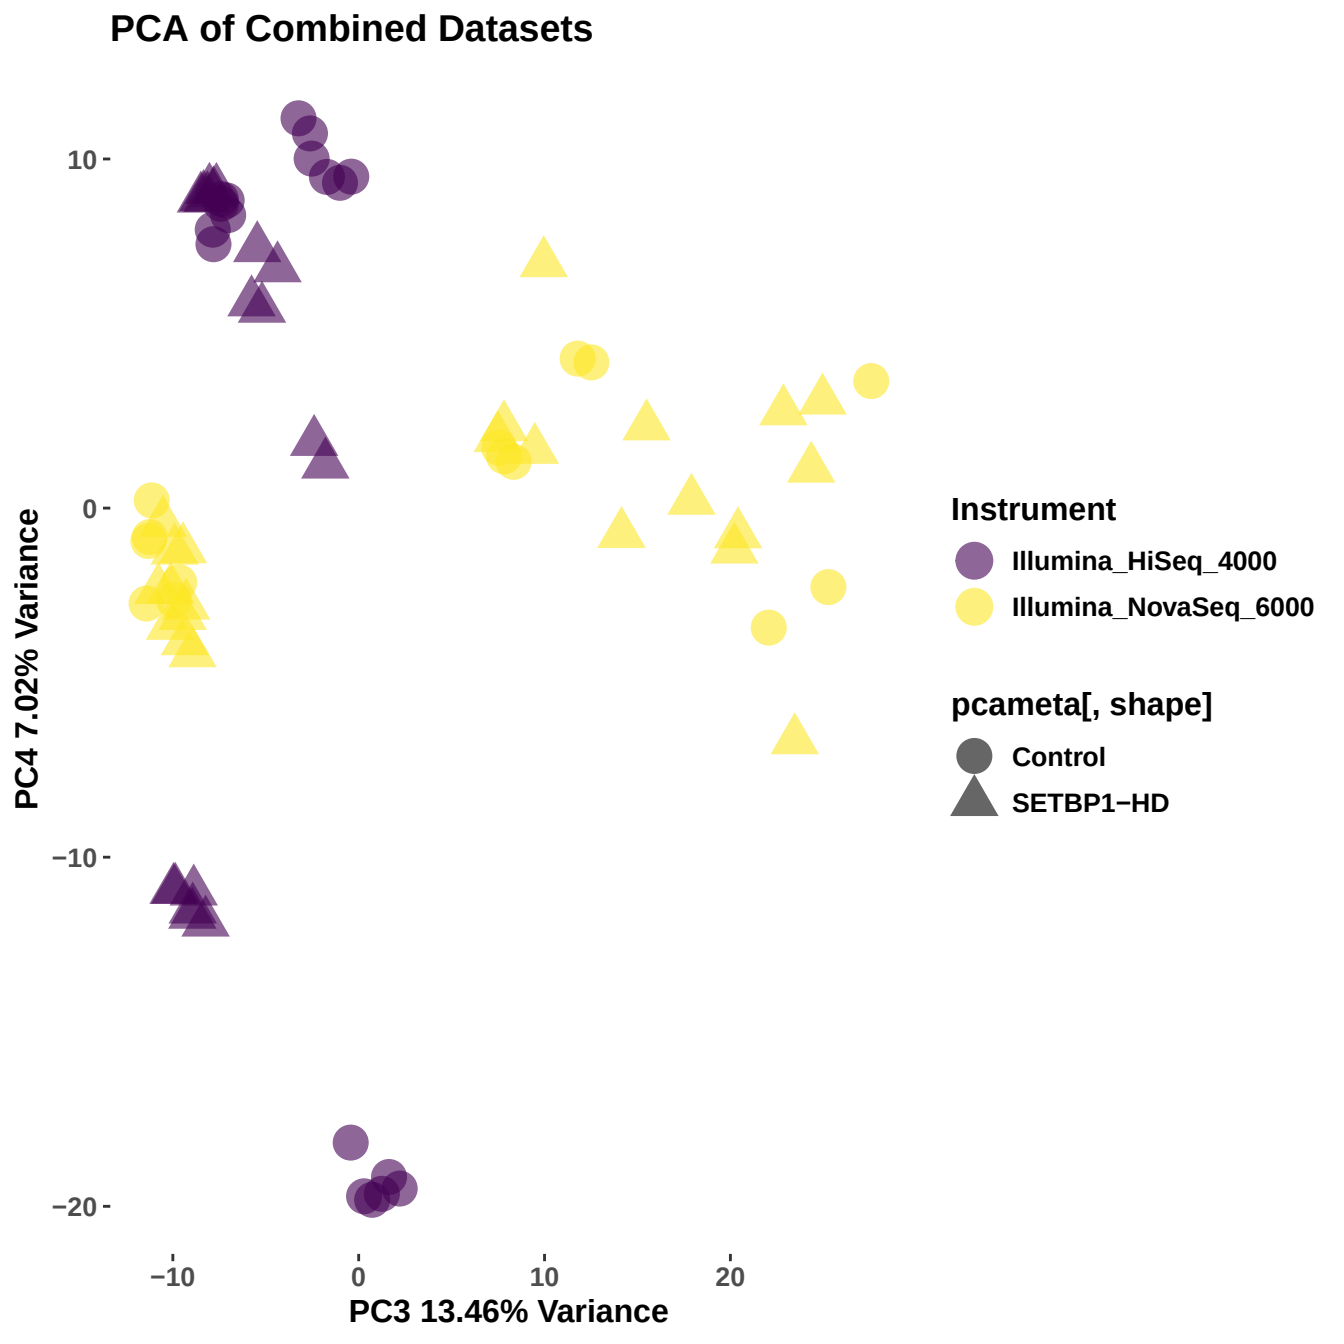
PCA of Combined Datasets
10
0
−10
−20
PC4 7.02% Variance
−10
0
10
20
PC3 13.46% Variance
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD

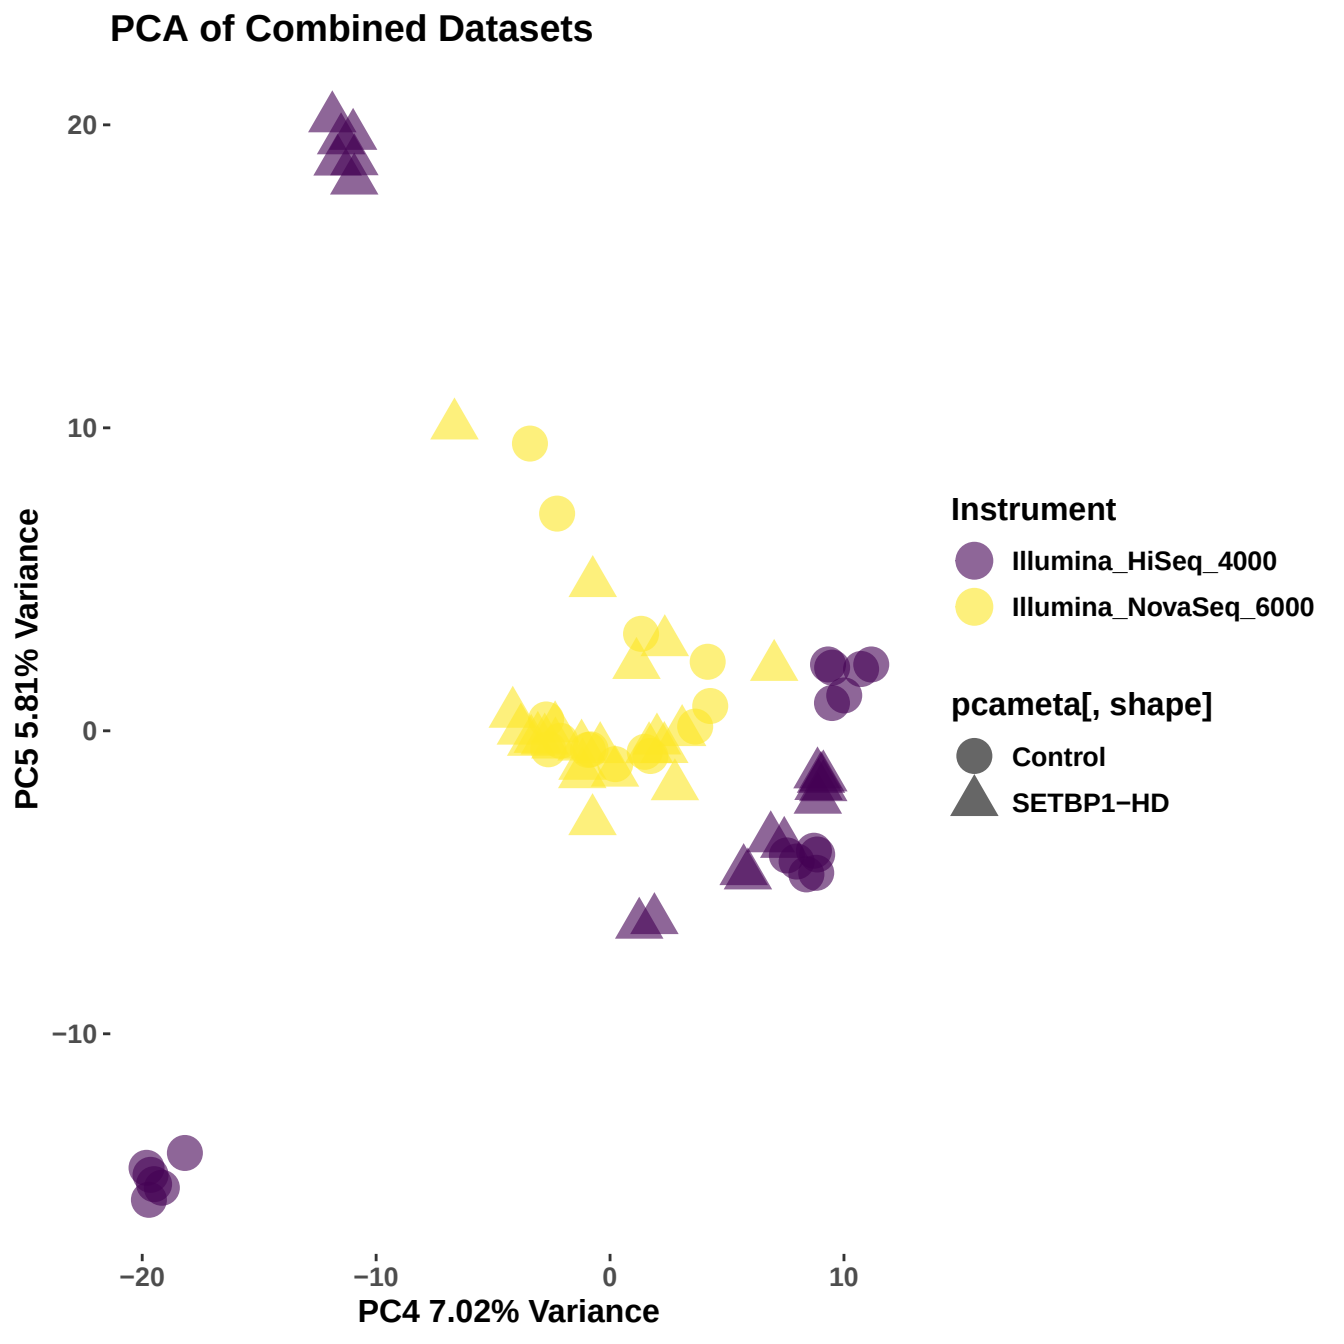
PCA of Combined Datasets
20
10
0
−10
PC5 5.81% Variance
−20
−10
0
10
PC4 7.02% Variance
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD

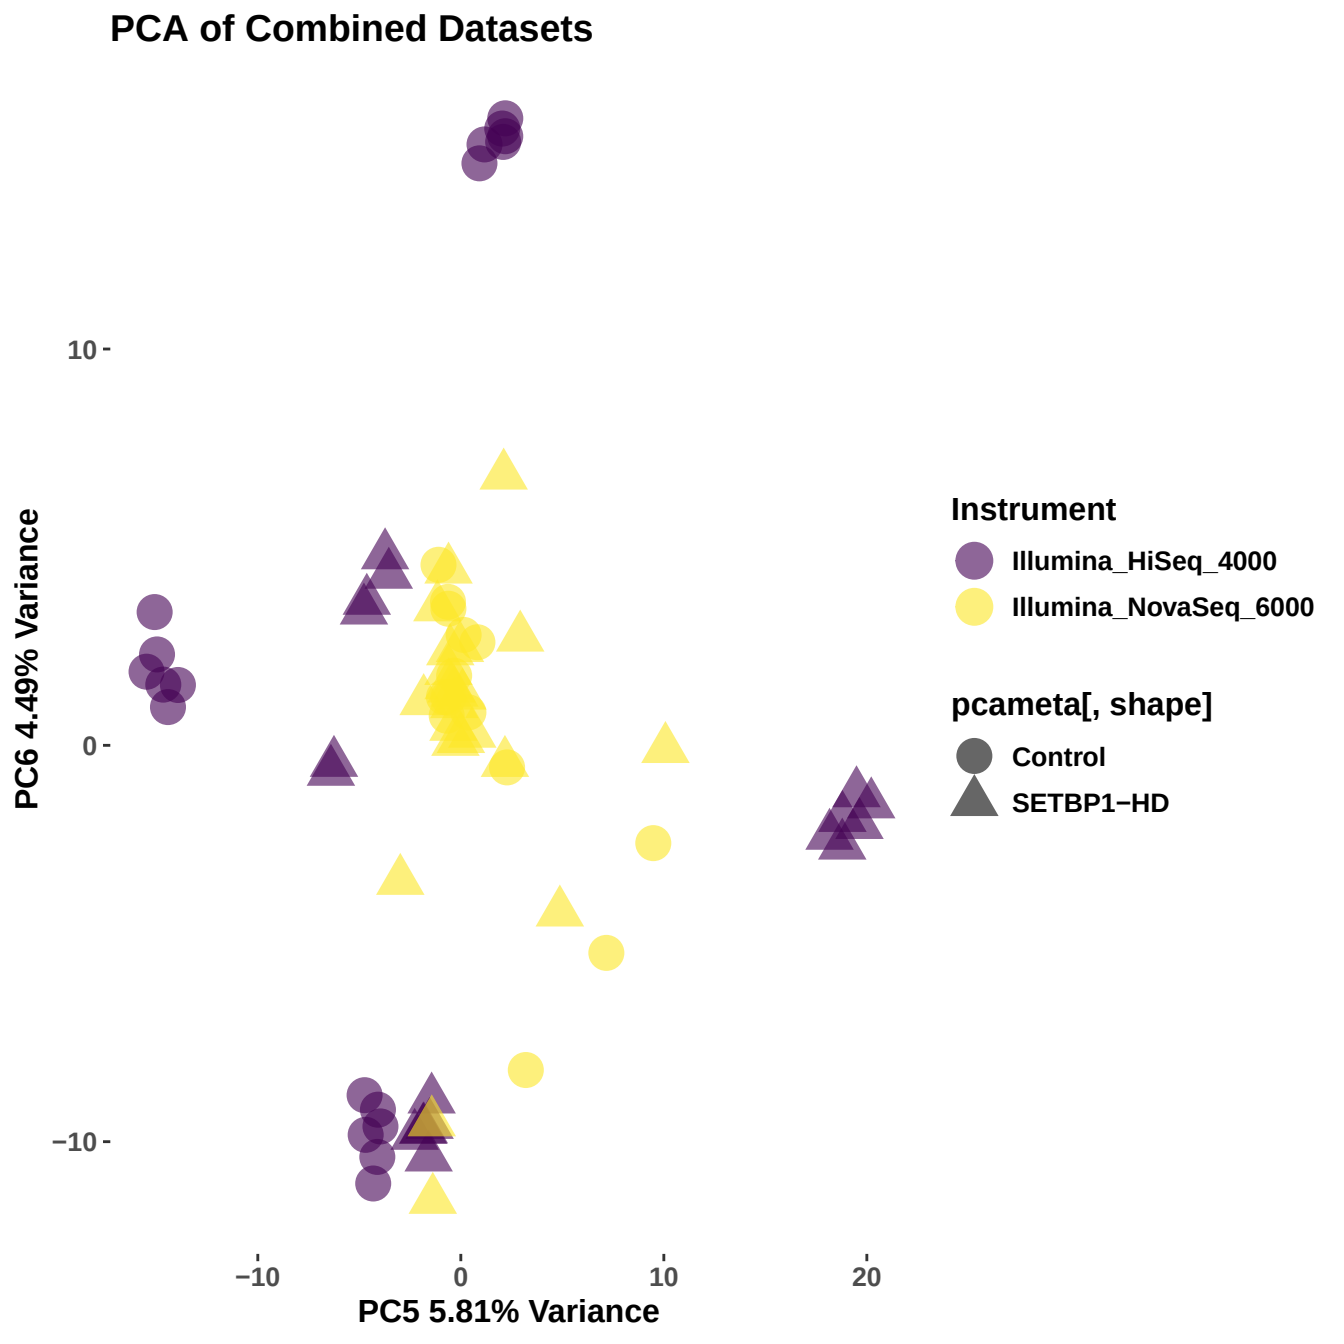
PCA of Combined Datasets
PC6 4.49% Variance
PC5 5.81% Variance
10
0
−10
−10
0
10
20
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD

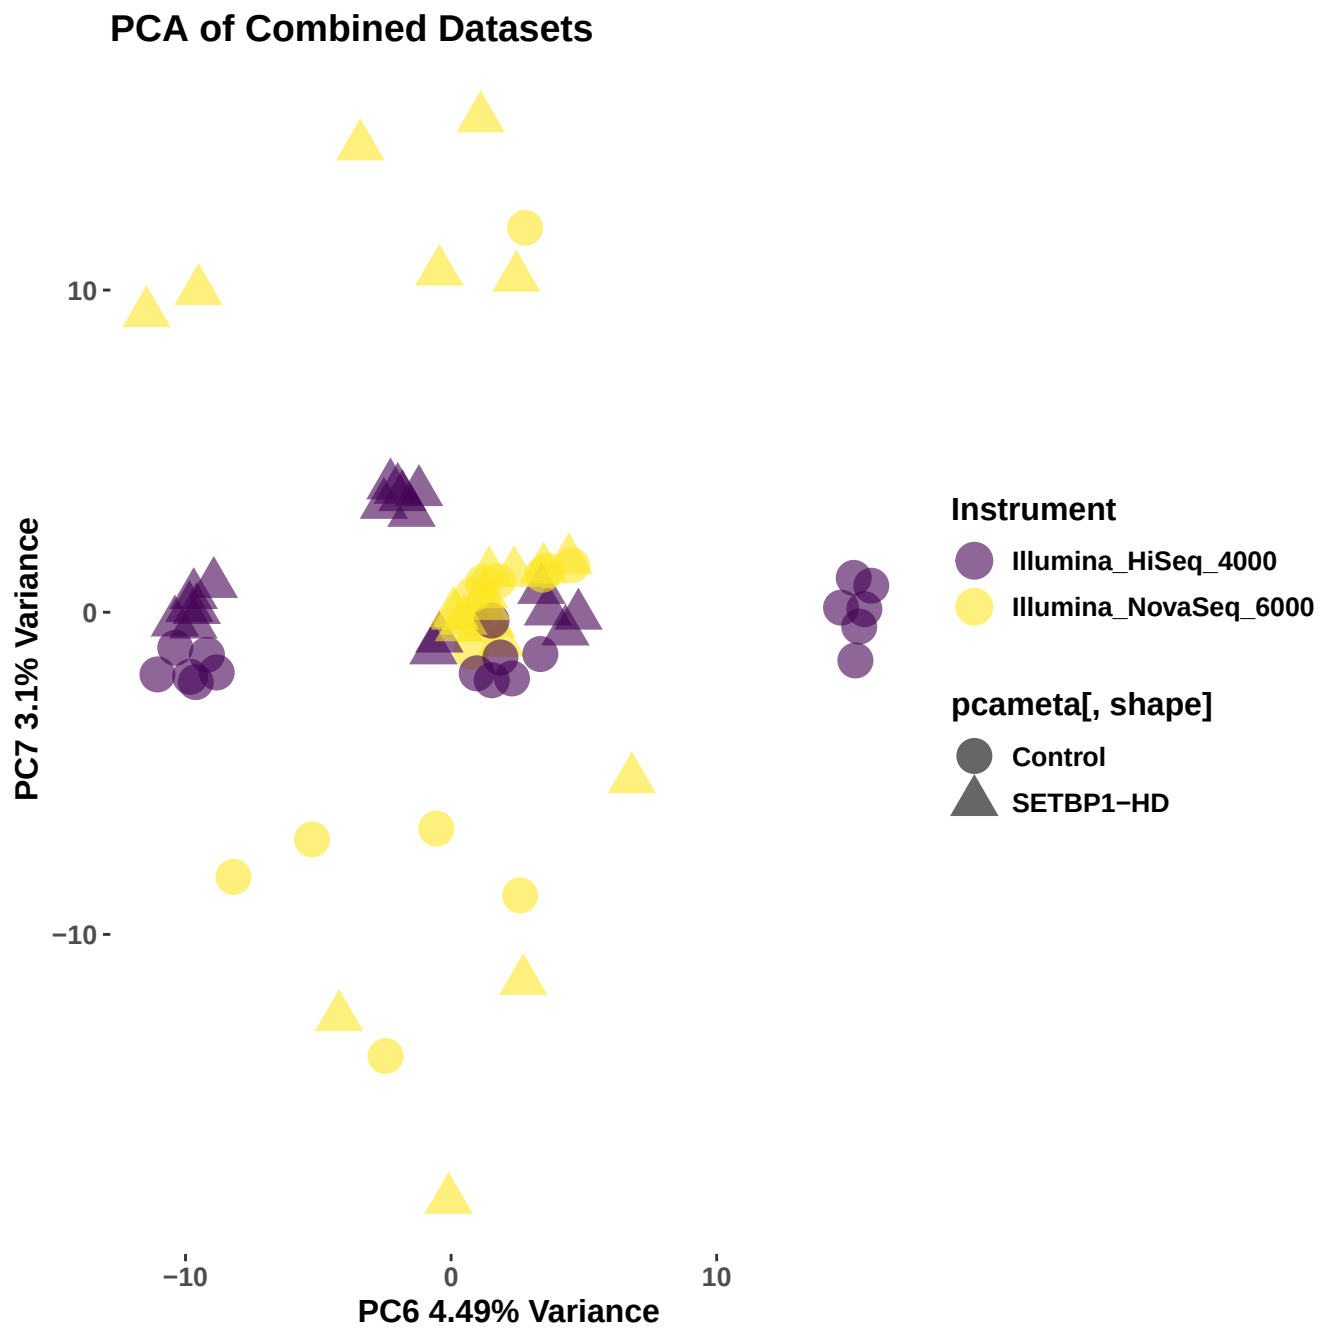
PCA of Combined Datasets
PC7 3.1% Variance
PC6 4.49% Variance
10
0
−10
−10
0
10
Instrument
Illumina_HiSeq_4000
Illumina_NovaSeq_6000
pcameta[, shape]
Control
SETBP1−HD