
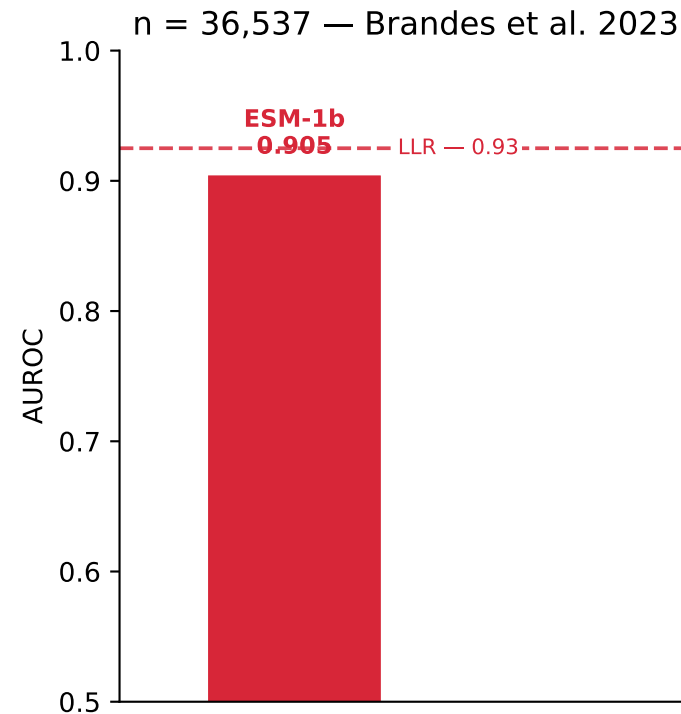
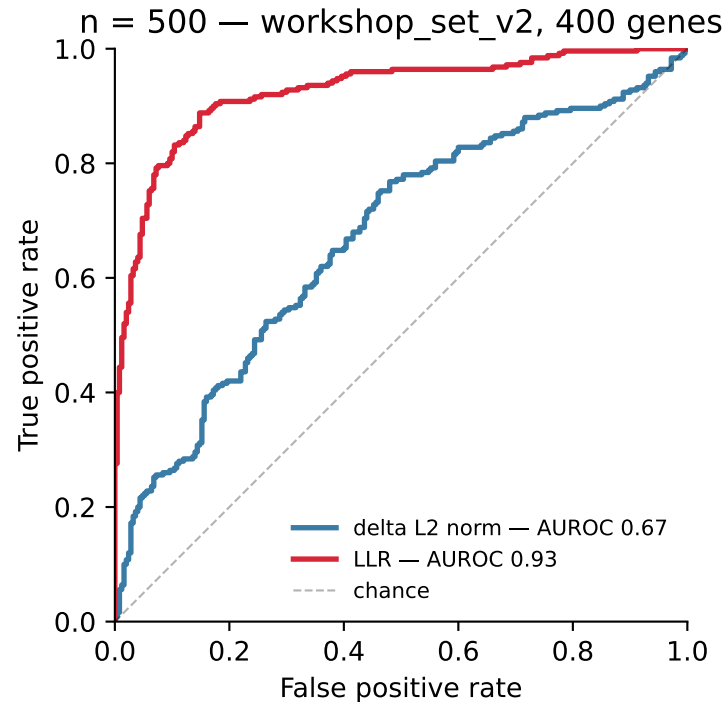


Resolution: same harness, three scales

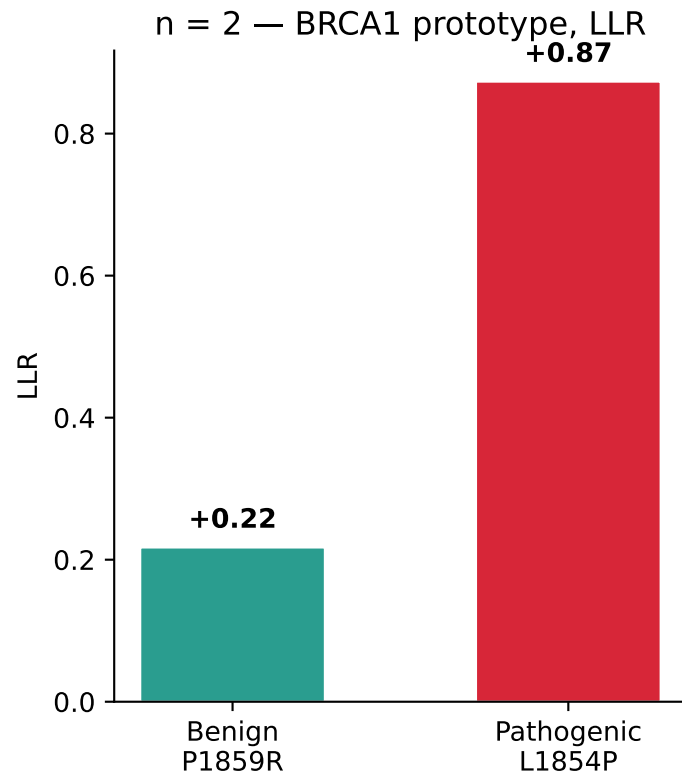

ESM-1b zero-shot, ClinVar missense (all genes).
The ceiling this harness climbs toward.

Panel B: workshop_set_v2 — 250 pathogenic + 250 benign ClinVar missense across 400 disease genes. Brandes-matching label scope: canonical Pathogenic*/Benign* by text class; Conflicting* by ClinSigSimple lean; Uncertain* dropped. All canonical-isoform-validated. LLR AUROC 0.925 (CI95 0.900–0.947) — within noise of Brandes 2023's 0.905.