


Resolution: same harness, three scales

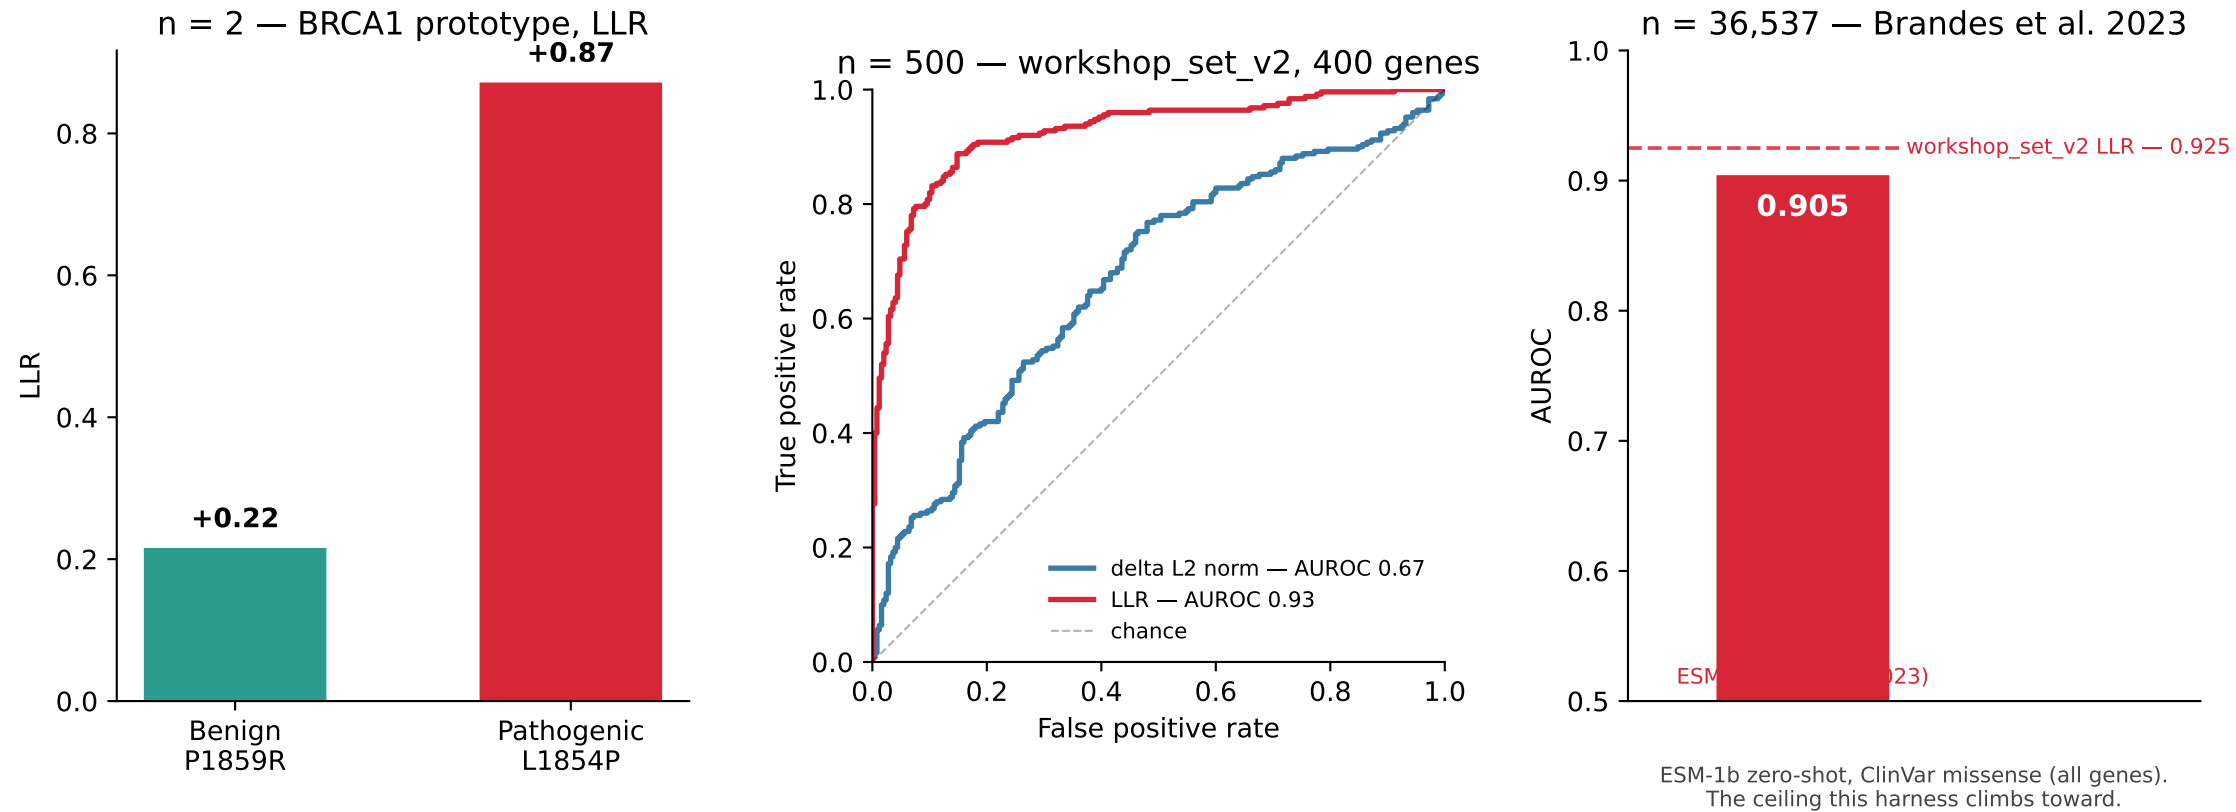

Panel B: workshop_set_v2 — 250 pathogenic + 250 benign ClinVar missense across 400 disease genes.

Brandes-matching label scope: canonical Pathogenic*/Benign* by text class;

Conflicting* by ClinSigSimple lean; Uncertain* dropped. All canonical-isoform-validated.

LLR AUROC 0.925 (CI95 0.900–0.947) — within noise of Brandes 2023's 0.905.