
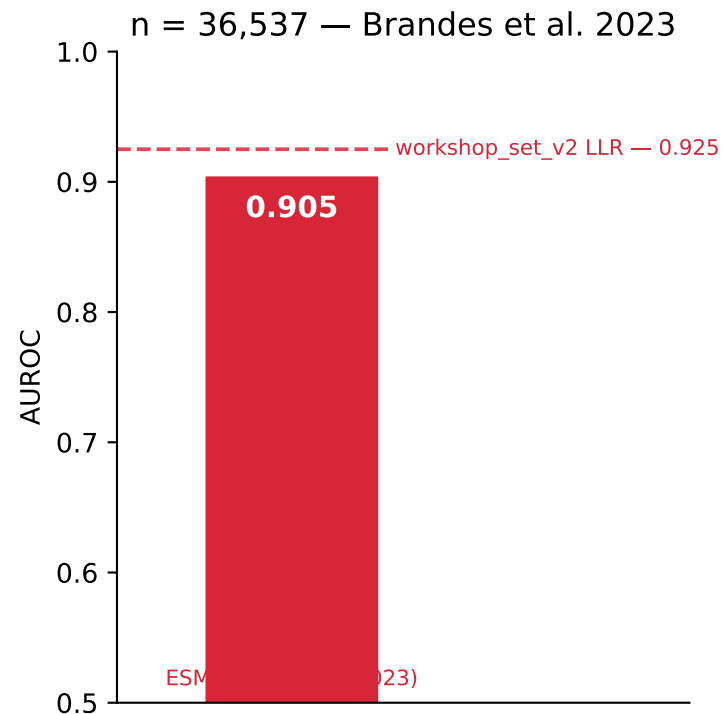
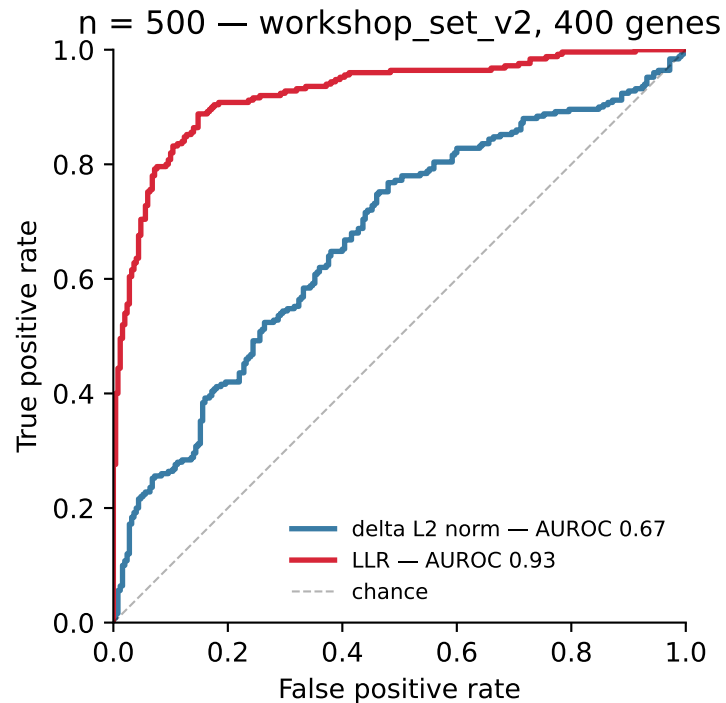


## Resolution: same harness, three scales

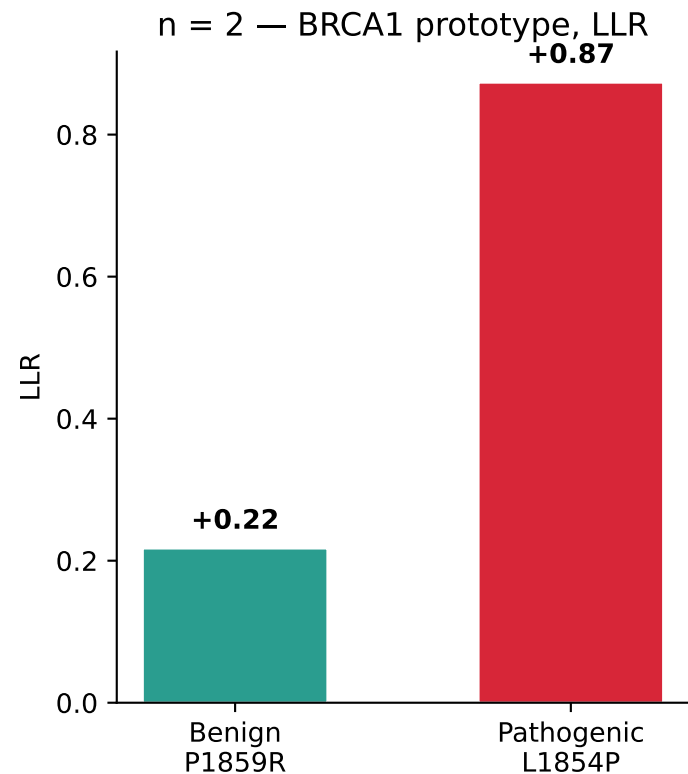

ESM-1b zero-shot, ClinVar missense (all genes).  
The ceiling this harness climbs toward.

Panel B: workshop\_set\_v2 — 250 P + 250 B across 400 disease genes; Brandes-matching label scope (canonical text + Conflicting via ClinSigSimple), canonical-isoform-validated.  
LLR AUROC 0.925 (CI95 0.900–0.947) — within noise of Brandes 2023's 0.905.