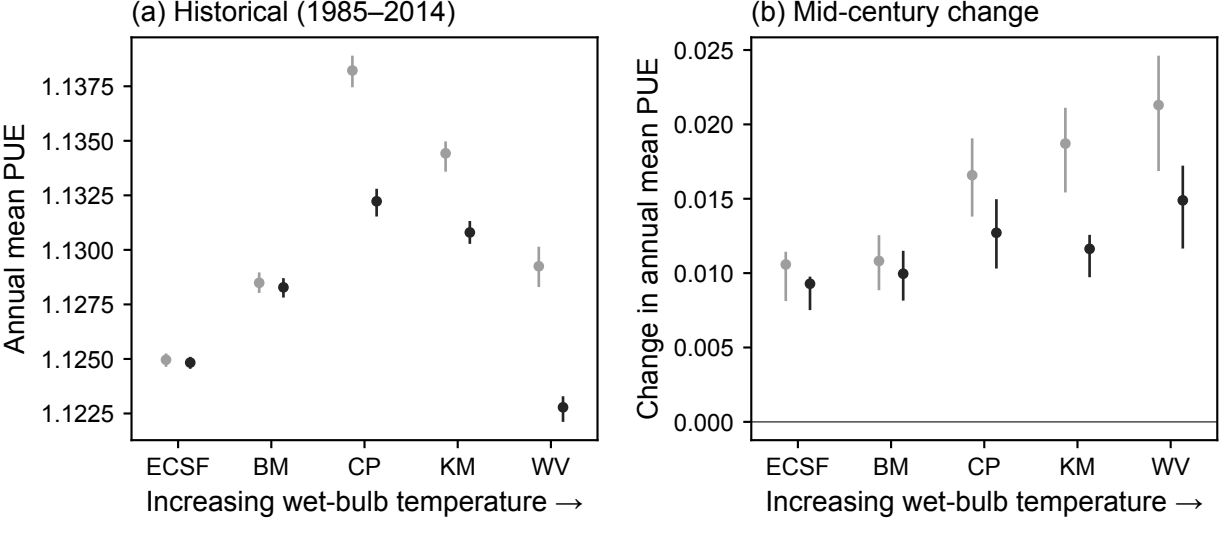
(a) Historical (1985–2014)
Annual mean PUE
1.1375
1.1350
1.1325
1.1300
1.1275
1.1250
1.1225
ECSF
BM
CP
KM
WV
Increasing wet-bulb temperature →
(b) Mid-century change
Change in annual mean PUE
0.025
0.020
0.015
0.010
0.005
0.000
ECSF
BM
CP
KM
WV
Increasing wet-bulb temperature →
Supply-air relative humidity upper setpoint:
60%
77.5%