


CrossMEP: A Tiered Synthetic Dataset of Multi-Trade MEP Cross-Sections

A support-design problem distribution for learning-based structural support assembly synthesis

Lavinia Pedrollo¹ • David Gvadzabia² • Torben Graeber³ • Martin Fischer¹

¹ Stanford University, CIFE ² Lafayette College ³ Hilti AG


43rd International CIB W78 Conference • IT in Construction • New Delhi, 6–8 October 2026

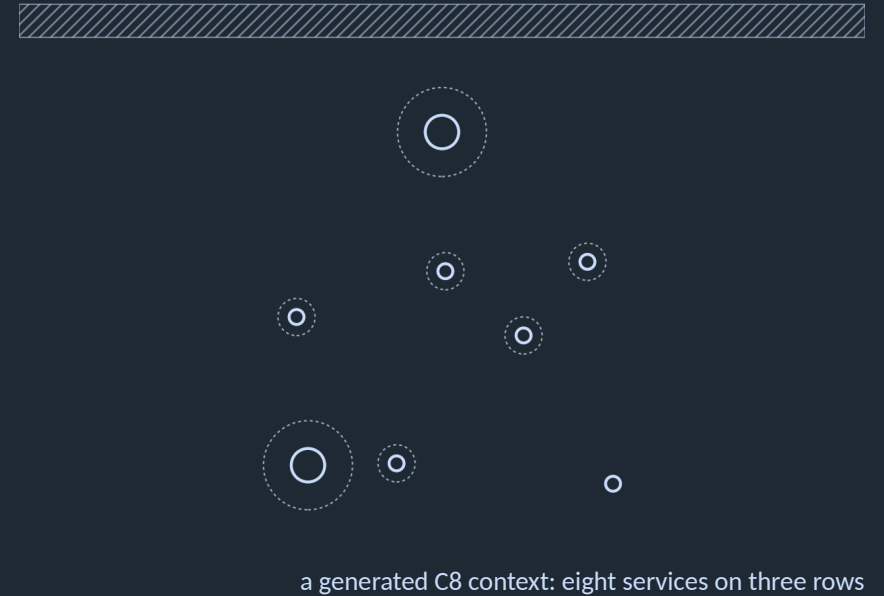

A hospital needs about 10,000 support assemblies, each designed by hand



1 unit = 1 structural support assembly (SSA)

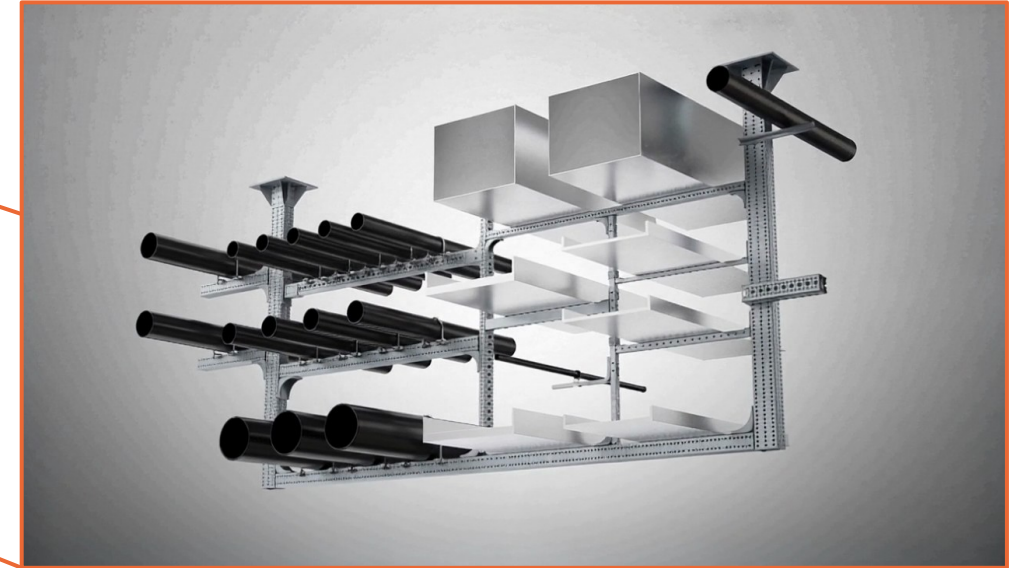

≈ 10,000

support assemblies in one 200,000 sq ft hospital



20 min – 2 h

of engineering for each assembly,
designed one by one




≈ 1/4

of MEP design effort; on the order of
\$600K per project


A designer turns one cross-section into verified support assemblies

In: one cross-section = a context

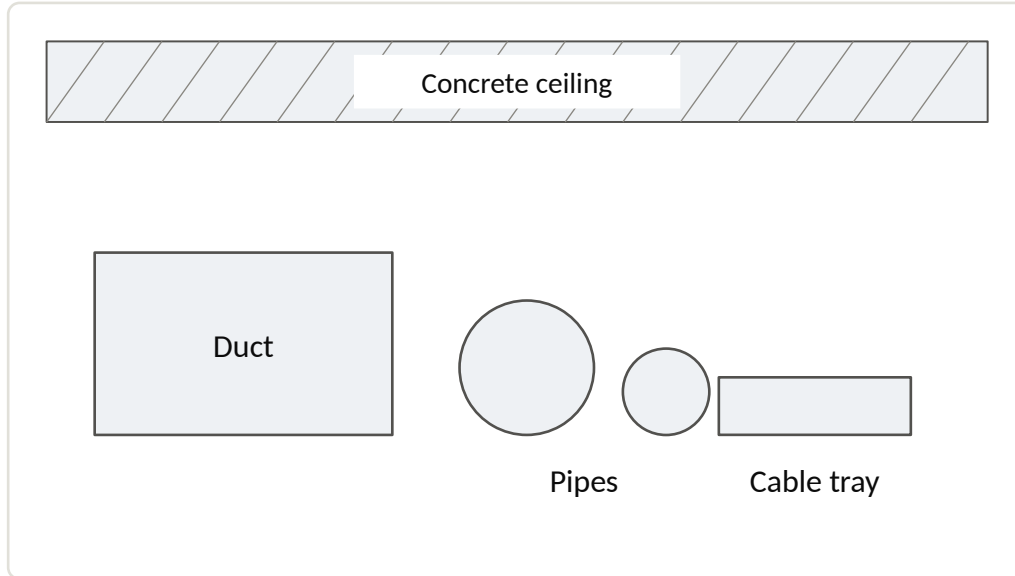

Structure: ceiling, floor or wall, with anchor zones
Services: trade, position, size and weight per metre

Out: verified support designs = assemblies

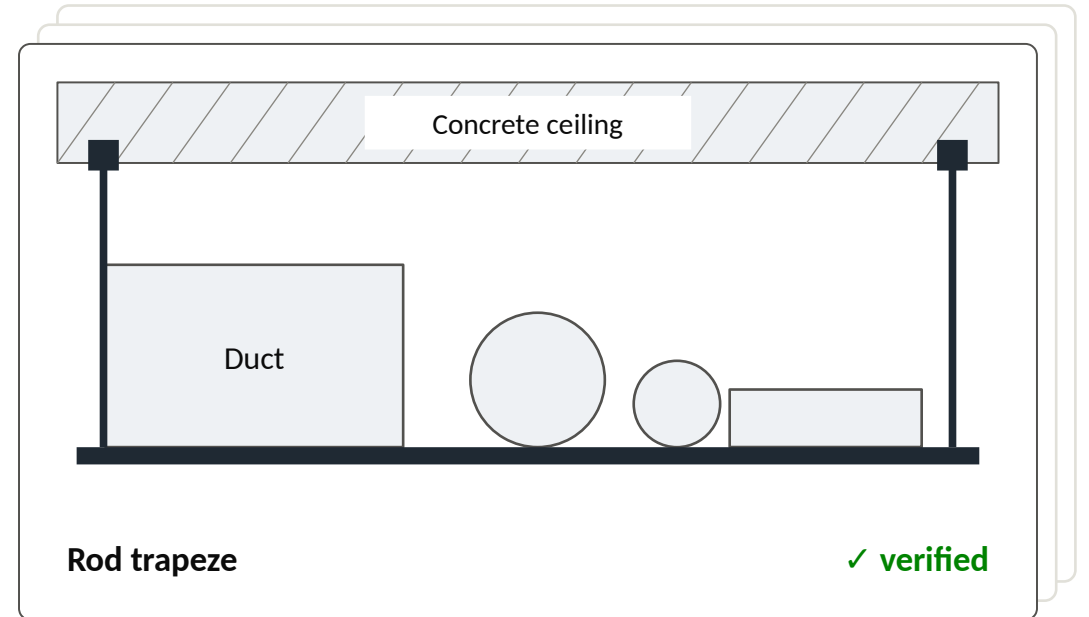


Up to ten designs, ranked by installed cost
Each checked: statics, anchors, connectors, buildability

Context, the brief: the section at one hanger, its structure and services.
This is what CrossMEP contains.

Assembly, the answer: catalog parts that carry the services to the structure. Not in CrossMEP: a method produces it.

Synthesizing the assembly from a catalog and a context has resisted automation

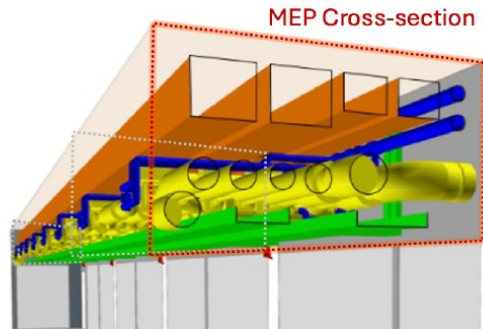

(a) Full MEP route



(b) One CrossMEP context

Design starts after coordination [3]: at each hanger the designer works from the section across the run, not from the whole model [2].



Where practice stands

Tools coordinate the model and check a design.

Choosing the topology and the parts, from a fixed catalog, is still done by hand, one section at a time [1].



1. Geometric judgment

Engineers choose an assembly's topology from experience.



2. Rule explosion

Code, load and material constraints interact across thousands of combinations.




3. Catalog volatility

Catalogs change faster than rule-based systems can be rewritten.

[1] Pedrollo, Graeber & Fischer (2026), Feasibility-aware sequential synthesis of structural support assemblies, ISARC 2026 [2] Pedrollo, Gvazdabia, Graeber & Fischer (2026), CrossMEP, CIB W78 2026 (this paper) [3] Korman, Fischer & Tatum (2003), Knowledge and reasoning for MEP coordination, J. Constr. Eng. Manage. 129(6)

Whatever the method, it needs problems to learn from and a fixed set to compare on

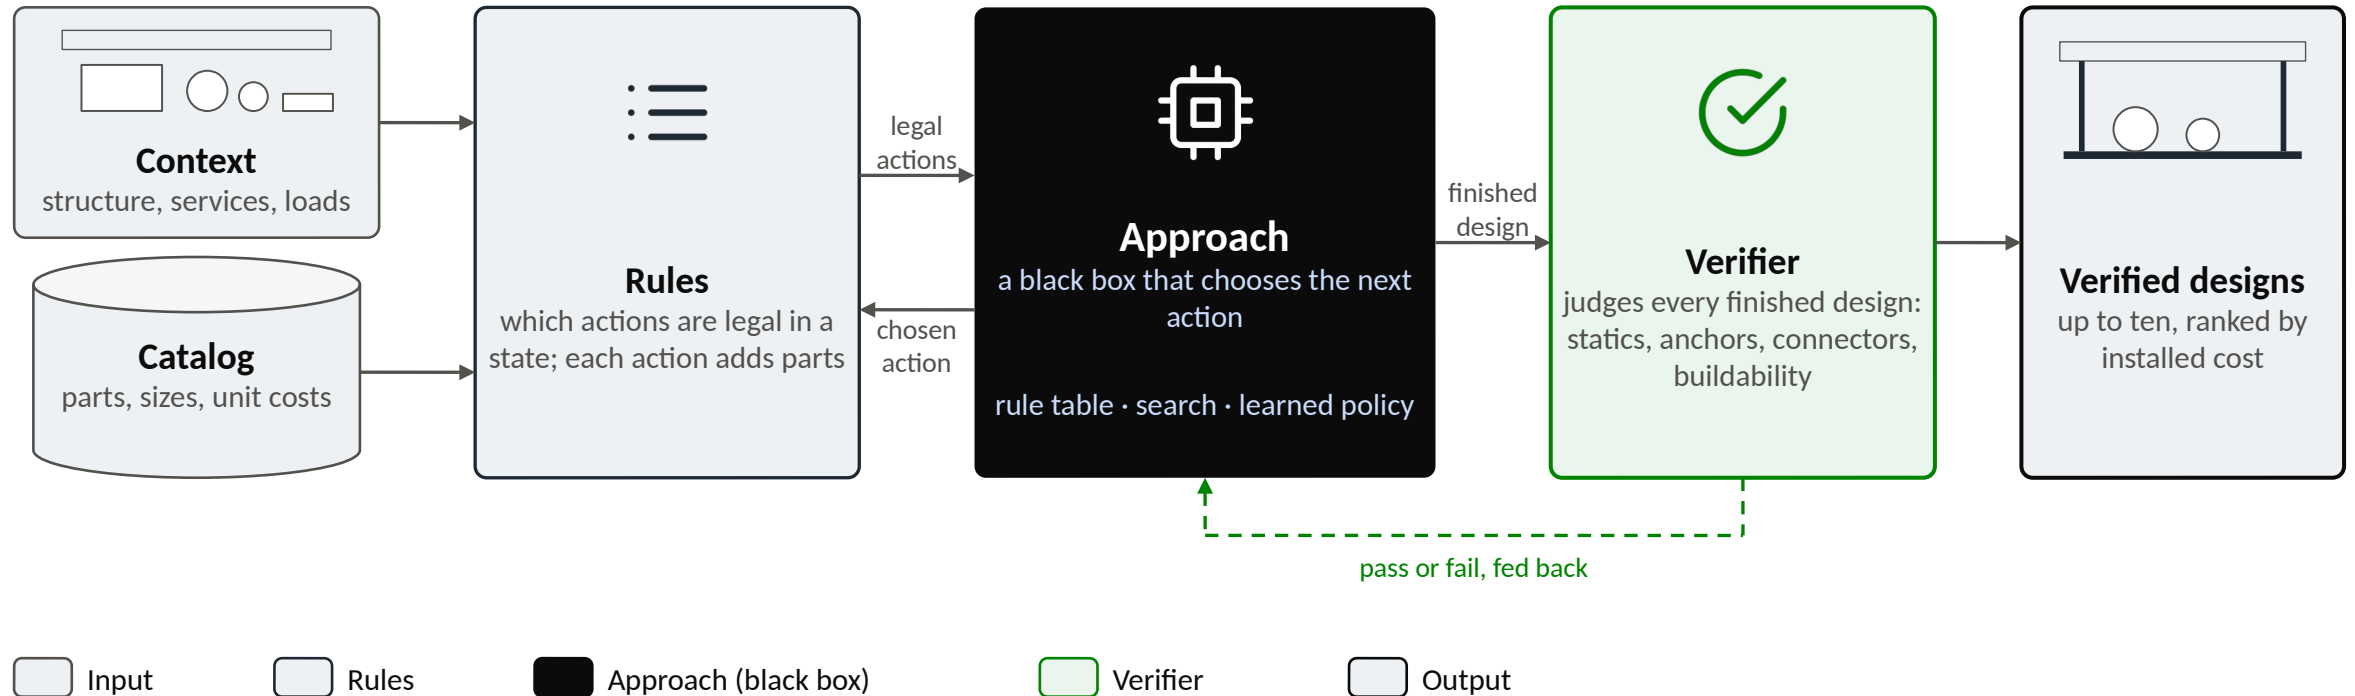


Whatever sits in the black box, it needs **problems to learn from**, a **fixed set to compare on** and **problems that look like practice**.

Real designs cover one corner of the design space; CrossMEP covers all of it

The real designs we had

few, from one kind of project with one trade mix: one corner of the space

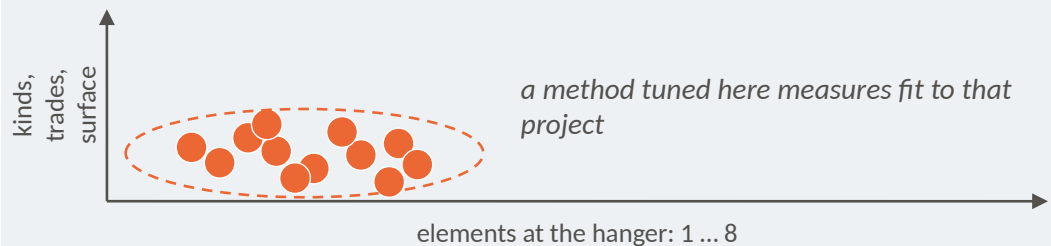

CrossMEP at a glance

7,000

contexts in four splits
on disjoint seeds

31,484


elements: pipes, cable
trays, ducts and
conduits; six trades

C1–C8

eight difficulty tiers by
exact element count

CrossMEP

the space filled by construction, without limit: a new seed is a new set; uniform over the tiers, or any mix you ask for (`generate_custom`)

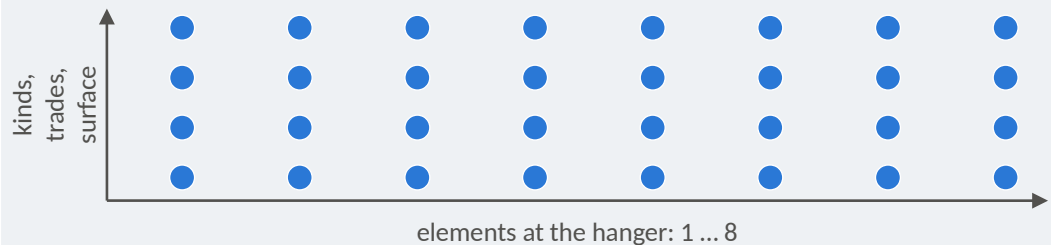

0 labels

the brief, not the
answer: no support-
assembly information


Traced

every constant with its
source, or declared a
design choice

Open

data CC BY 4.0, code
MIT; a seeded,
deterministic generator


We generate what a designer receives: the section at one hanger

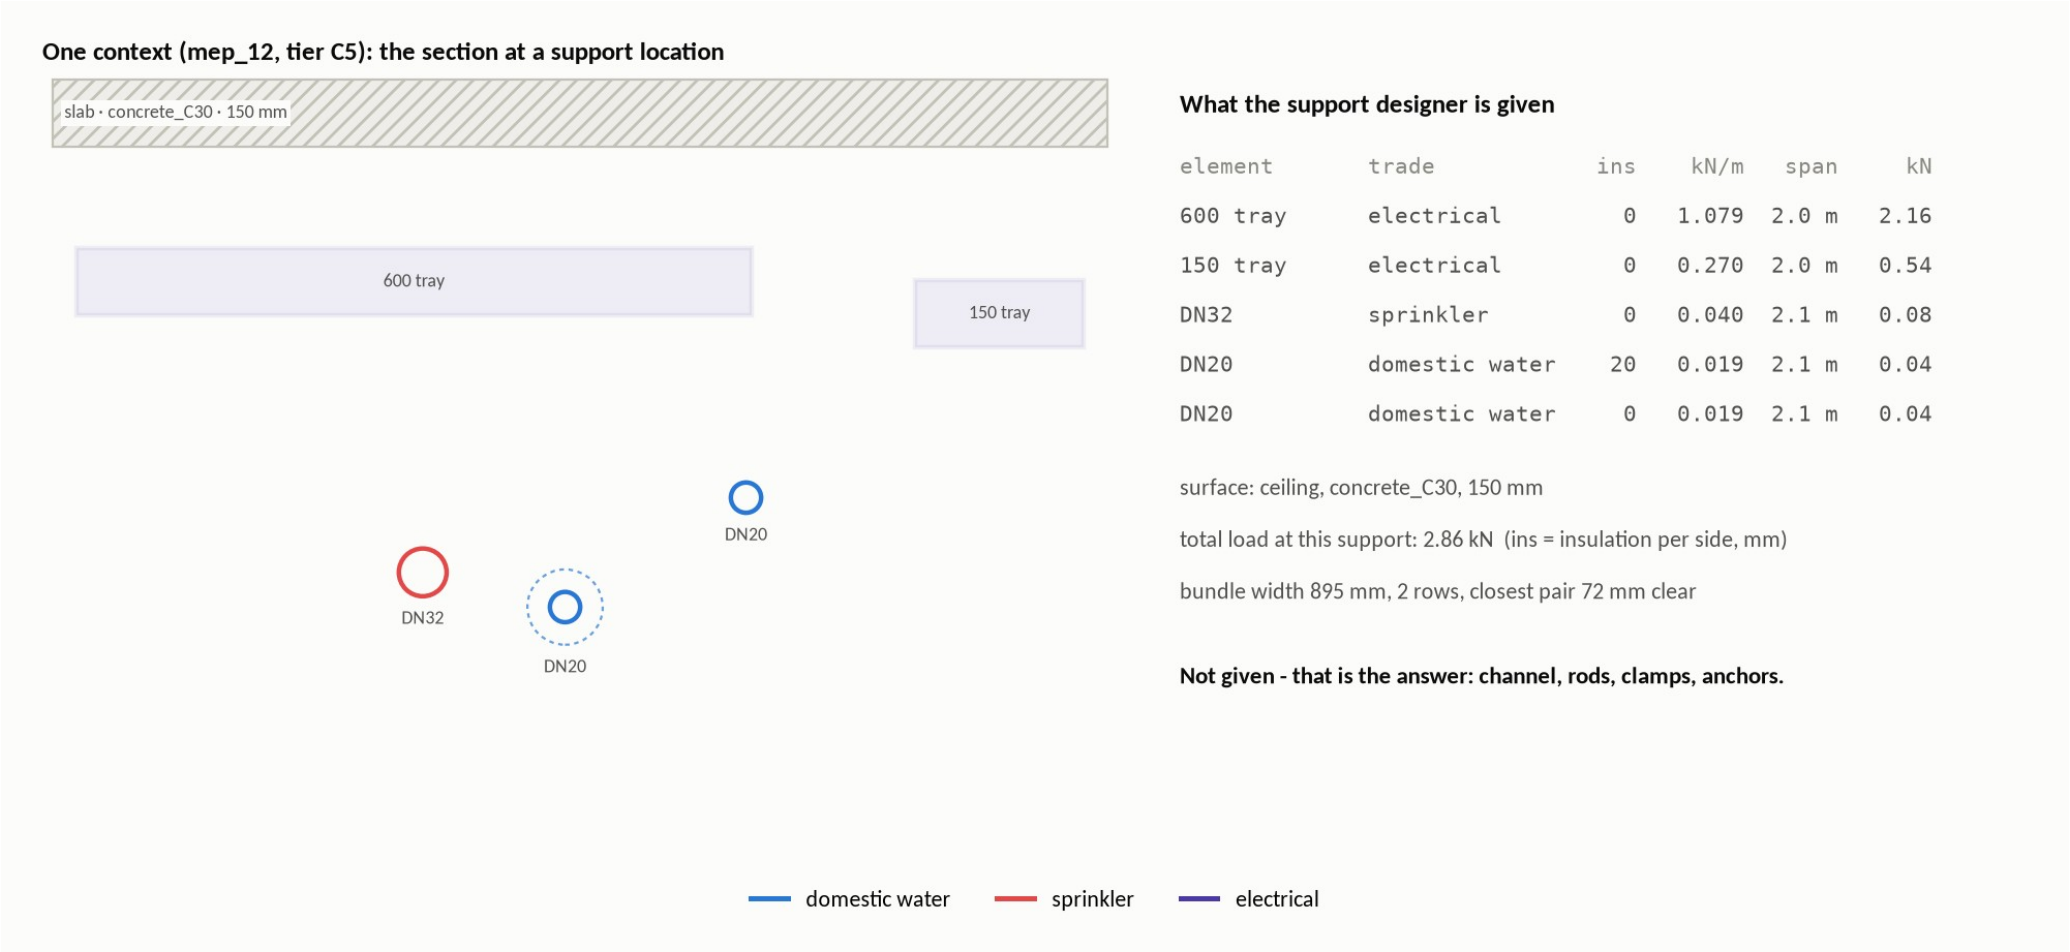

Per element: kind, service and trade · bare size · insulation per side · load per metre × the span it was sized at = load at the support · position along and out from the surface. Per context: slab or wall, substrate, thickness. Absent by design: channel, rods, clamps, anchors — and any “correct” answer, since a feasible support depends on the catalog you build from.

Sections follow trade practice and measured spacing, not random shapes

- 1 Tier.** Cn fixes the exact element count, $n = 1 \dots 8$.
- 2 Surface.** Ceiling or wall (78 / 22 %); concrete slab or wall, 150–300 mm thick.
- 3 Services.** Grouped as trades run [3]: hot + cold pairs, flow + return, chilled banks, sprinkler mains, 1–2 trays, ducts, conduit groups of 2–6.
- 4 Rows.** Bulky first: ducts nearest the surface, then trays and conduits, then pipes.
- 5 Spacing.** Gaps drawn from gaps measured on a built project [12] (at least 25 mm); stagger within rows; electrical above wet on walls [10].
- 6 Check.** Every pair at least 25 mm clear; rows centred; sizes, insulation, loads and positions recorded.

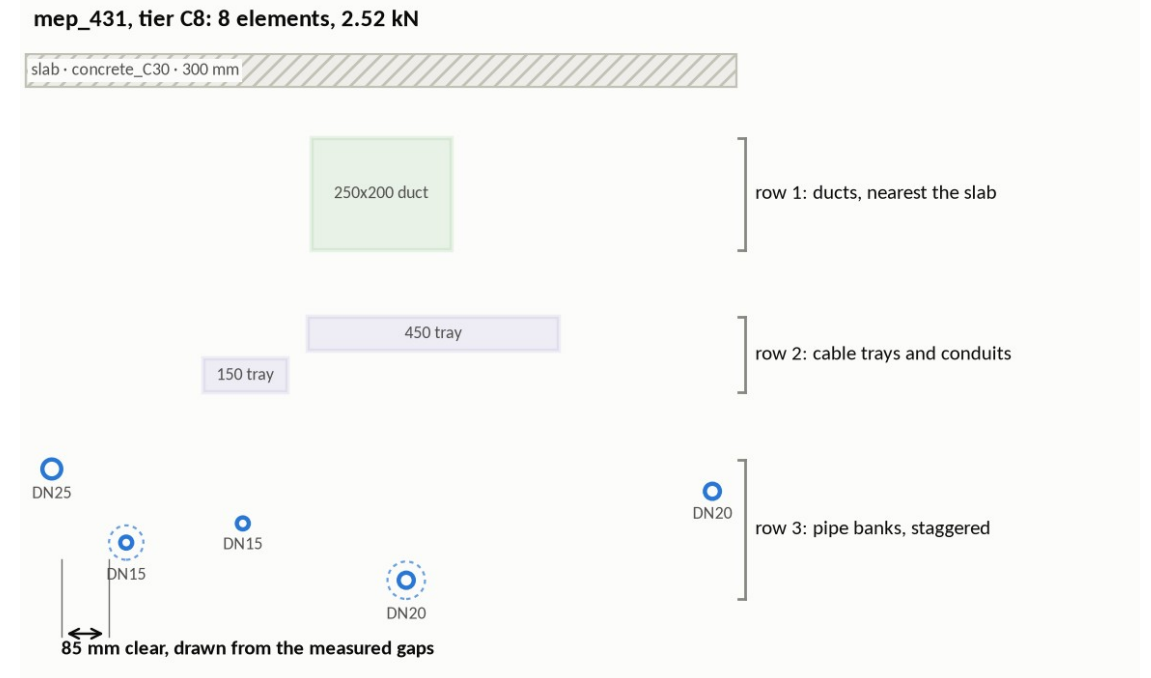

One generated benchmark context, three rows by priority; the gap marked is one draw from the measured distribution. Every context is seeded: the same seed gives the same file, byte for byte.

[3] Korman, Fischer & Tatum (2003), Knowledge and reasoning for MEP coordination, J. Constr. Eng. Manage. 129(6) [10] IET On-Site Guide (BS 7671), conduit support spacing; BS 7671 Reg. 528.3.2 [12] buildingSMART International (2020), Duplex Apartment and Medical-Dental Clinic sample IFC files, CC BY 4.0

Sizes, spans and loads come from standards; the choices are declared

Element	Sizes	Load basis
Pipes DN15–100	EN 10220 / EN 10255 medium series [4]	steel + water × ASME B31.1 water-service span (published points only) [8]
Insulation	GEG Anlage 8 (heated) [11]; 30/50 mm condensation control (chilled)	—
Cable trays 150–600	IEC 61537 systems [6], NEMA VE 1 widths [7]	full tray: 50 kg/m at 300 mm datum, × 2.0 m (NEMA VE 1 class span) [7]
Ducts	EN 1505 rectangular; EN 1506 round [5]	manufacturer duct-weight table incl. flanges, × 2.4 m (SMACNA) [9]
Conduits Ø20–50	IEC 61386-1 [6], parallel groups of 2–6	steel tube + 40 %-of-bore cable fill, × 2.0 m (IET / BS 7671) [10]

Layout conventions

- Bulky services nearest the slab: ducts, then containment, then pipes
- Trades run in banks: hot + cold pairs, flow + return, conduit groups
- Electrical kept above wet services on walls (drip; BS 7671 528.3.2) [10]
- Clear gaps drawn from a distribution measured on a built project [12]; 25 mm minimum
- Within-row stagger calibrated to measured elevation spread



Three kinds of ground: standards (what each element is and weighs), measured open buildings (how close neighbours sit) and declared design choices (trade mix, surface mix, number of rows). Every constant carries its source and status in the repository, and the log says why each standard was chosen over its alternatives.

[4] EN 10220:2002, EN 10255:2004 (steel tubes: dimensions, medium series) [5] EN 1505:1997, EN 1506:2007 (sheet-metal air ducts: rectangular and circular dimensions) [6] IEC 61386-1 (conduit systems), IEC 61537 (cable tray and ladder systems) [7] NEMA VE 1 (metal cable tray systems: widths, load-class spans) [8] ASME B31.1 Table 121.5 (hanger spacing), as republished in the ASHRAE Handbook, HVAC Systems and Equipment [9] SMACNA, HVAC Duct Construction Standards, Metal and Flexible, Table 5-1 [10] IET On-Site Guide (BS 7671), conduit support spacing; BS 7671 Reg. 528.3.2 [11] GEG (Gebäudeenergiegesetz), Anlage 8 (pipe insulation thickness) [12] buildingSMART International (2020), Duplex Apartment and Medical-Dental Clinic sample IFC files, CC BY 4.0


7,000 contexts in four splits; the test seeds are never trained on

split	contexts	elements	seed
train	5,000	22,500	1000
validation	500	2,242	2000
test	500	2,242	3000
benchmark	1,000	4,500	42
total	7,000	31,484	

- Tiers assigned round-robin: 625 per tier in train, 125 in the benchmark
- Four in five contexts hang from a ceiling, one in five from a wall
- Six trades: electrical 10,494, domestic water 5,725, heating 5,788, chilled water 3,987, sprinkler 2,073, ventilation 3,417 elements
- Plain JSON, with a JSON Schema, Croissant metadata and a datasheet

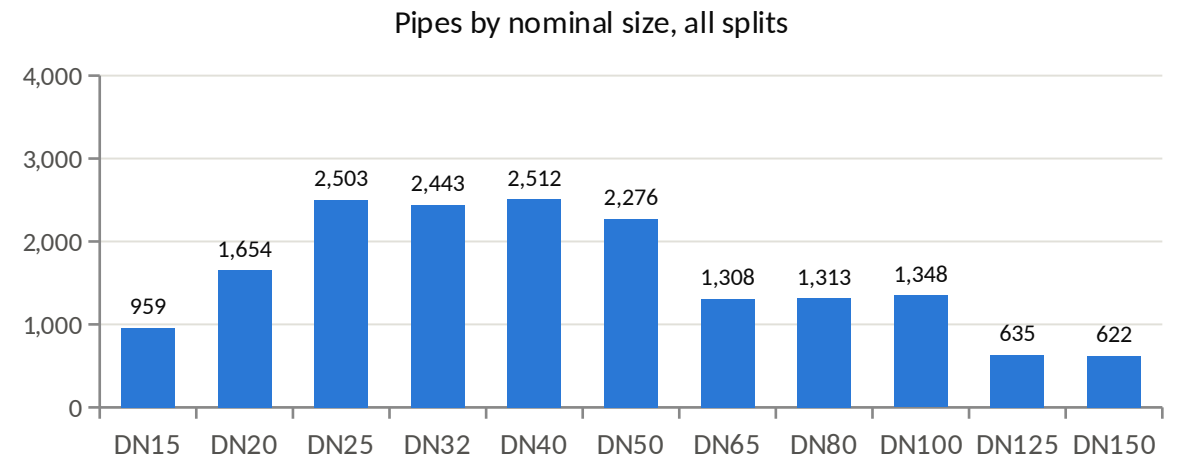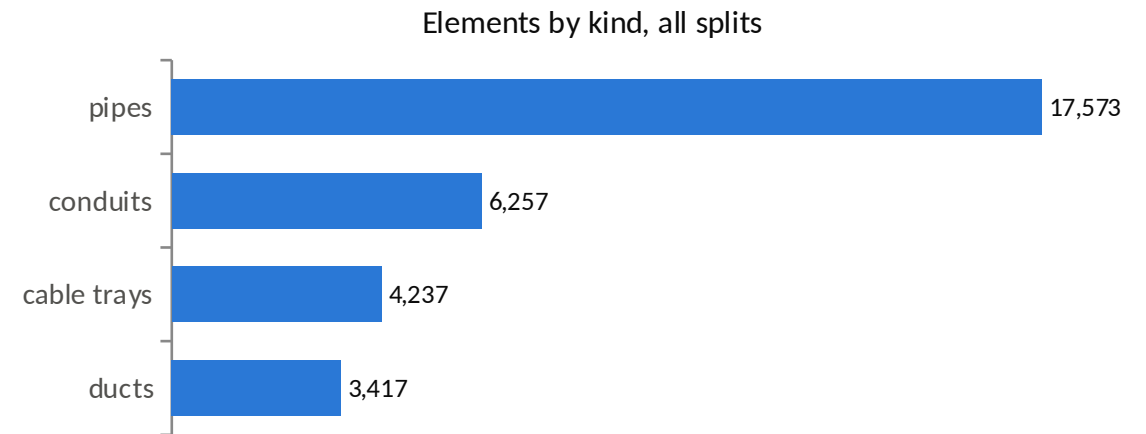


Difficulty is one number: tier Cn holds exactly n elements

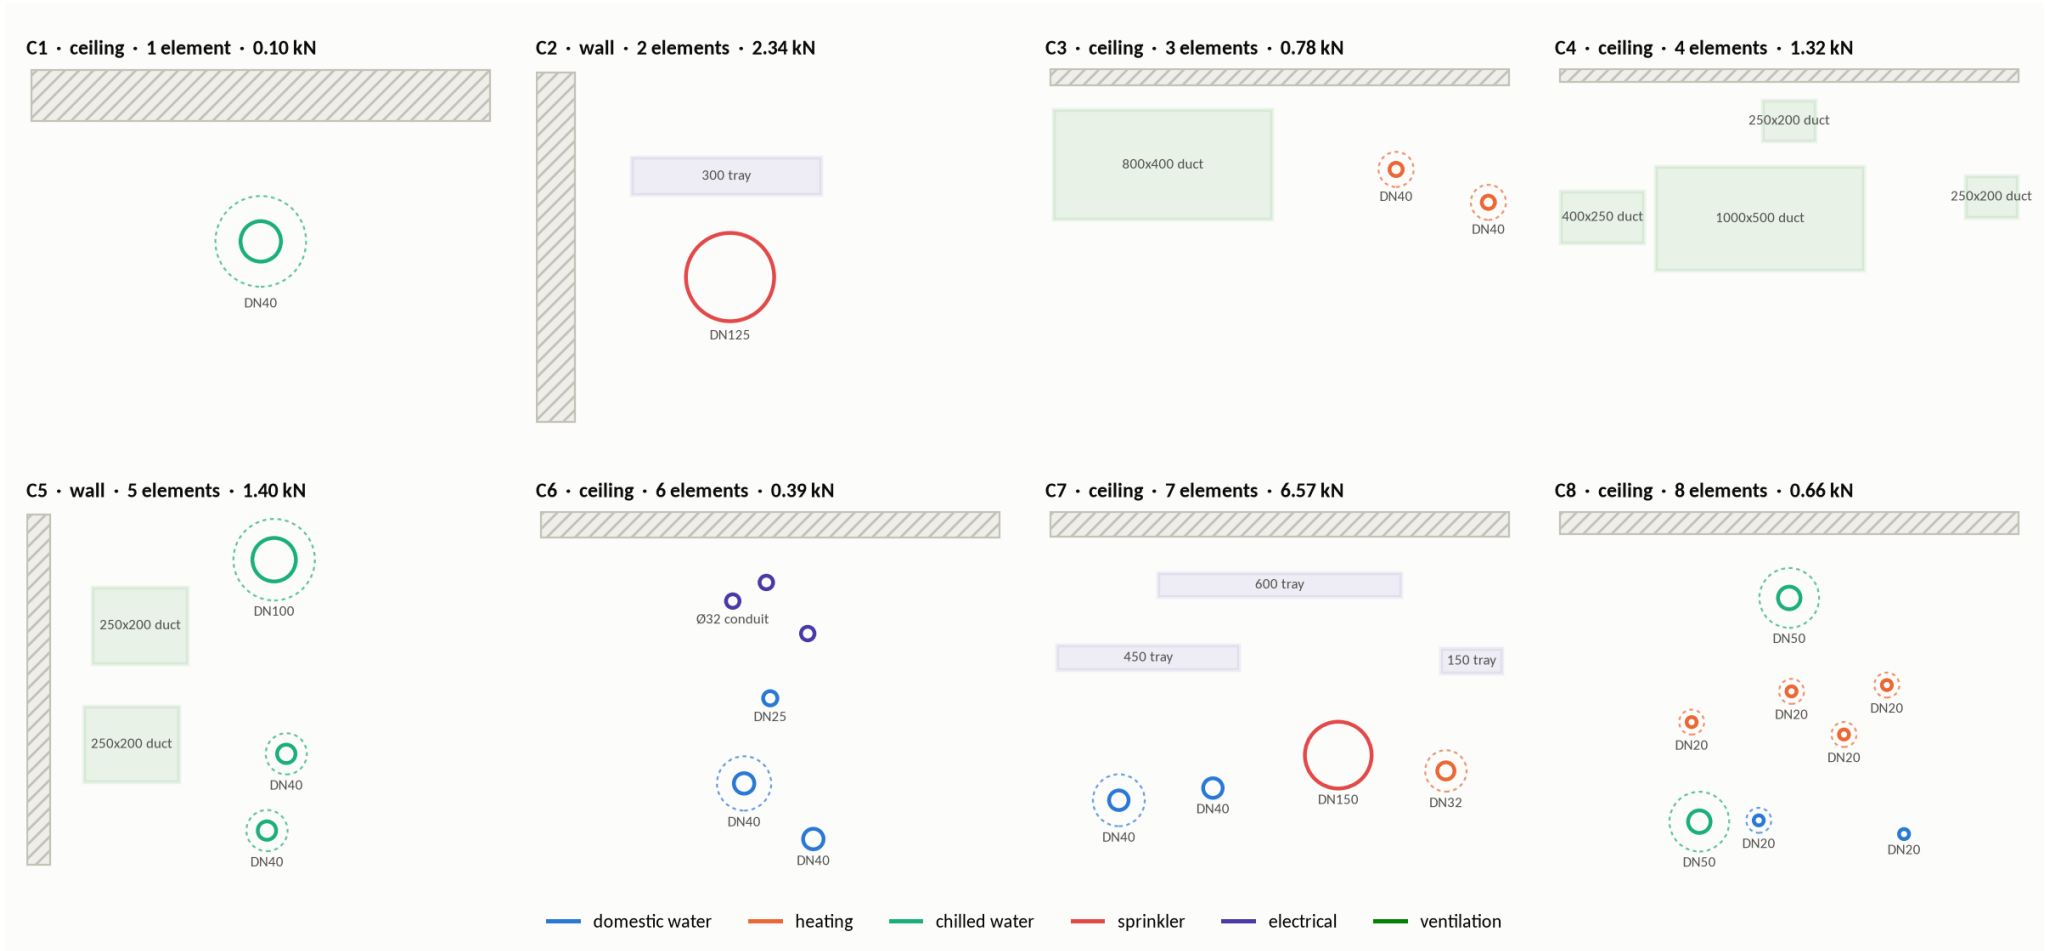


One benchmark context per tier; dashed rings are insulation. Within a tier, kinds, trades, services, surfaces and stacking all vary, so element count is the one controlled difficulty axis. C1 is the most common support in any building; C8 is a congested rack.

Higher tiers are heavier and tighter, as designed

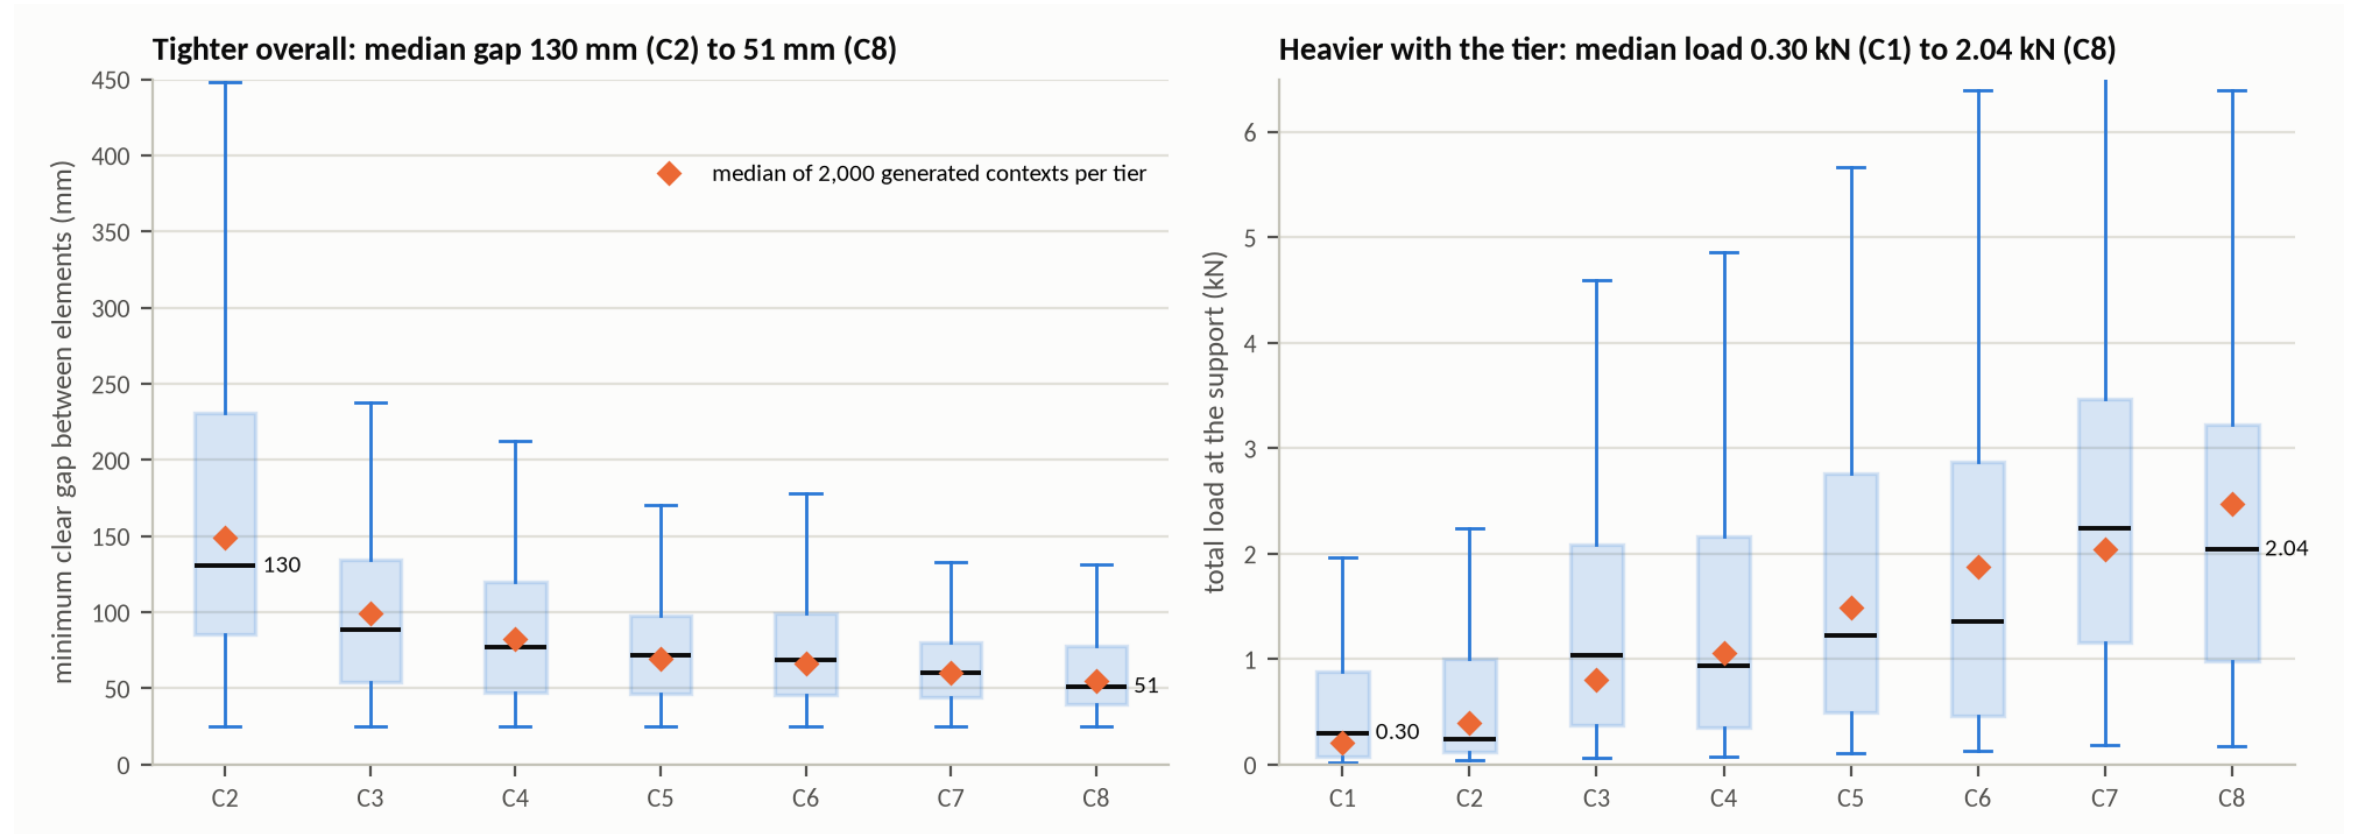

A check that the dataset behaves as designed: the tier fixes the element count; load and congestion follow from the rules. Boxes: benchmark, 125 contexts per tier (IQR, whiskers 1.5 IQR); diamonds: medians of 2,000 generated contexts per tier. Load rises with the tier (rank correlation +0.46; the population medians rise at every step) and the closest gap narrows at every step (-0.38; 149 → 55 mm in the population).



Spacing holds up on a clinic the generator never saw

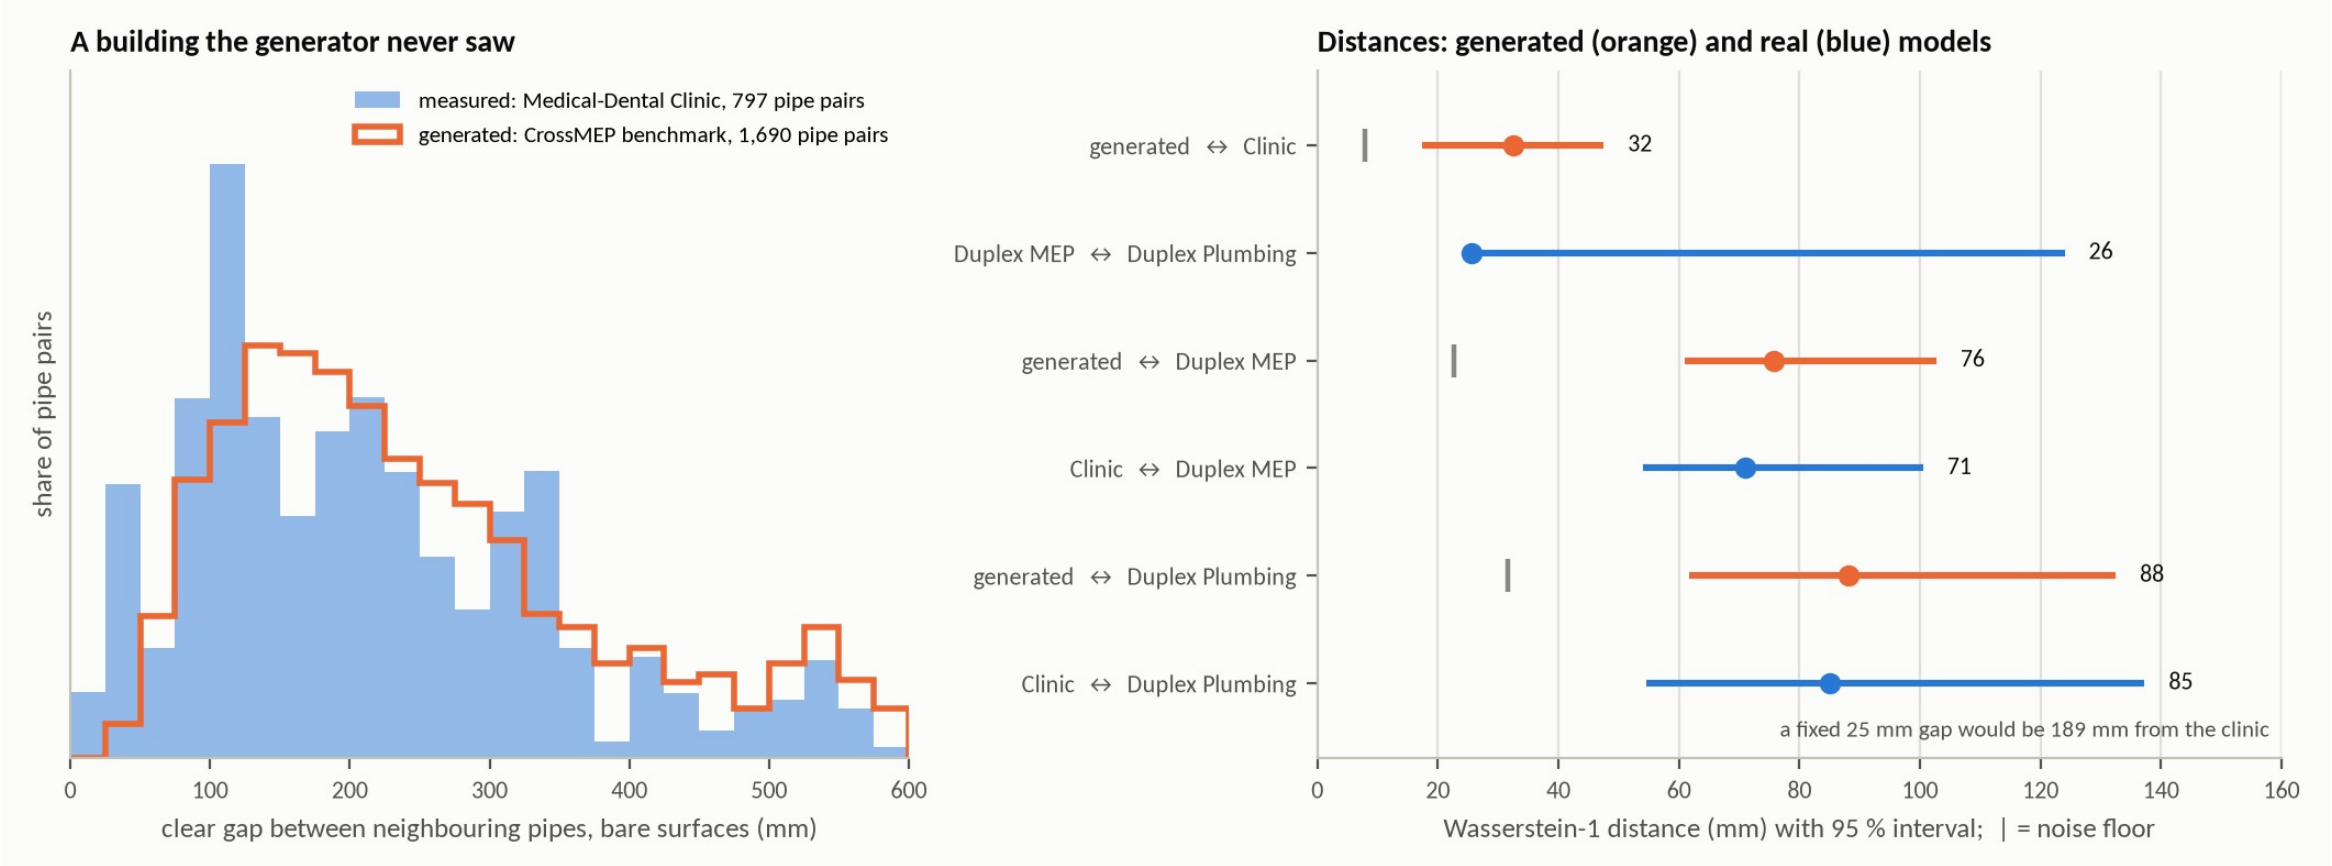

The gap distribution was fitted on the duplex; the clinic was held out. Clear gaps between side-by-side pipes, on sections every 250 mm. Clinic (797 pipe pairs): 32 mm from the generated gaps (95 % CI 17–48), more than the 8 mm a perfect generator would show, and about as close as the duplex’s own two models are to each other (26 mm). Models: buildingSMART Duplex Apartment and Medical-Dental Clinic [12].

[12] buildingSMART International (2020), Duplex Apartment and Medical-Dental Clinic sample IFC files, CC BY 4.0
CrossMEP · CIB W78 2026, New Delhi

A two-size catalog attaches 1 pipe in 7; the dataset shows what to cover

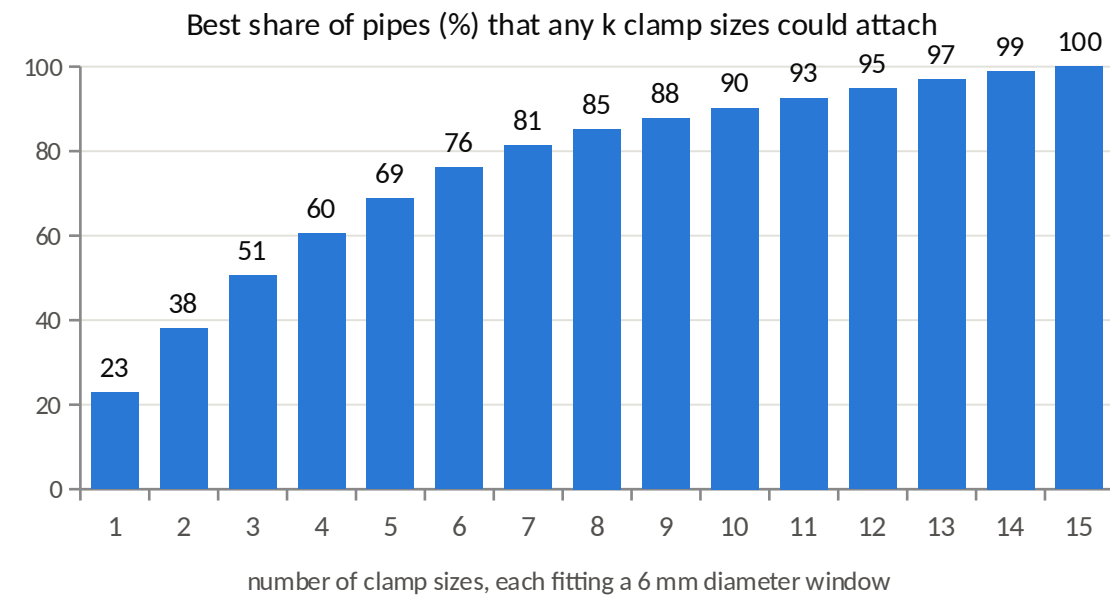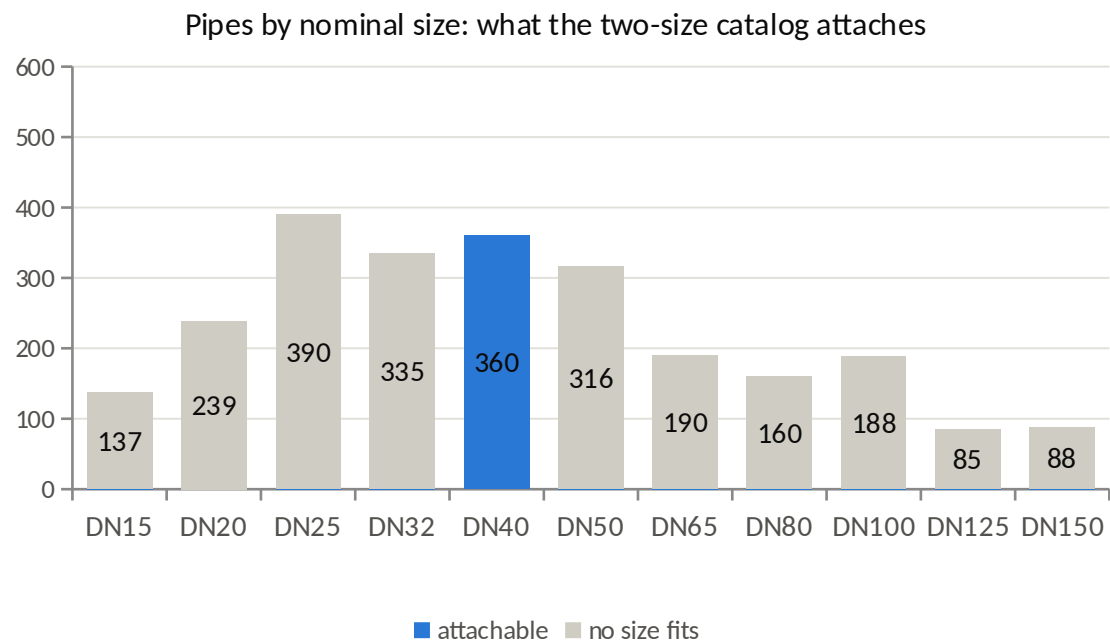

14.5 %

of benchmark pipes attachable with the paper's two sizes [2] (95 % CI 12.7–16.2); every one is DN40

38.1 %

with two sizes placed where the pipes are; 76 % with six, and every pipe with 15

0 of 2,012

trays, ducts and conduits: a pipe-clamp catalog defines no attachment. Load never binds (1.97 vs 2.5 kN)

[2] Pedrollo, Gvazdabia, Graeber & Fischer (2026), CrossMEP, CIB W78 2026 (this paper)

Set the parameters and the generator returns the designer's brief

SERVICES AT THE HANGER

TIER = NUMBER OF SERVICES



SEED

By tier Exact mix

C1 C2 C3 C4 C5 C6 C7 C8

< 0 >

Generate another

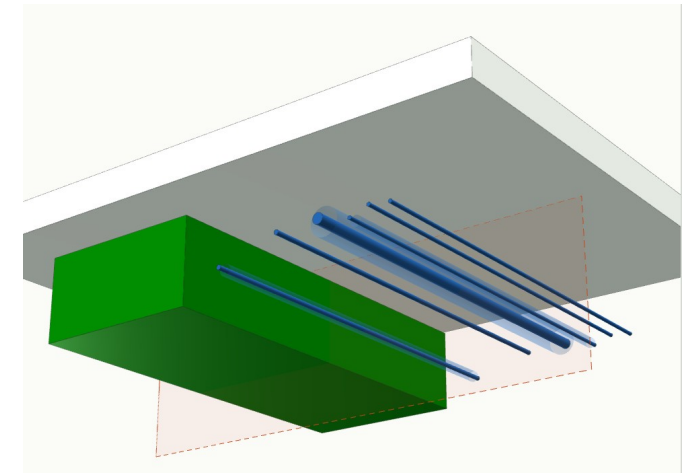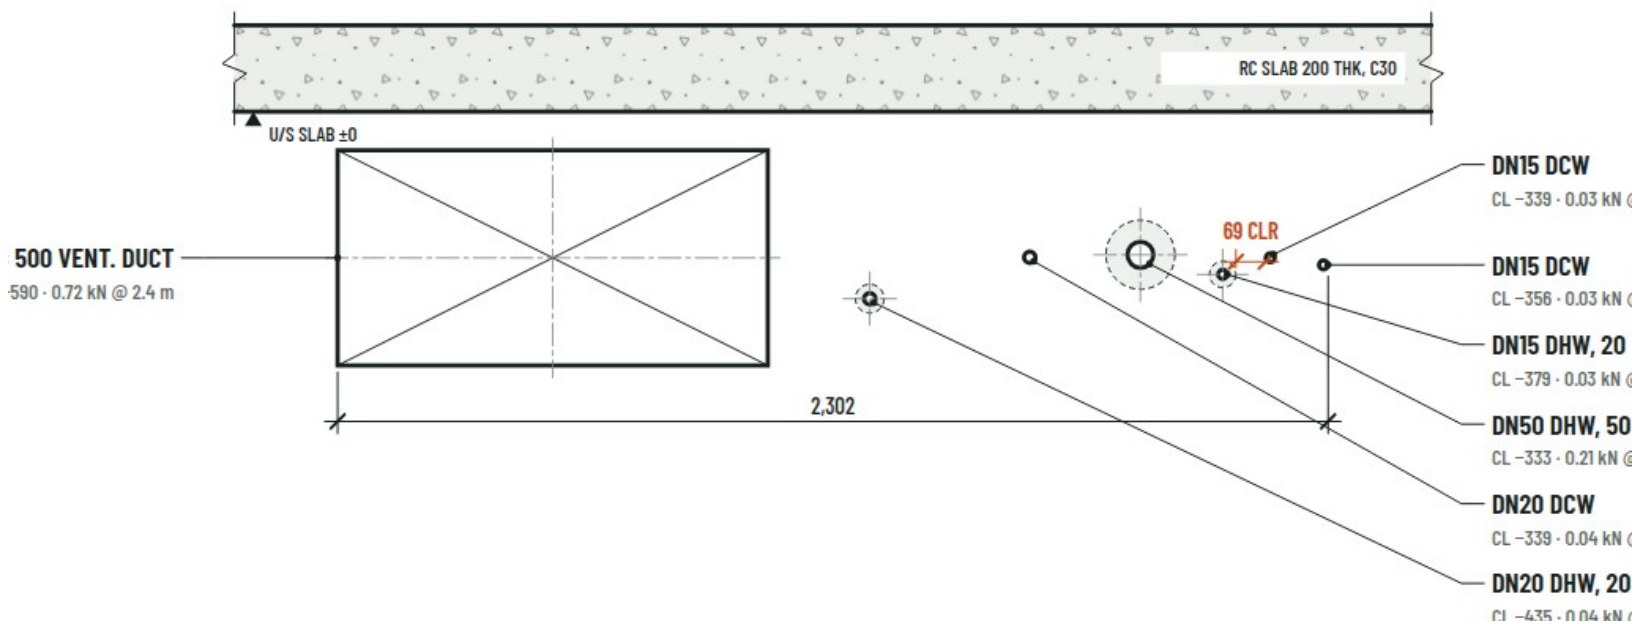

Scan to open the studio


In: the parameters (tier C7, seed 0). Out: section A-A at the support, as the support designer receives it (scale 1:20), and the same run in 3D. Every section is a stored output of the released generator, with the Python call that reproduces it.

Train on the generator, evaluate on the benchmark, report per tier

```
import crossmep.tasks as cm
data = cm.load("benchmark") # 1,000 contexts
cm.filter_contexts(data, pipes=2, trays=1)

from crossmep.evaluate import score, compare
score(my_results, data) # per tier, 95 % CI
compare(mine, baseline, data) # paired test
```

Loading, metrics and scoring need only the Python standard library; the generator needs NumPy. Command line: `python -m crossmep generate | validate | evaluate`.

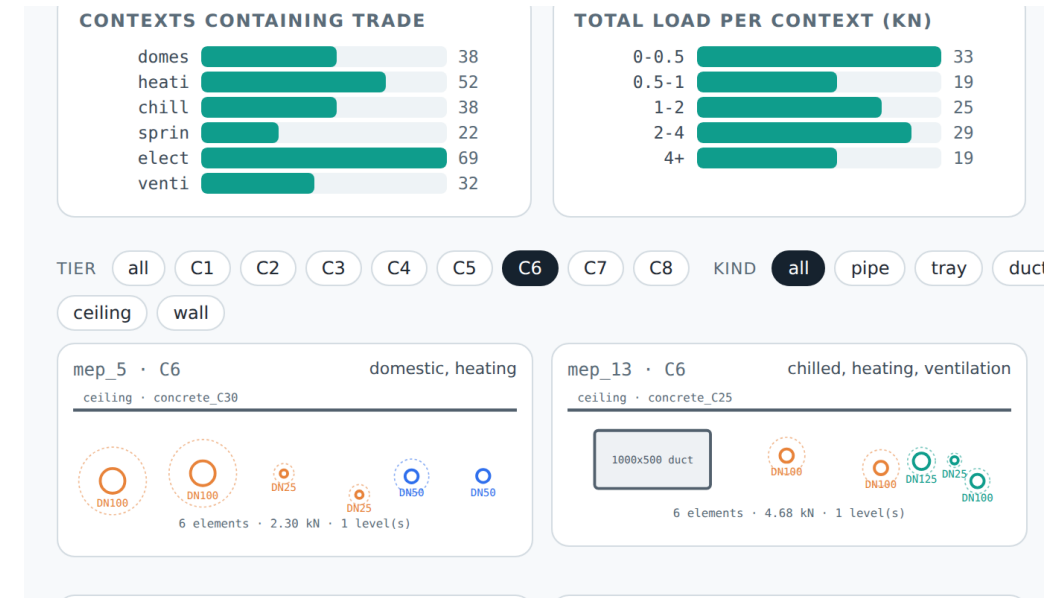

Interactive gallery: filter the benchmark by tier, kind, trade and surface.

Train

on the generator: unlimited seeds, a curriculum from C1 up to C8

Evaluate

on the benchmark: 125 held-out contexts per tier, the same for every method

Report

per tier with 95 % intervals, paired tests between methods

One section at one support today; a checker and real data come next

Scope

- One cross-section at one support: routing, branches and elevation changes are outside it; so is support spacing — the span is recorded per element, so a method can vary it
- Realism checked on sections of two open buildings, a residential duplex and a medical clinic; congested racks rest on coordination practice and standards
- Trade mix and tier composition are design choices, not survey results
- Synthetic: not for the structural design of real installations

Next

- A public checker for support designs, with best-known costs from an exact solver on the small tiers
- The catalog as an input: generated catalogs, and tests on catalogs a method has never seen
- A real test set: sections from commercial projects with supports designed by engineers

If you coordinate services or design supports, open the gallery, filter for the scenes you know, and tell us what looks wrong. Every rule is one documented constant away from being changed.



Support design now has open problems to learn from

7,000 support-design problems · every constant sourced or declared
pipe gaps checked on two open buildings · open data and code

Data CC BY 4.0, code MIT. Not for the structural design of real installations.



github.com/lavinia-ped/CrossMEP_Dataset
lavinia@stanford.edu