


CrossMEP: A Tiered Synthetic Dataset of Multi-Trade MEP Cross-Sections

A support-design problem distribution for learning-based structural support assembly synthesis

Lavinia Pedrollo¹ • David Gvazabia² • Torben Graeber³ • Martin Fischer¹

¹ Stanford University, CIFE ² Lafayette College ³ Hilti AG

43rd International CIB W78 Conference • IT in Construction • New Delhi, 6–8 October 2026

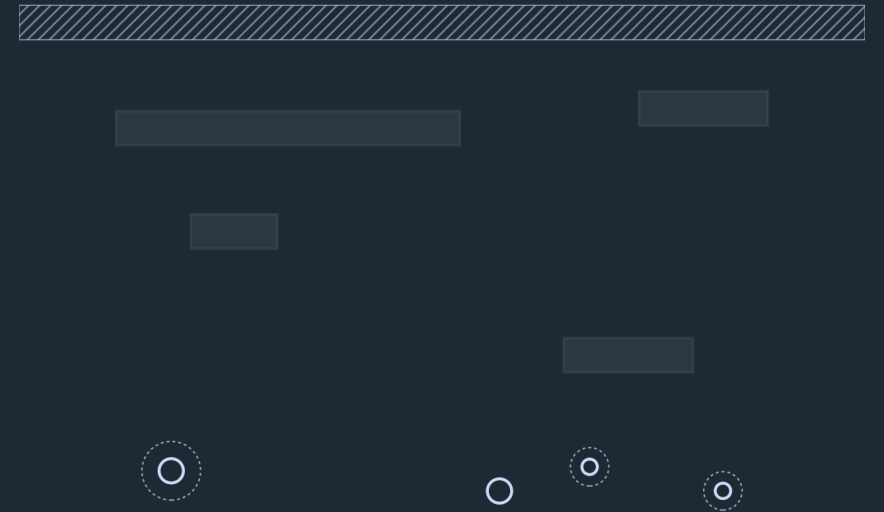

a generated C8 context: eight services on three rows

Every pipe, duct and tray hangs from a support designed by hand

≈ 10,000


support assemblies in one 200,000 sq ft hospital

20 min – 2 h


to design each one by hand, from the coordinated model

≈ 1/4

of all MEP design effort; on the order of \$600K of engineering per project

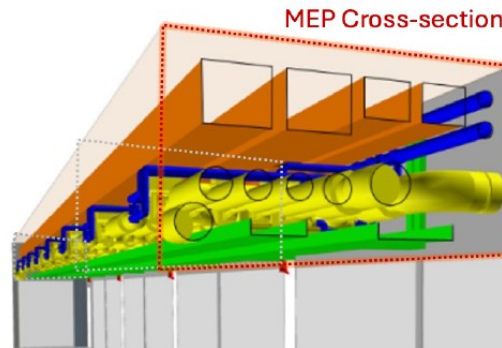

(a) Full MEP route

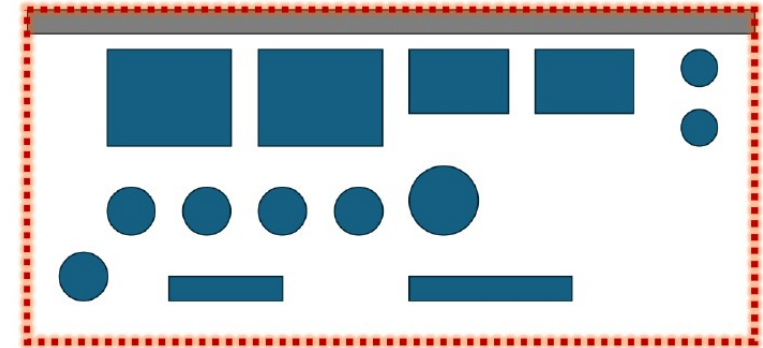

(b) One CrossMEP context

Support design starts after coordination. At each hanger location the designer works from the section across the run: what passes, how big, how heavy, how far apart, what it hangs from.

Nobody designs a support from the whole model; it is designed from the section at that hanger.

That section is the unit of work — and the unit of CrossMEP.

Approximate practitioner estimates.

There was no public dataset of support-design problems

Why it has to be synthetic



Scarcity

Project models are proprietary; the few open ones are not organised around supports and often export no element sizes.



Coverage

One project is one narrow slice: one building type, one trade mix. A method tuned to it measures fit to that project.



Control

A seeded generator gives unlimited problems with a known distribution, difficulty by construction and held-out seeds.

CrossMEP at a glance

7,000

contexts in four splits
on disjoint seeds

31,484

elements: pipes, cable
trays, ducts and
conduits; six trades

C1–C8

eight difficulty tiers by
exact element count

0 labels

the brief, not the
answer: no support-
assembly information

Traced


every constant from a
standard, a
manufacturer table or a
measurement

Open

data CC BY 4.0, code
MIT; a seeded,
deterministic generator

A context is the section at one hanger: the brief, not the answer

One context (mep_228, tier C5): the section at a support location

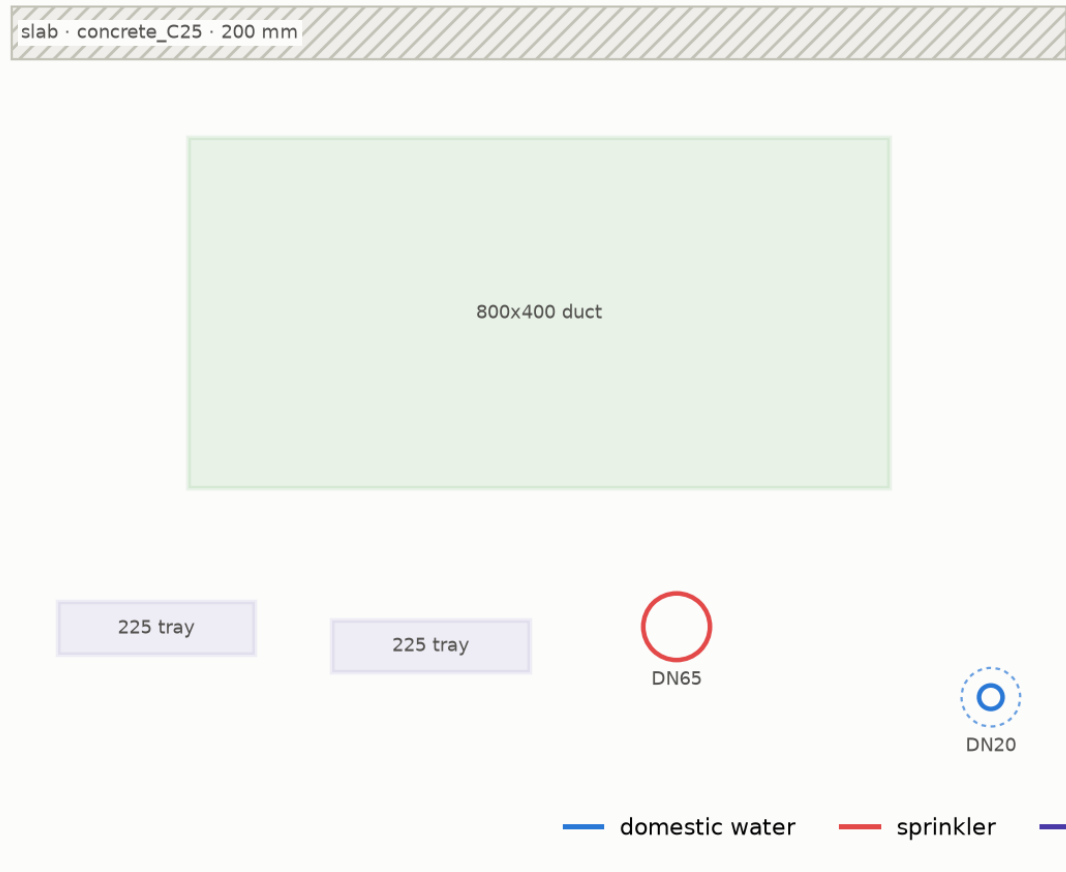

What the support designer is given

element	trade	ins	kN/m	span	kN
800x400 duct	ventilation	0	0.240	2.4 m	0.58
225 tray	electrical	0	0.405	2.0 m	0.81
225 tray	electrical	0	0.405	2.0 m	0.81
DN65	sprinkler	0	0.100	3.0 m	0.30
DN20	domestic water	20	0.019	2.1 m	0.04

surface: ceiling, concrete_C25, 200 mm

total load at this support: 2.54 kN (ins = insulation per side, mm)

bundle width 1099 mm, 2 rows, closest pair 88 mm clear


Not given - that is the answer: channel, rods, clamps, anchors.

Per element: kind, service and trade · bare size · insulation per side · load per metre × the span it was sized at = load at the support · position along and out from the surface. Per context: slab or wall, substrate, thickness. Absent by design: channel, rods, clamps, anchors — and any “correct” answer, since a feasible support depends on the catalog you build from.

How a context is generated: rules, not free randomness

- 1 **Tier.** Cn fixes the exact element count, $n = 1 \dots 8$.
- 2 **Surface.** Ceiling or wall (78 / 22 %); concrete slab or wall, 150–300 mm thick.
- 3 **Services.** Grouped as trades run: hot + cold pairs, flow + return, chilled banks, sprinkler mains, 1–2 trays, ducts, conduit groups of 2–6.
- 4 **Rows.** Bulky first: ducts nearest the surface, then trays and conduits, then pipes.
- 5 **Spacing.** Gaps drawn from gaps measured on a built project (at least 25 mm); stagger within rows; electrical above wet on walls.
- 6 **Check.** Every pair at least 25 mm clear; rows centred; sizes, insulation, loads and positions recorded.

mep_150, tier C7: 7 elements, 3.92 kN

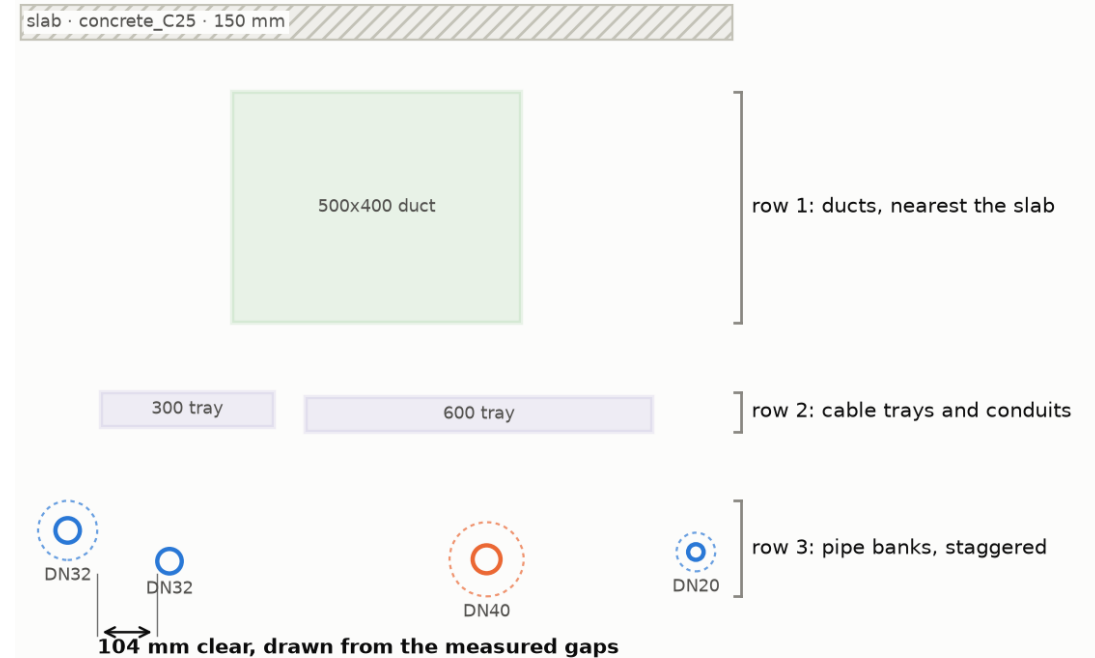

One generated benchmark context, three rows by priority; the gap marked is one draw from the measured distribution. Every context is seeded: the same seed gives the same file, byte for byte.

Every number has a source, and every load is computed from it

Element	Sizes	Load basis
Pipes DN15–100	EN 10220 / EN 10255 medium series	steel + water × ASME B31.1 water-service span (published points only)
Insulation	GEG Anlage 8 (heated); 30/50 mm condensation control (chilled)	—
Cable trays 150–600	IEC 61537 systems	full tray: 50 kg/m at 300 mm datum, × 2.0 m
Ducts	EN 1505 rectangular; EN 1506 round	manufacturer duct-weight table incl. flanges, × 2.4 m
Conduits Ø20–50	IEC 61386-1, parallel groups of 2–6	steel tube + 40 %-of-bore cable fill, × 2.0 m

Layout conventions



- Bulky services nearest the slab: ducts, then containment, then pipes
- Trades run in banks: hot + cold pairs, flow + return, conduit groups
- Electrical kept above wet services on walls (drip)
- Clear gaps drawn from a distribution measured on a built project; 25 mm minimum
- Within-row stagger calibrated to measured elevation spread

Every constant carries a source and a status (verified, practice-cited, or a declared design choice) in the repository. Loads are derived in code from those sources, so each number can be traced and checked.


The release: 7,000 contexts in four splits on disjoint seeds

split	contexts	elements	seed
train	5,000	22,500	1000
validation	500	2,242	2000
test	500	2,242	3000
benchmark	1,000	4,500	42
total	7,000	31,484	

- Tiers assigned round-robin: 625 per tier in train, 125 in the benchmark
- Four in five contexts hang from a ceiling, one in five from a wall
- Six trades: electrical 11,592, domestic water 5,889, heating 5,766, chilled water 4,129, sprinkler 2,200, ventilation 1,908 elements
- Plain JSON, with a JSON Schema, Croissant metadata and a datasheet

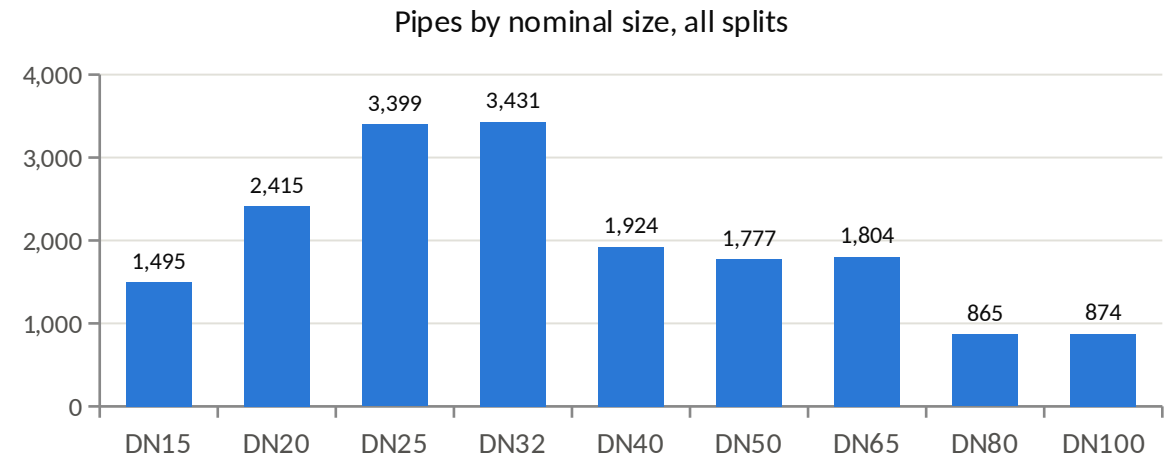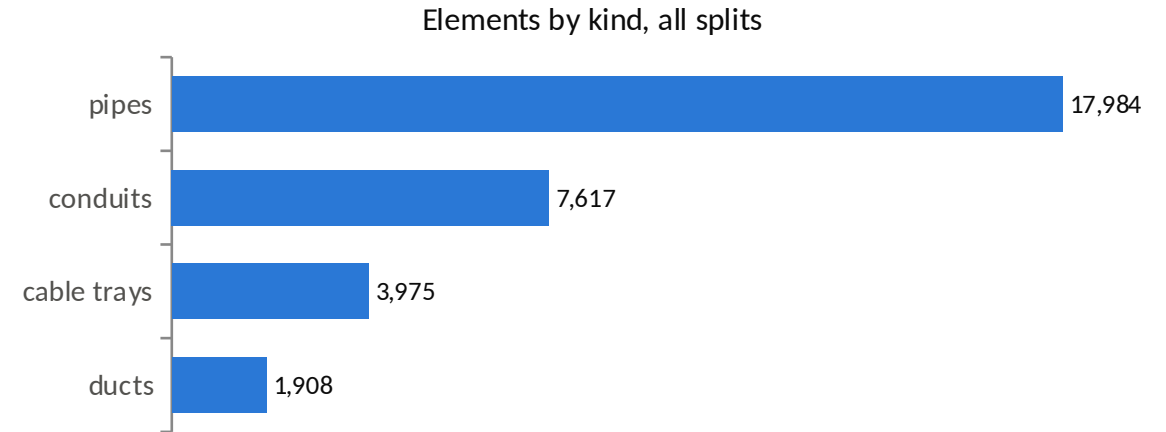


Eight difficulty tiers: tier Cn holds exactly n elements

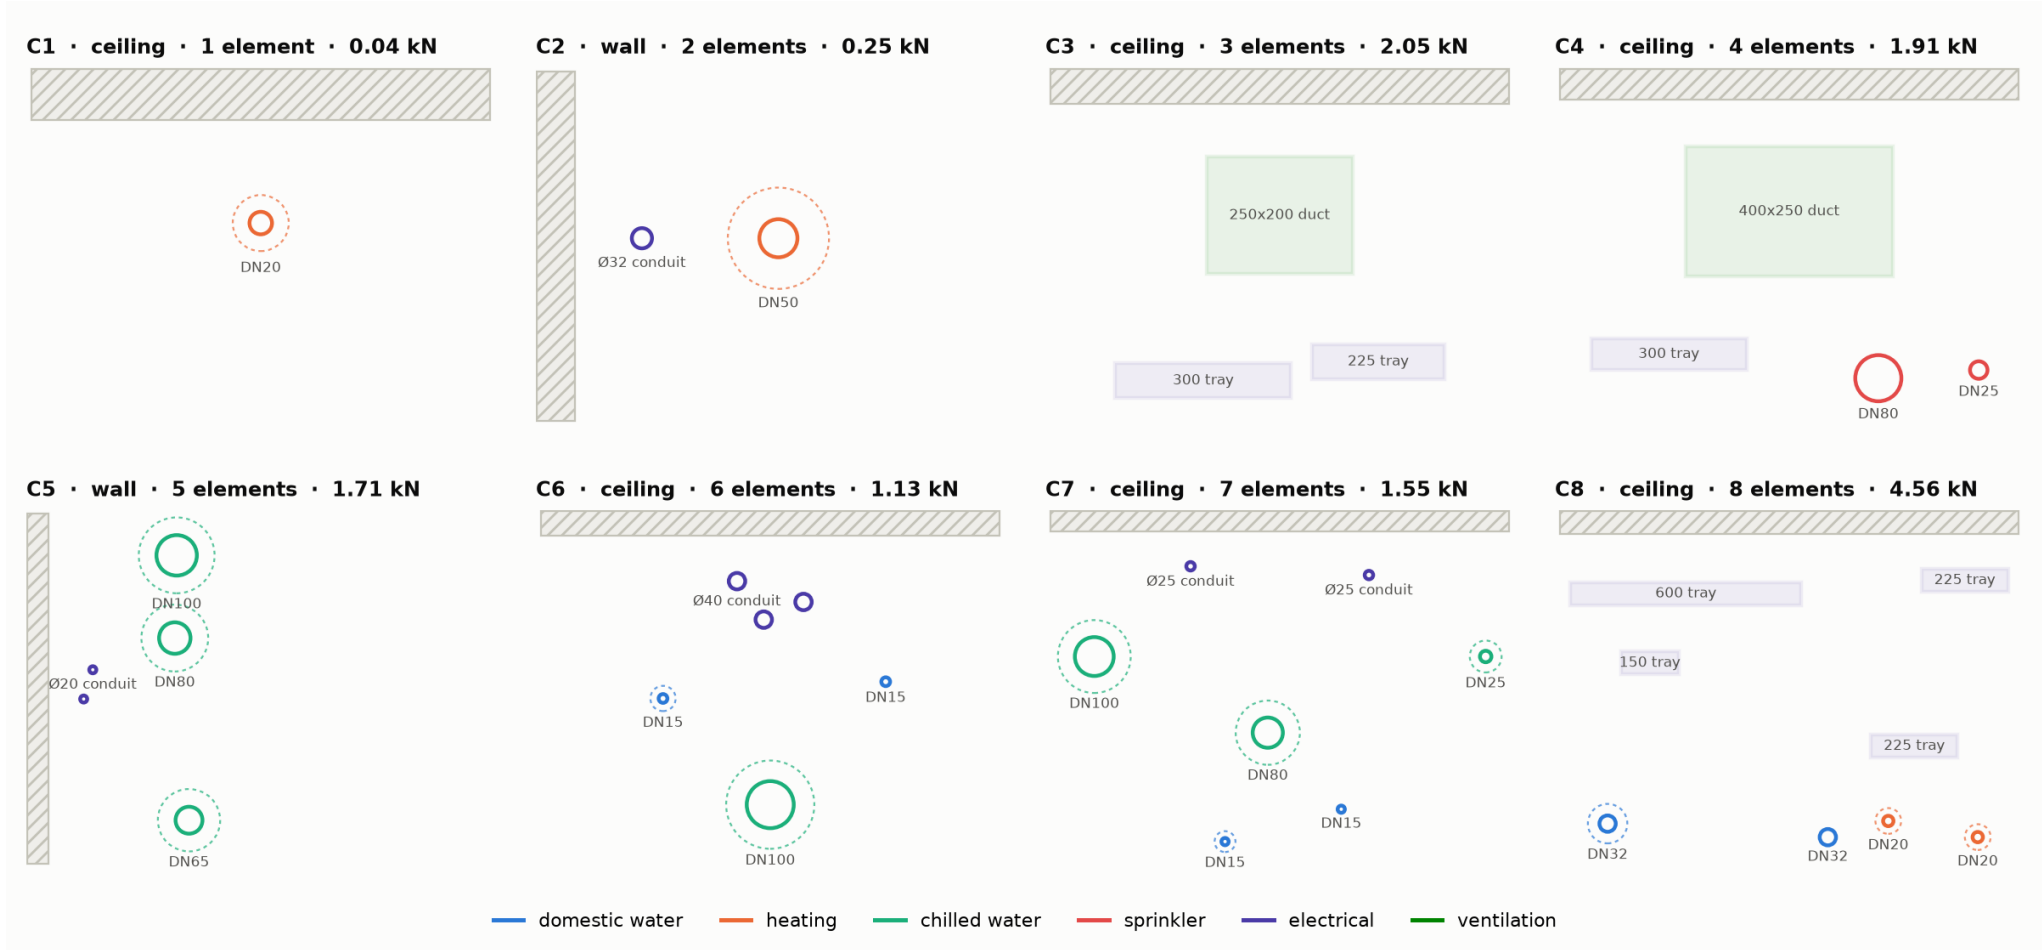


One benchmark context per tier; dashed rings are insulation. Within a tier, kinds, trades, services, surfaces and stacking all vary, so element count is the one controlled difficulty axis. C1 is the most common support in any building; C8 is a congested rack.

Experiment 1: as the count rises, scenes get tighter and heavier

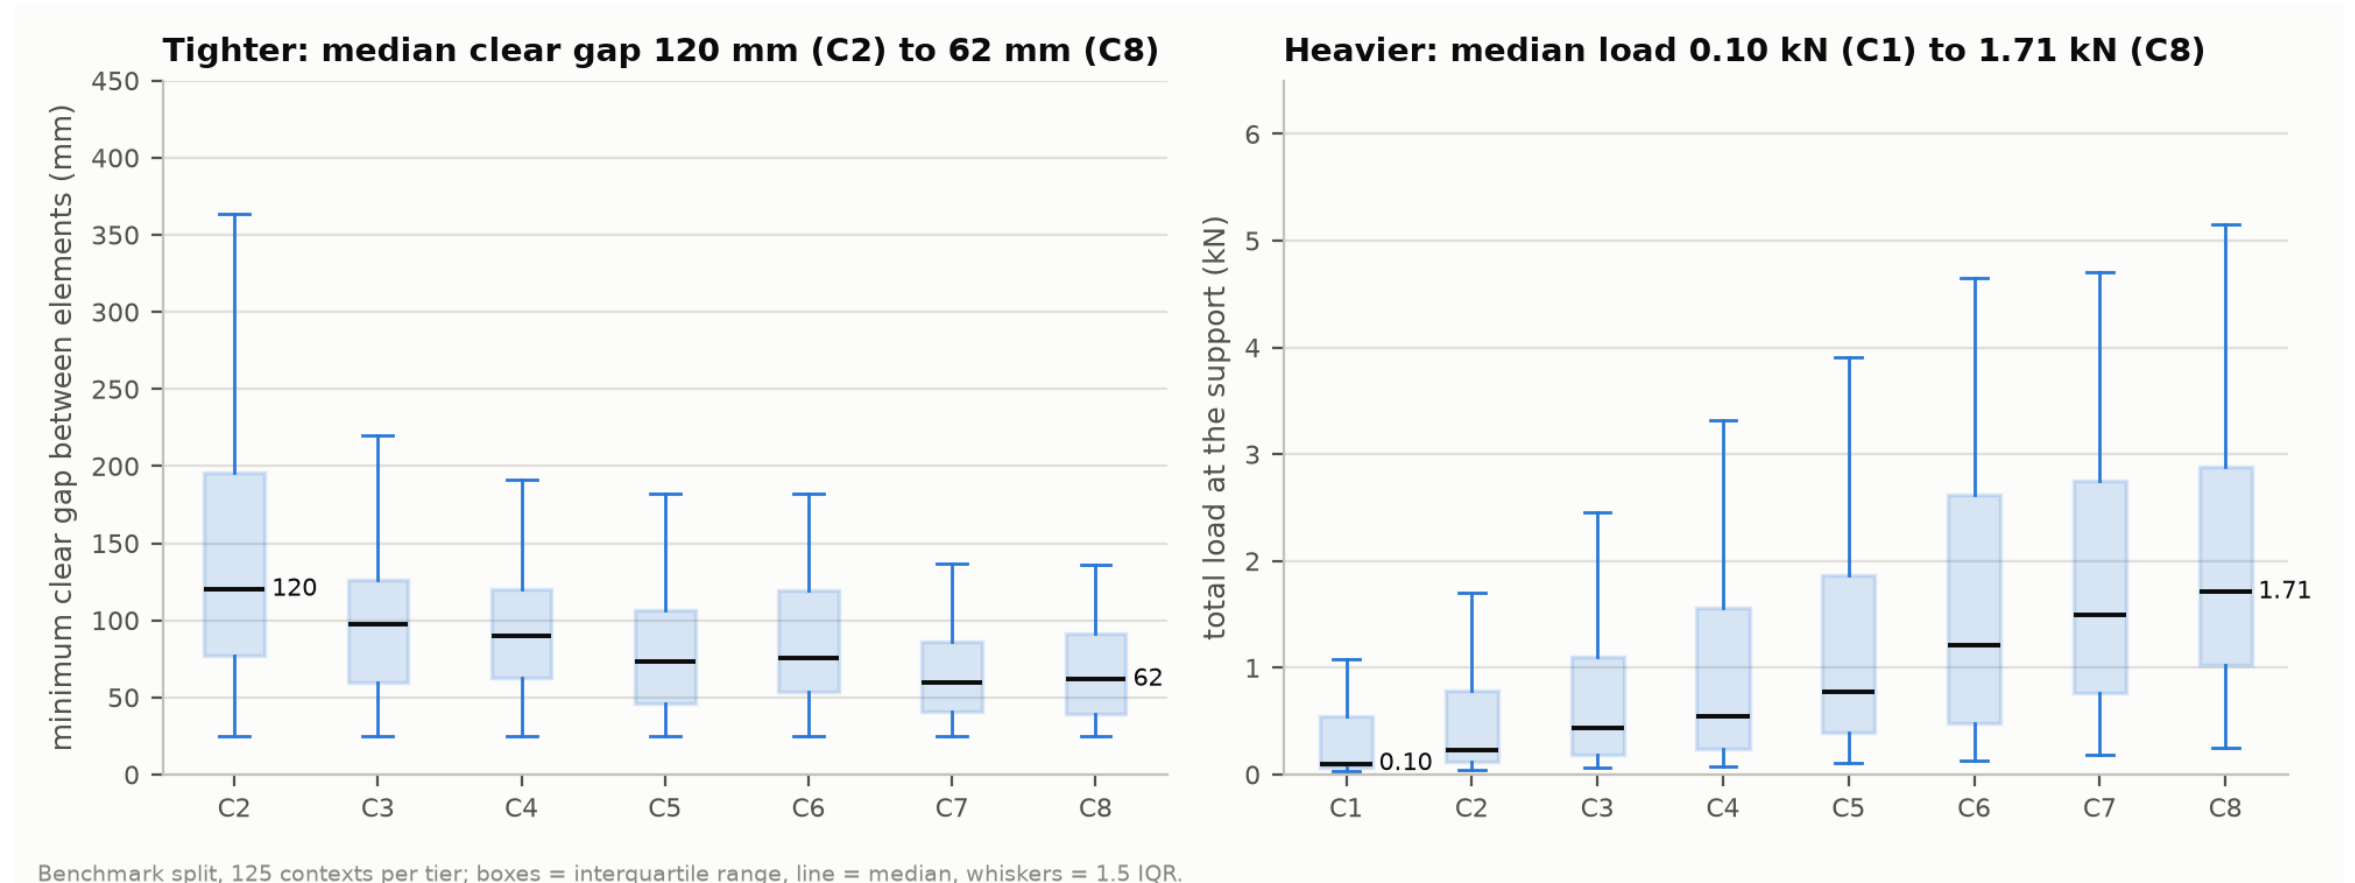


Element count is exact by construction, so ordering is checked on congestion: the median closest gap falls from 120 mm (C2) to 62 mm (C8) and the median load at the support rises from 0.10 to 1.71 kN. The trends are near-monotone; with 125 contexts per tier, neighbouring tiers can swap.

Experiment 2: generated spacing follows a built project

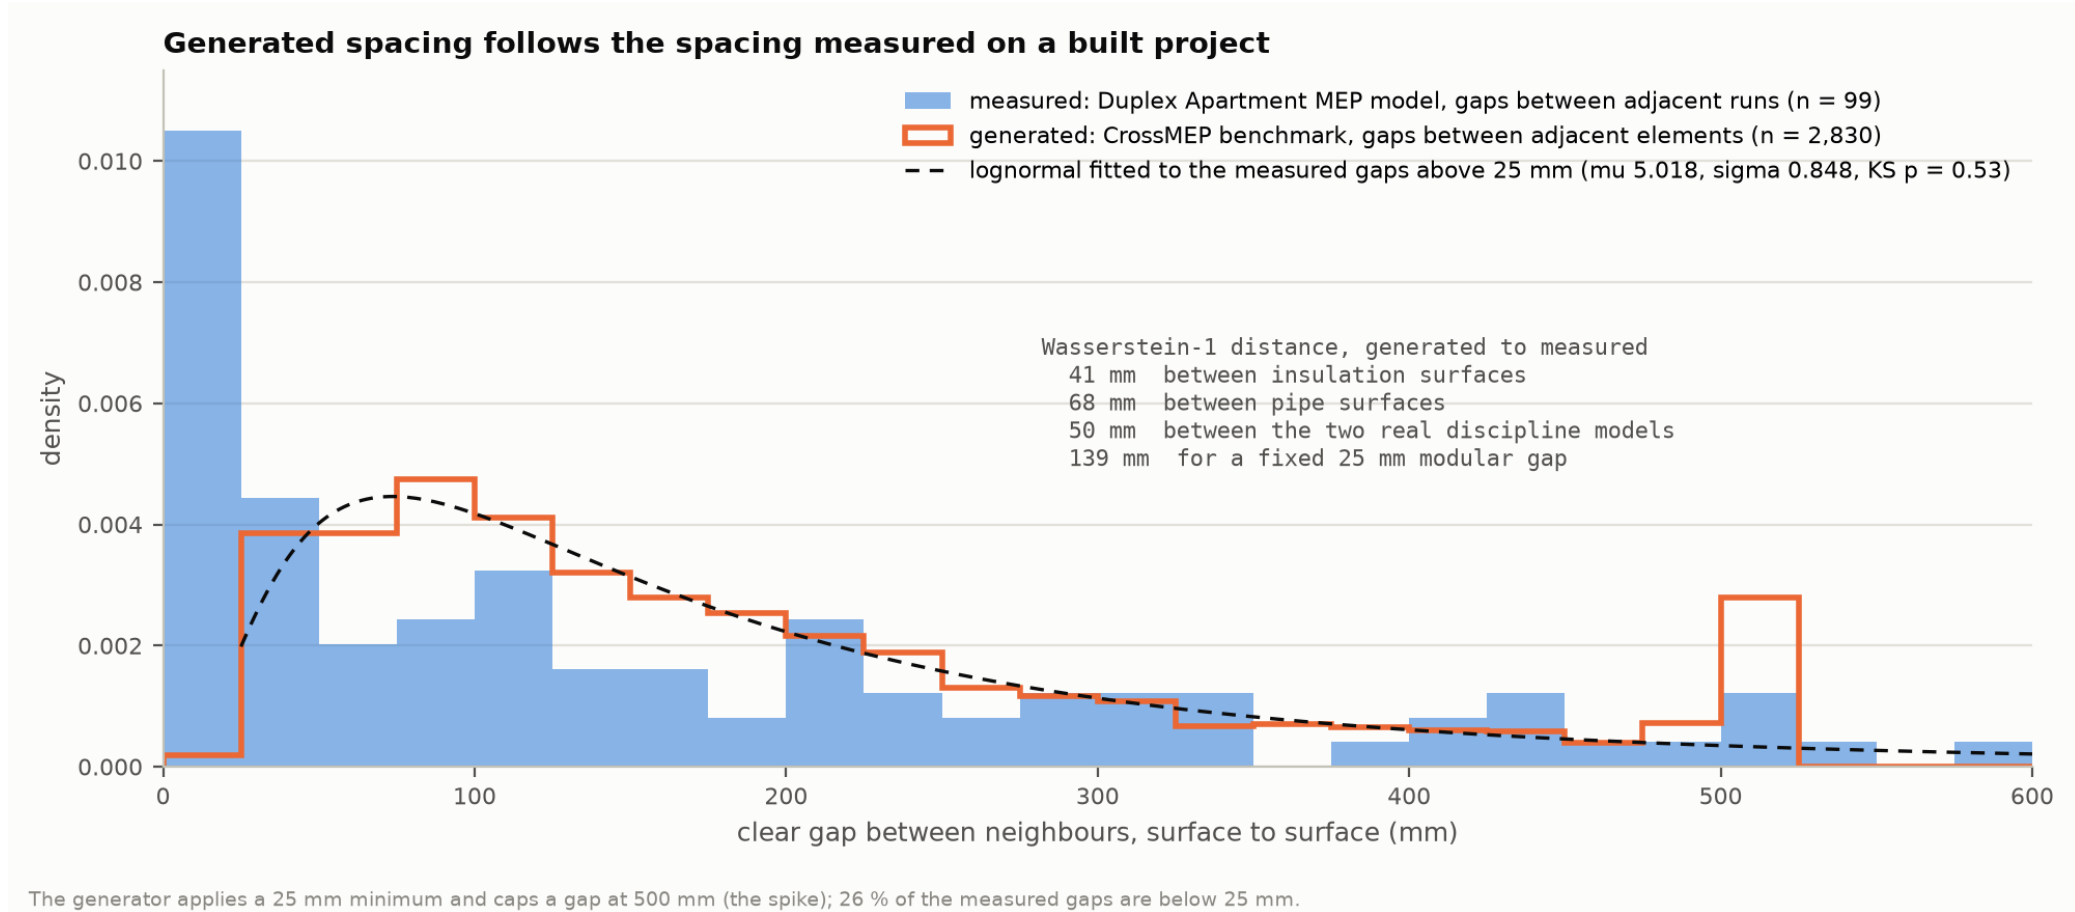

buildingSMART Duplex Apartment (open IFC): MEP and Plumbing discipline models parsed with IfcOpenShell, 427 and 231 segments. Measured gaps are irregular, not modular. The two discipline models of the same building are 50 mm apart; the generated gaps are 41 mm from the measured ones between insulation surfaces (68 mm between pipe surfaces); a fixed modular gap would be 139 mm away.

Experiment 3: a two-bin clamp catalog covers 1 pipe in 9

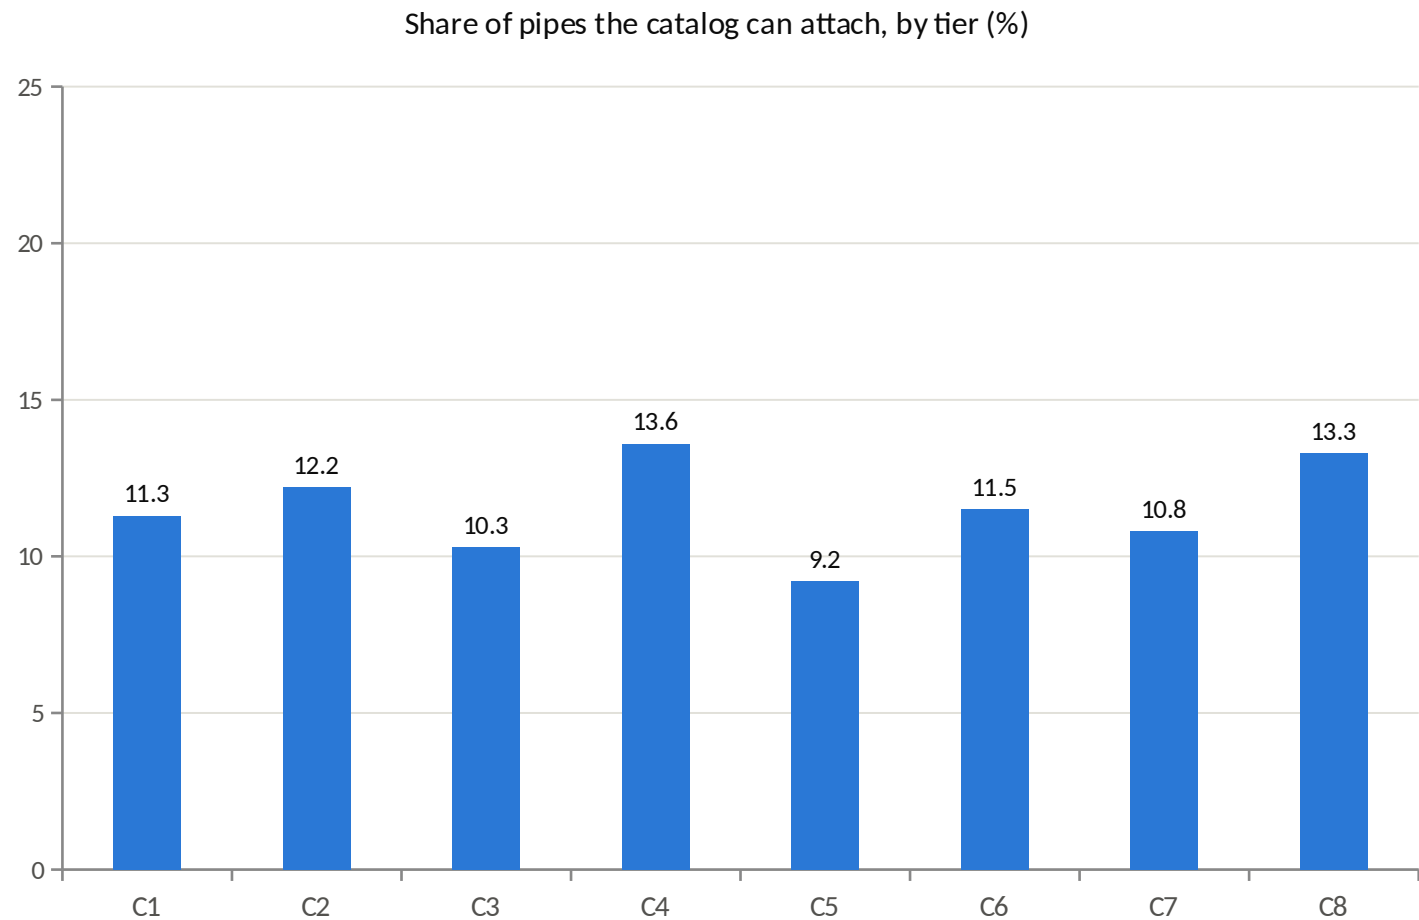

11.6 %

of the benchmark's pipes can be attached with two clamp bins (48–54 mm at 2.5 kN; 108–114 mm at 4.0 kN)

0 of 1,971

trays, ducts and conduits: a clamp catalog defines no attachment for them


Loads never bind; diameter and kind do. “Generalise the catalog” becomes a measured requirement: small-bore clamps first, then tray, duct and conduit attachments.

Using CrossMEP: load, filter, generate, inspect

```
import crossmep.tasks as cm
data = cm.load("benchmark") # 1,000 contexts
cm.filter_contexts(data, pipes=2, trays=1)
cm.catalog_coverage(data, my_catalog)

from crossmep import generate_custom
generate_custom(100, pipes=(2, 4), trays=1)
```

The loader and metrics need only the Python standard library; the generator needs NumPy.
Command line: `python -m crossmep`.

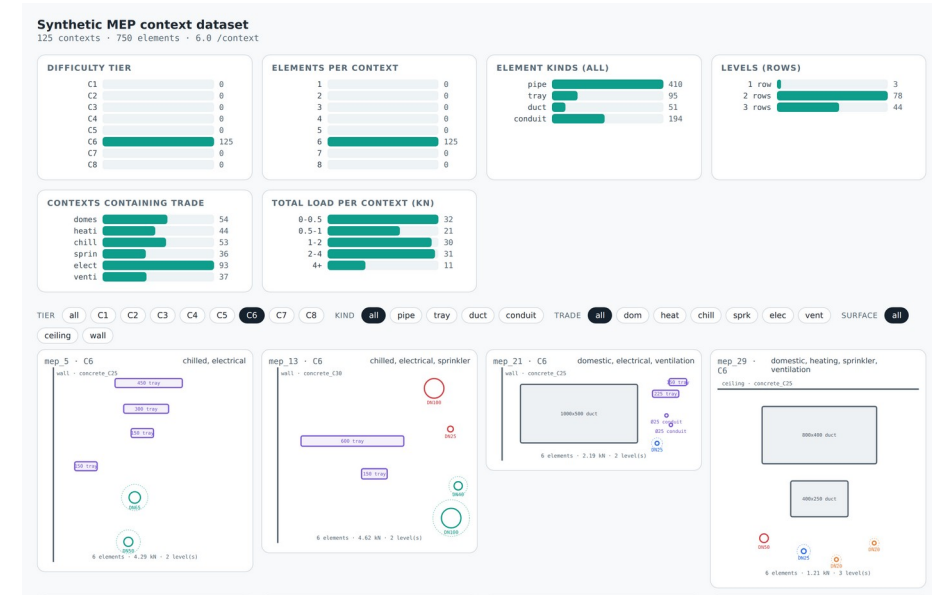

Interactive gallery: filter the benchmark by tier, kind, trade and surface.

Curriculum

train from C1 to C8, one element at a time

Stratified evaluation

success and feasibility-collapse rate per tier

Probes

held-out seeds and custom compositions

Scope, and what comes next

Scope

- One cross-section at one support: routing, branches and elevation changes are outside it; so is support spacing — the span is recorded per element, so a method can vary it
- Realism checked on two discipline models of one open residential project; congested racks rest on coordination practice and standards
- Trade mix and tier composition are design choices, not survey results
- Synthetic: not for the structural design of real installations

Next

- Per-tier feasibility-collapse measurement in a multi-element synthesis environment
- Verification against commercial corridor models
- An expert plausibility review of generated scenes, and a curated expert reference set for evaluation

If you coordinate services or design supports, open the gallery, filter for the scenes you know, and tell us what looks wrong. Every rule is one documented constant away from being changed.



CrossMEP: the brief, not the answer

7,000 support-design problems · every number traced · checked against a built project · open data and code

Data CC BY 4.0, code MIT. Not for the structural design of real installations.



github.com/lavinia-ped/CrossMEP_Dataset
lavinia@stanford.edu

Appendix: per-tier statistics, benchmark split

tier	contexts	median clear gap (mm)	median load (kN)	median width (mm)
C1	125	—	0.10	102
C2	125	120	0.23	344
C3	125	98	0.44	613
C4	125	90	0.55	728
C5	125	73	0.78	1027
C6	125	76	1.21	993
C7	125	60	1.49	1138
C8	125	62	1.71	1448

4,500 elements

2,529 pipes · 1,141 conduits · 569 trays · 261 ducts

41 / 68 mm

Wasserstein-1, generated to measured gaps: insulation / pipe surfaces

KS p = 0.53

lognormal fit to the measured gaps above 25 mm (n = 73)

Appendix: one record, as stored

```
{
  "context_id": "mep_57", "tier": "C2",
  "surface": {
    "kind": "ceiling", "substrate": "concrete_C25", "thickness_mm": 200.0
  },
  "n_elements": 2, "n_levels": 1, "total_load_kN": 1.12, "bundle_width_mm": 588.0,
  "elements": [
    {
      "kind": "cable_tray", "service": "tray", "trade": "electrical", "shape": "rect",
      "label": "300 tray", "width_mm": 300.0, "height_mm": 60.0, "insulation_mm": 0.0,
      "load_kN": 1.08, "span_m": 2.0, "load_kN_per_m": 0.5396,
      "level": 0, "along_mm": -144.0, "out_mm": 120.0
    },
    {
      "kind": "pipe", "service": "heating", "trade": "heating", "shape": "round",
      "label": "DN20", "width_mm": 26.9, "height_mm": 26.9, "insulation_mm": 20.0,
      "load_kN": 0.04, "span_m": 2.1, "load_kN_per_m": 0.0189,
      "level": 0, "along_mm": 260.5, "out_mm": 156.2
    }
  ]
}
```

- Units: millimetres, kilonewtons, metres (span)
- Widths are bare; insulation_mm is per side
- $\text{load_kN} = \text{load_kN_per_m} \times \text{span_m}$
- along_mm, out_mm: position along and out from the surface
- level: the generative row (metadata)