
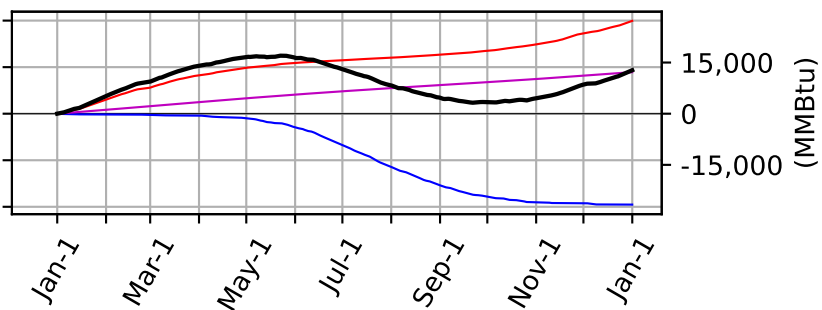
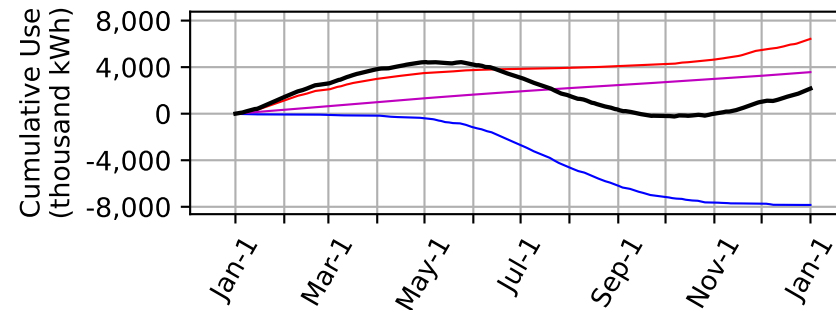
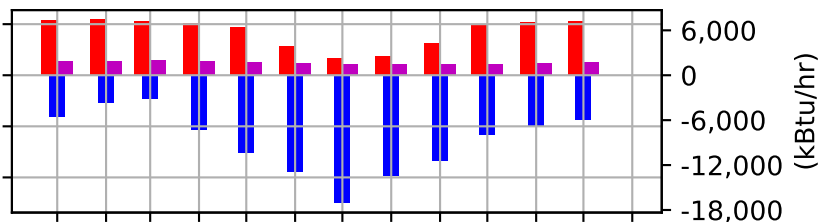
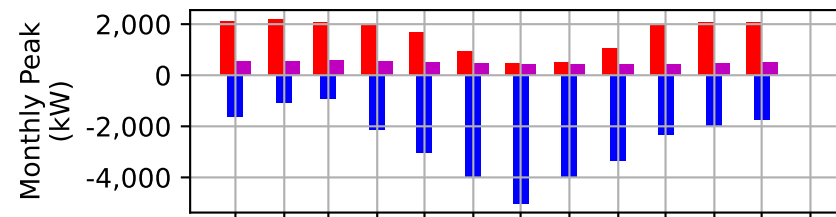
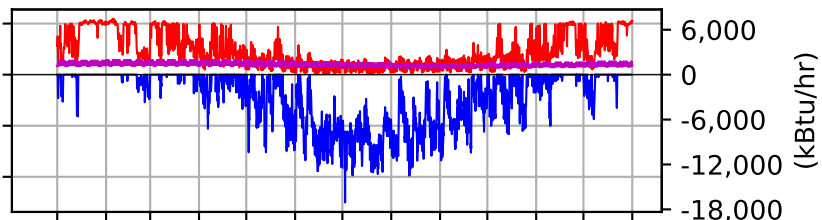


1058&1060 Malcolm Grow Medical

Baseline

Post-ECM

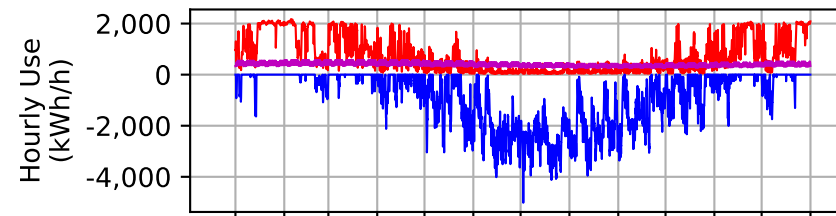

heating cooling dom. hot water net energy