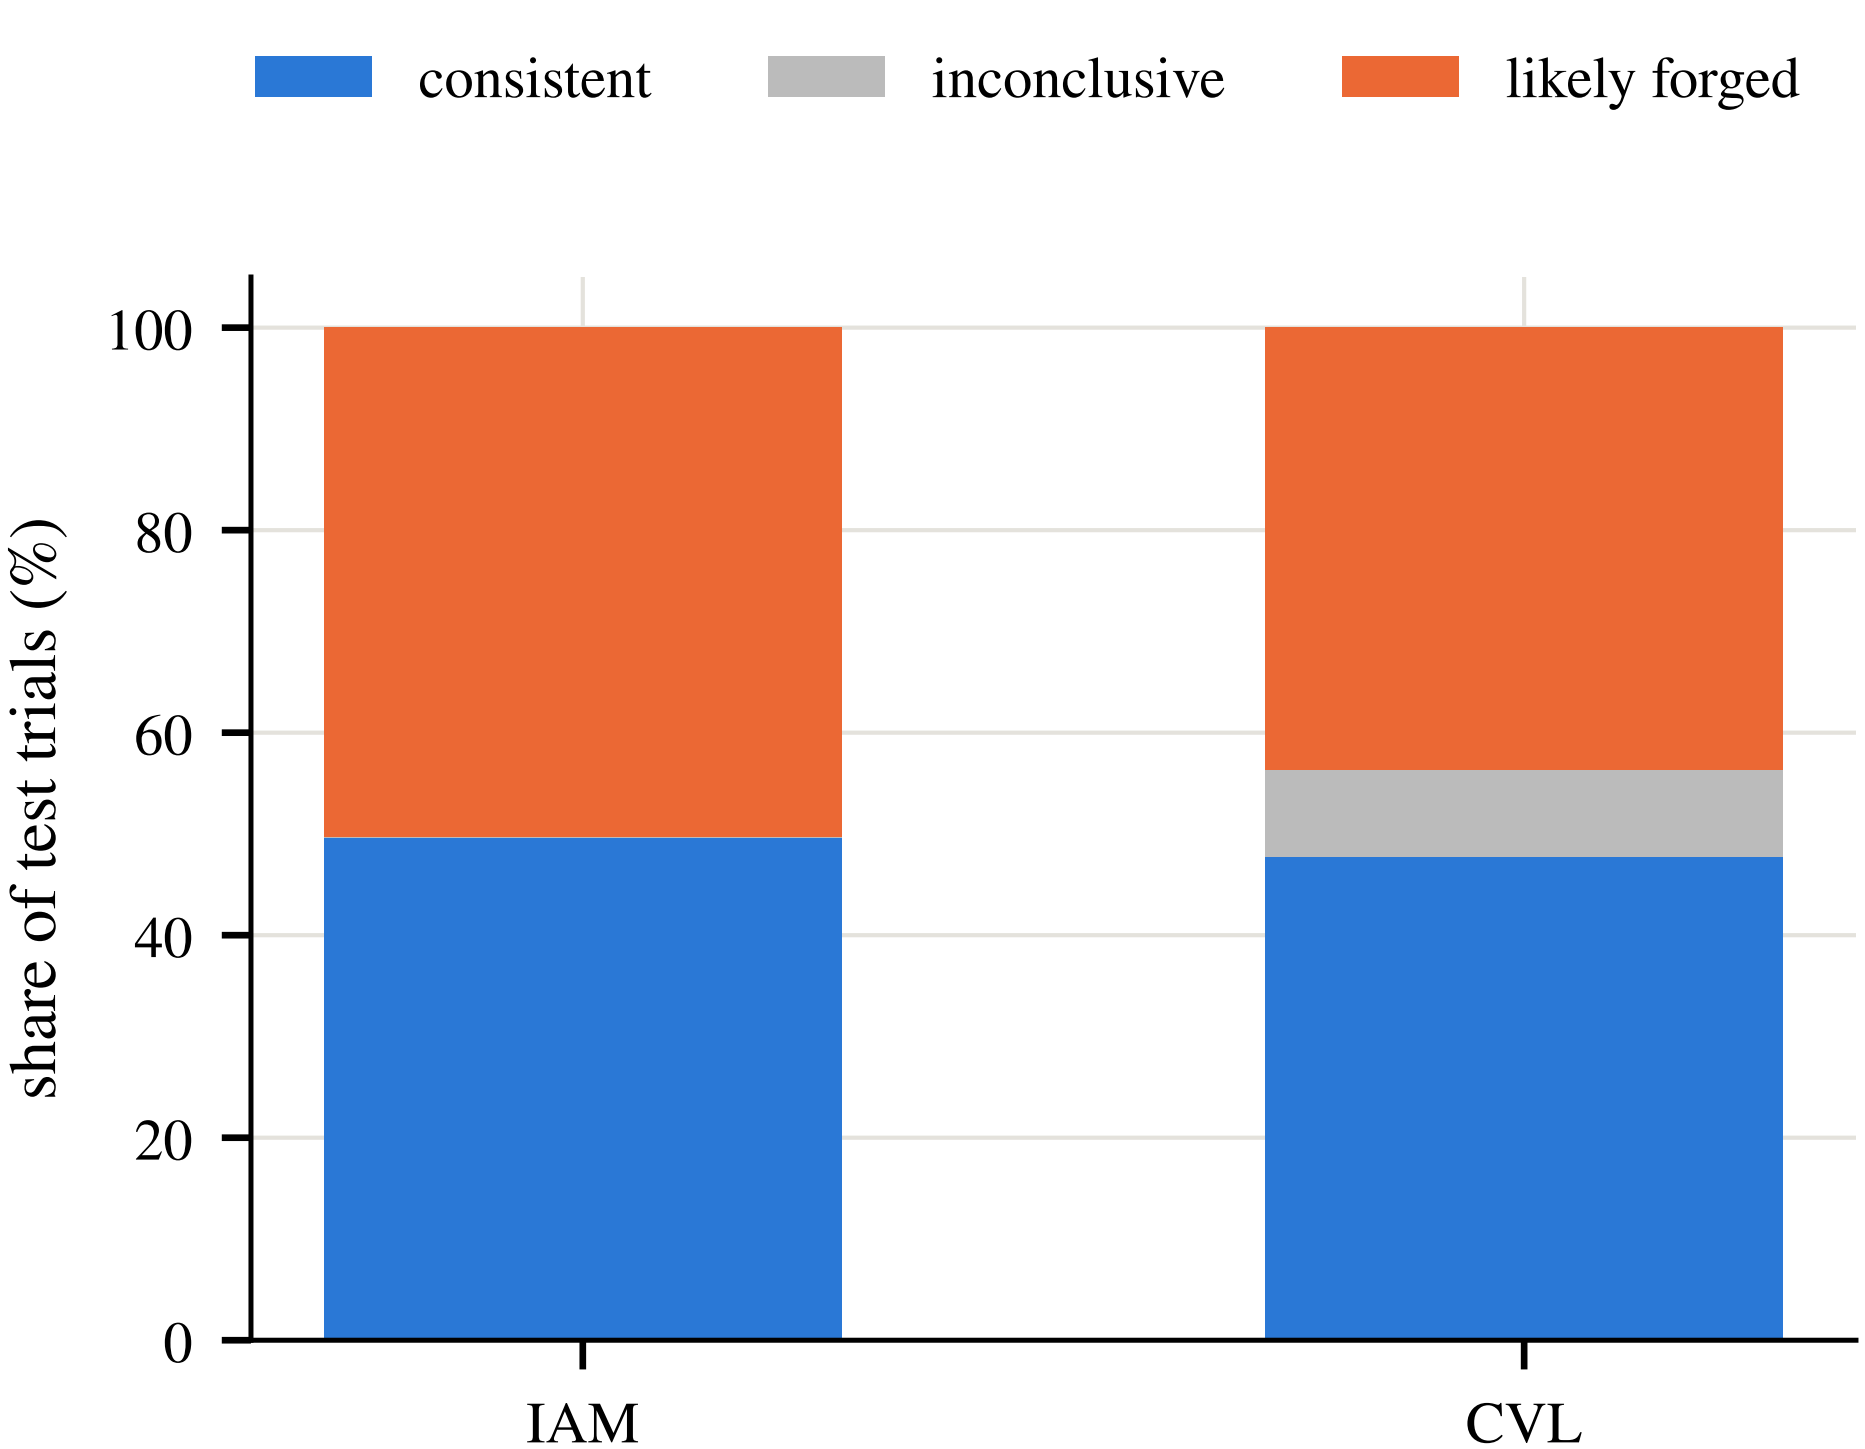
consistent
inconclusive
likely forged
share of test trials (%)
100
80
60
40
20
0
IAM
CVL