


Lighting Legend

Symbol	Description
	LEDlite COB LED recessed mounted fire rated down lighters, dimmable-IP66 Daylight white. Code number LT CFD12DL or similar.
	Standard light bulb fitting.
	Luxon Intel LED plus suspended 3000K diffuser frost IN-PLUS-SS-WW-DF (H 70mm W 95mm L 1515mm)
	Luxon Intel LED medium suspended 3000K diffuser frost IN-MEDIUM-SS-WW-DF (H 70mm W 95mm L 1005mm)
	Light Switch- numbers denotes how many switches/ ways.
	Suggested wiring circuits.
	Passive Light Sensor

Air admittances valves Durgo or similar to WC's should terminate above the highest waste appliance.

Lighting and Power General

New lighting to achieve a luminous efficiency of 60 lumens per circuit watt. 75% of all new lighting to be LED's. New control sockets to be 450-1200mm above floor level. See service drawing.

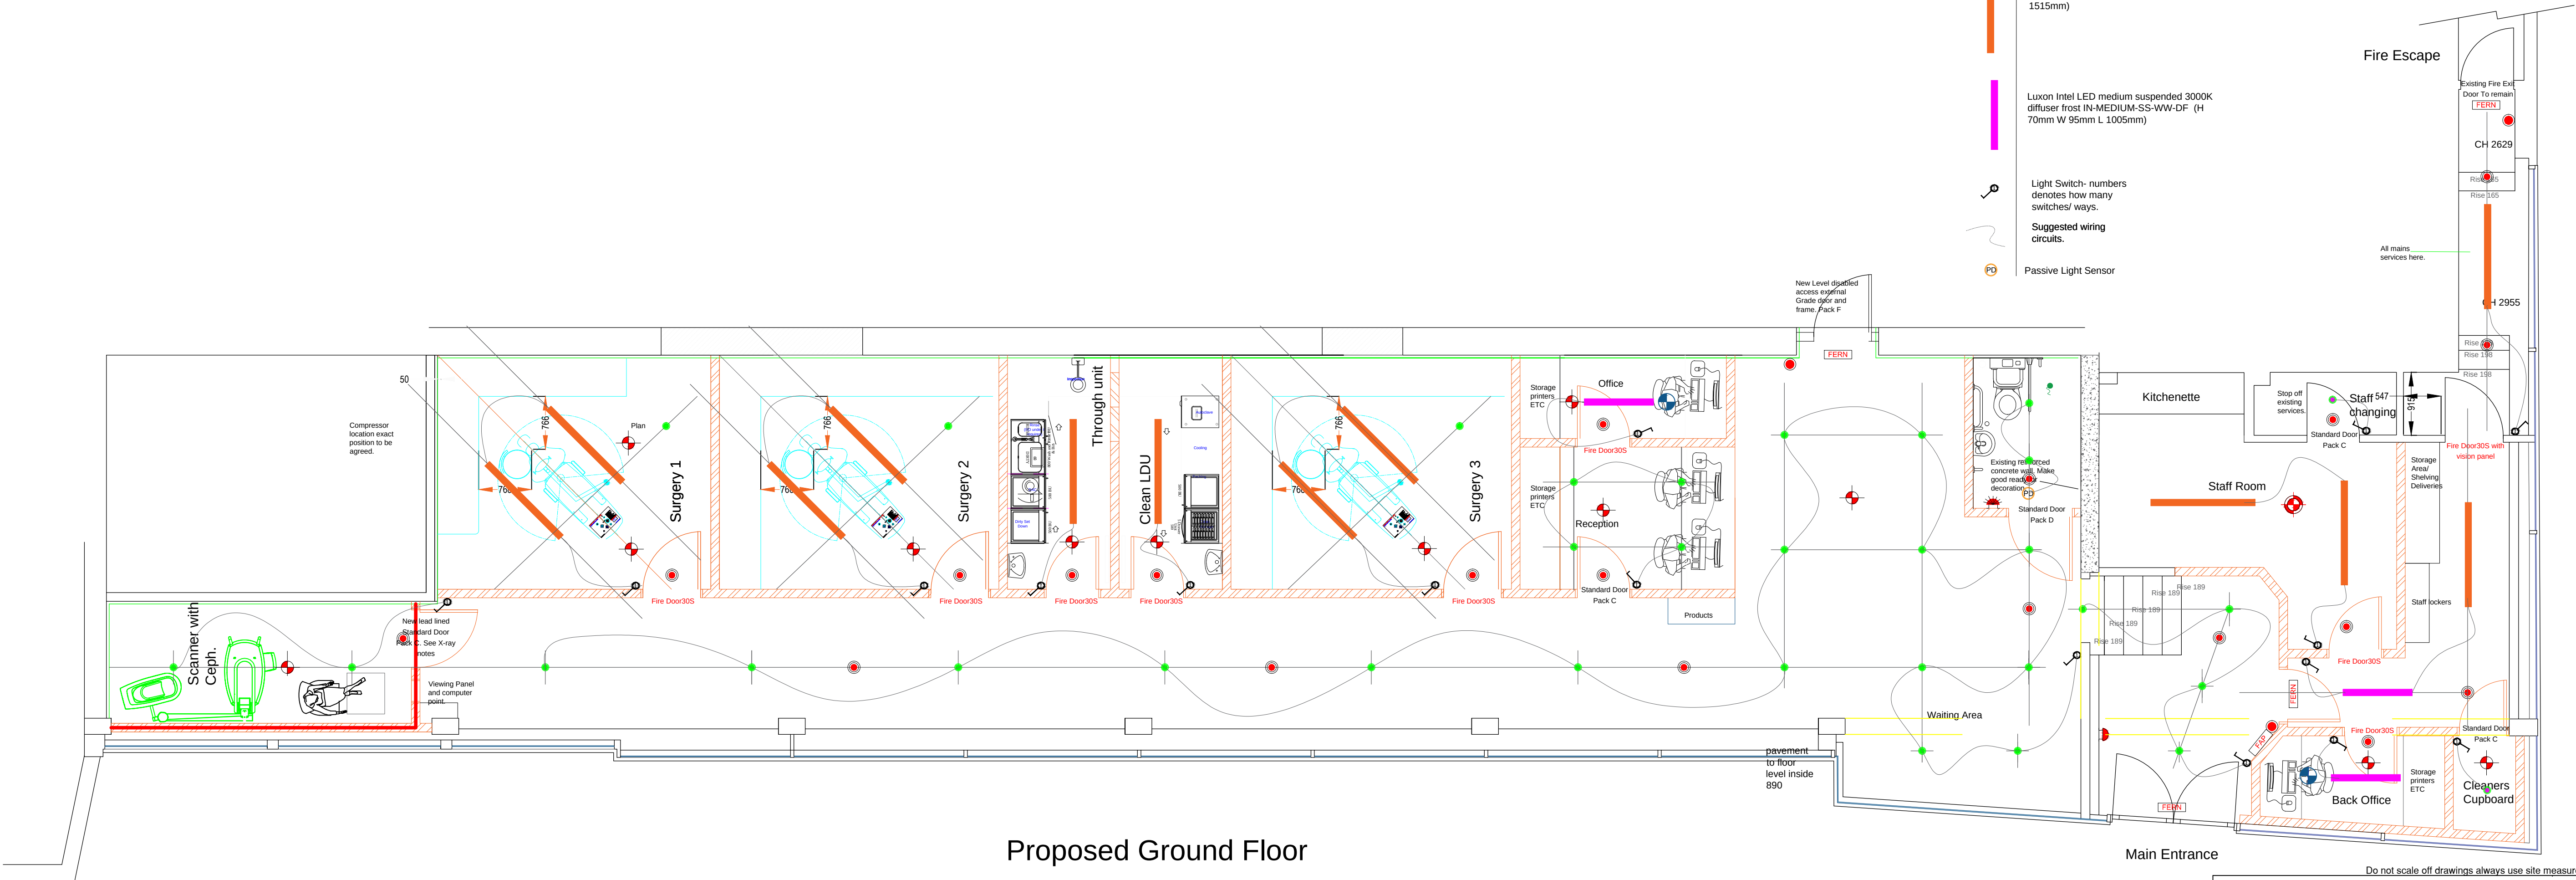


Proposed Ground Floor

Revision Register

No.	Description	Date	Approved by
2	Compressor position changed	27-8-2019	

Note:

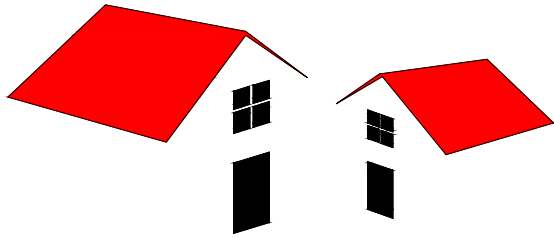

Archiintelligence

www.archiintelligence.com

E: info@archiintelligence.com

Tennysen House

Cambridge Business Park

Cambridge CB4 0WZ

CLIENT:	Set and Roopa Regarding The New Practice at Lanmore House 370 High Road Wembley London HA9 6AX	DATE:	2-9-2019	Approved by:	DATE:
DWG NO:	SARLH 2-9-19 PLD	SCALE:	1:50 at A1		
DWG TITLE:	Proposed Lighting Drawing	DRAWN BY:	RG		