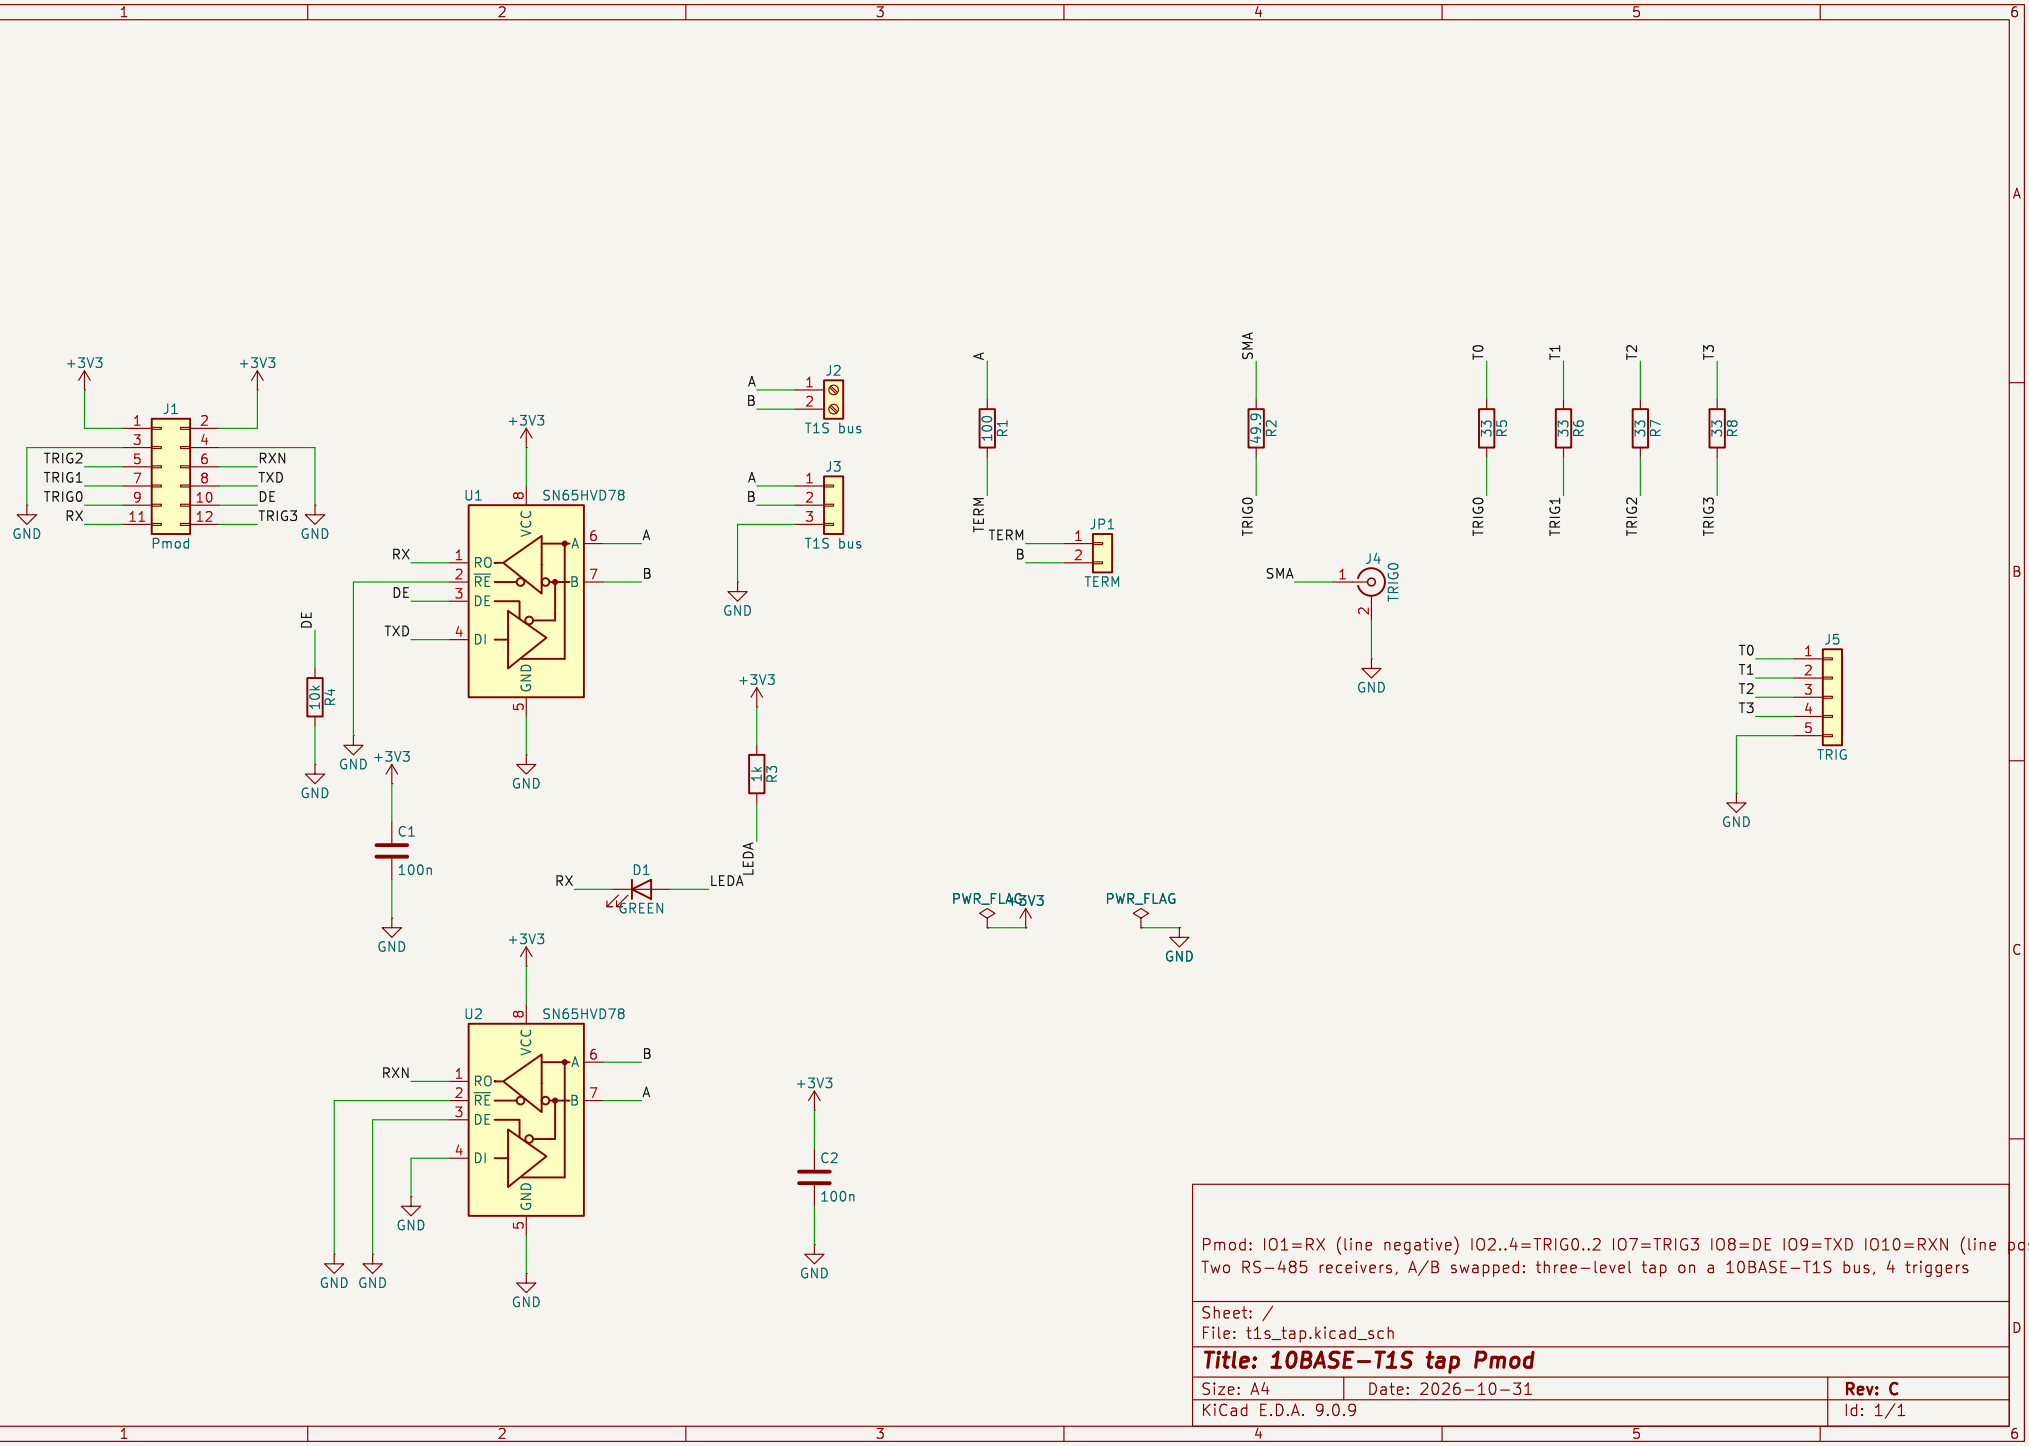


Pmod: IO1=RX (line negative) IO2..4=TRIG0..2 IO7=TRIG3 IO8=DE IO9=TXD IO10=RXN (line positive)
Two RS-485 receivers, A/B swapped: three-level tap on a 10BASE-T1S bus, 4 triggers

Sheet: /		
File: t1s_tap.kicad_sch		
Title: 10BASE-T1S tap Pmod		
Size: A4	Date: 2026-10-31	**Rev: C**
KiCad E.D.A. 9.0.9		Id: 1/1