
State control enters whole-site power accounting

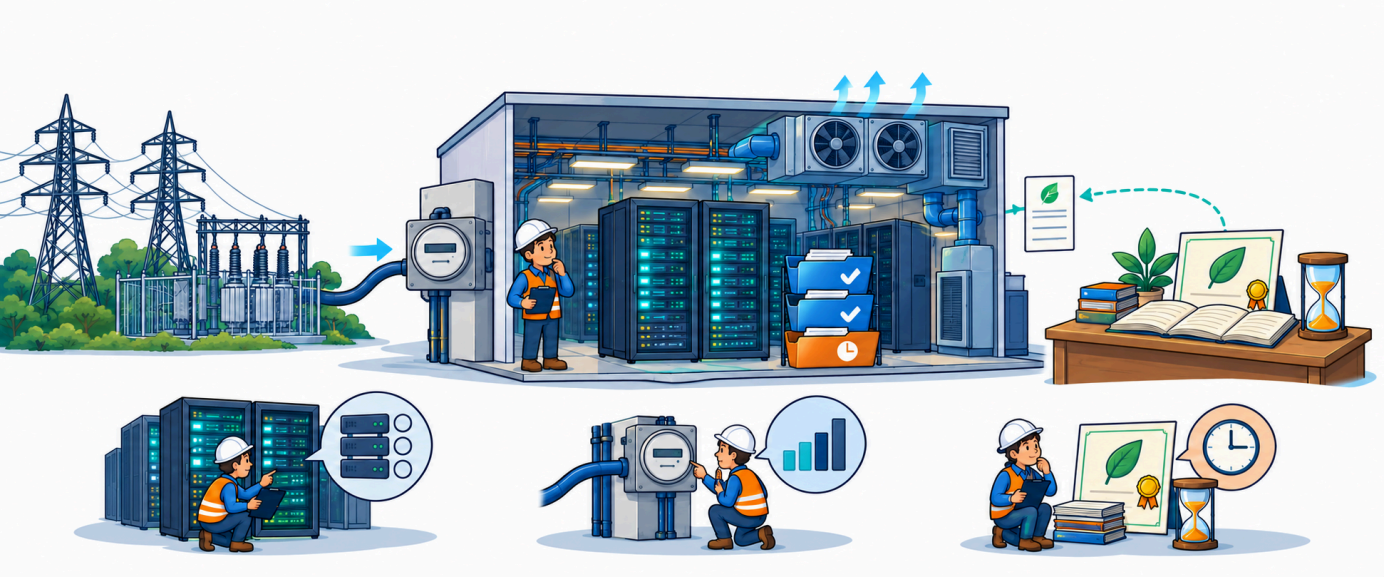

Equipment and tasks

Run / pause / save / restore
GPU, CPU, memory, network
Include facility support

Power and metering

Site load and local supply
Explicit net-import balance
Aggregate into hourly energy

Common criterion

Network and call agreement
Hourly clean attribution
State and original deadline

Check the full power requirement of each path

A GPU low-power fraction is not a site threshold; verify local supply.
Account for clean attributes and physical supply separately; avoid double counting.