




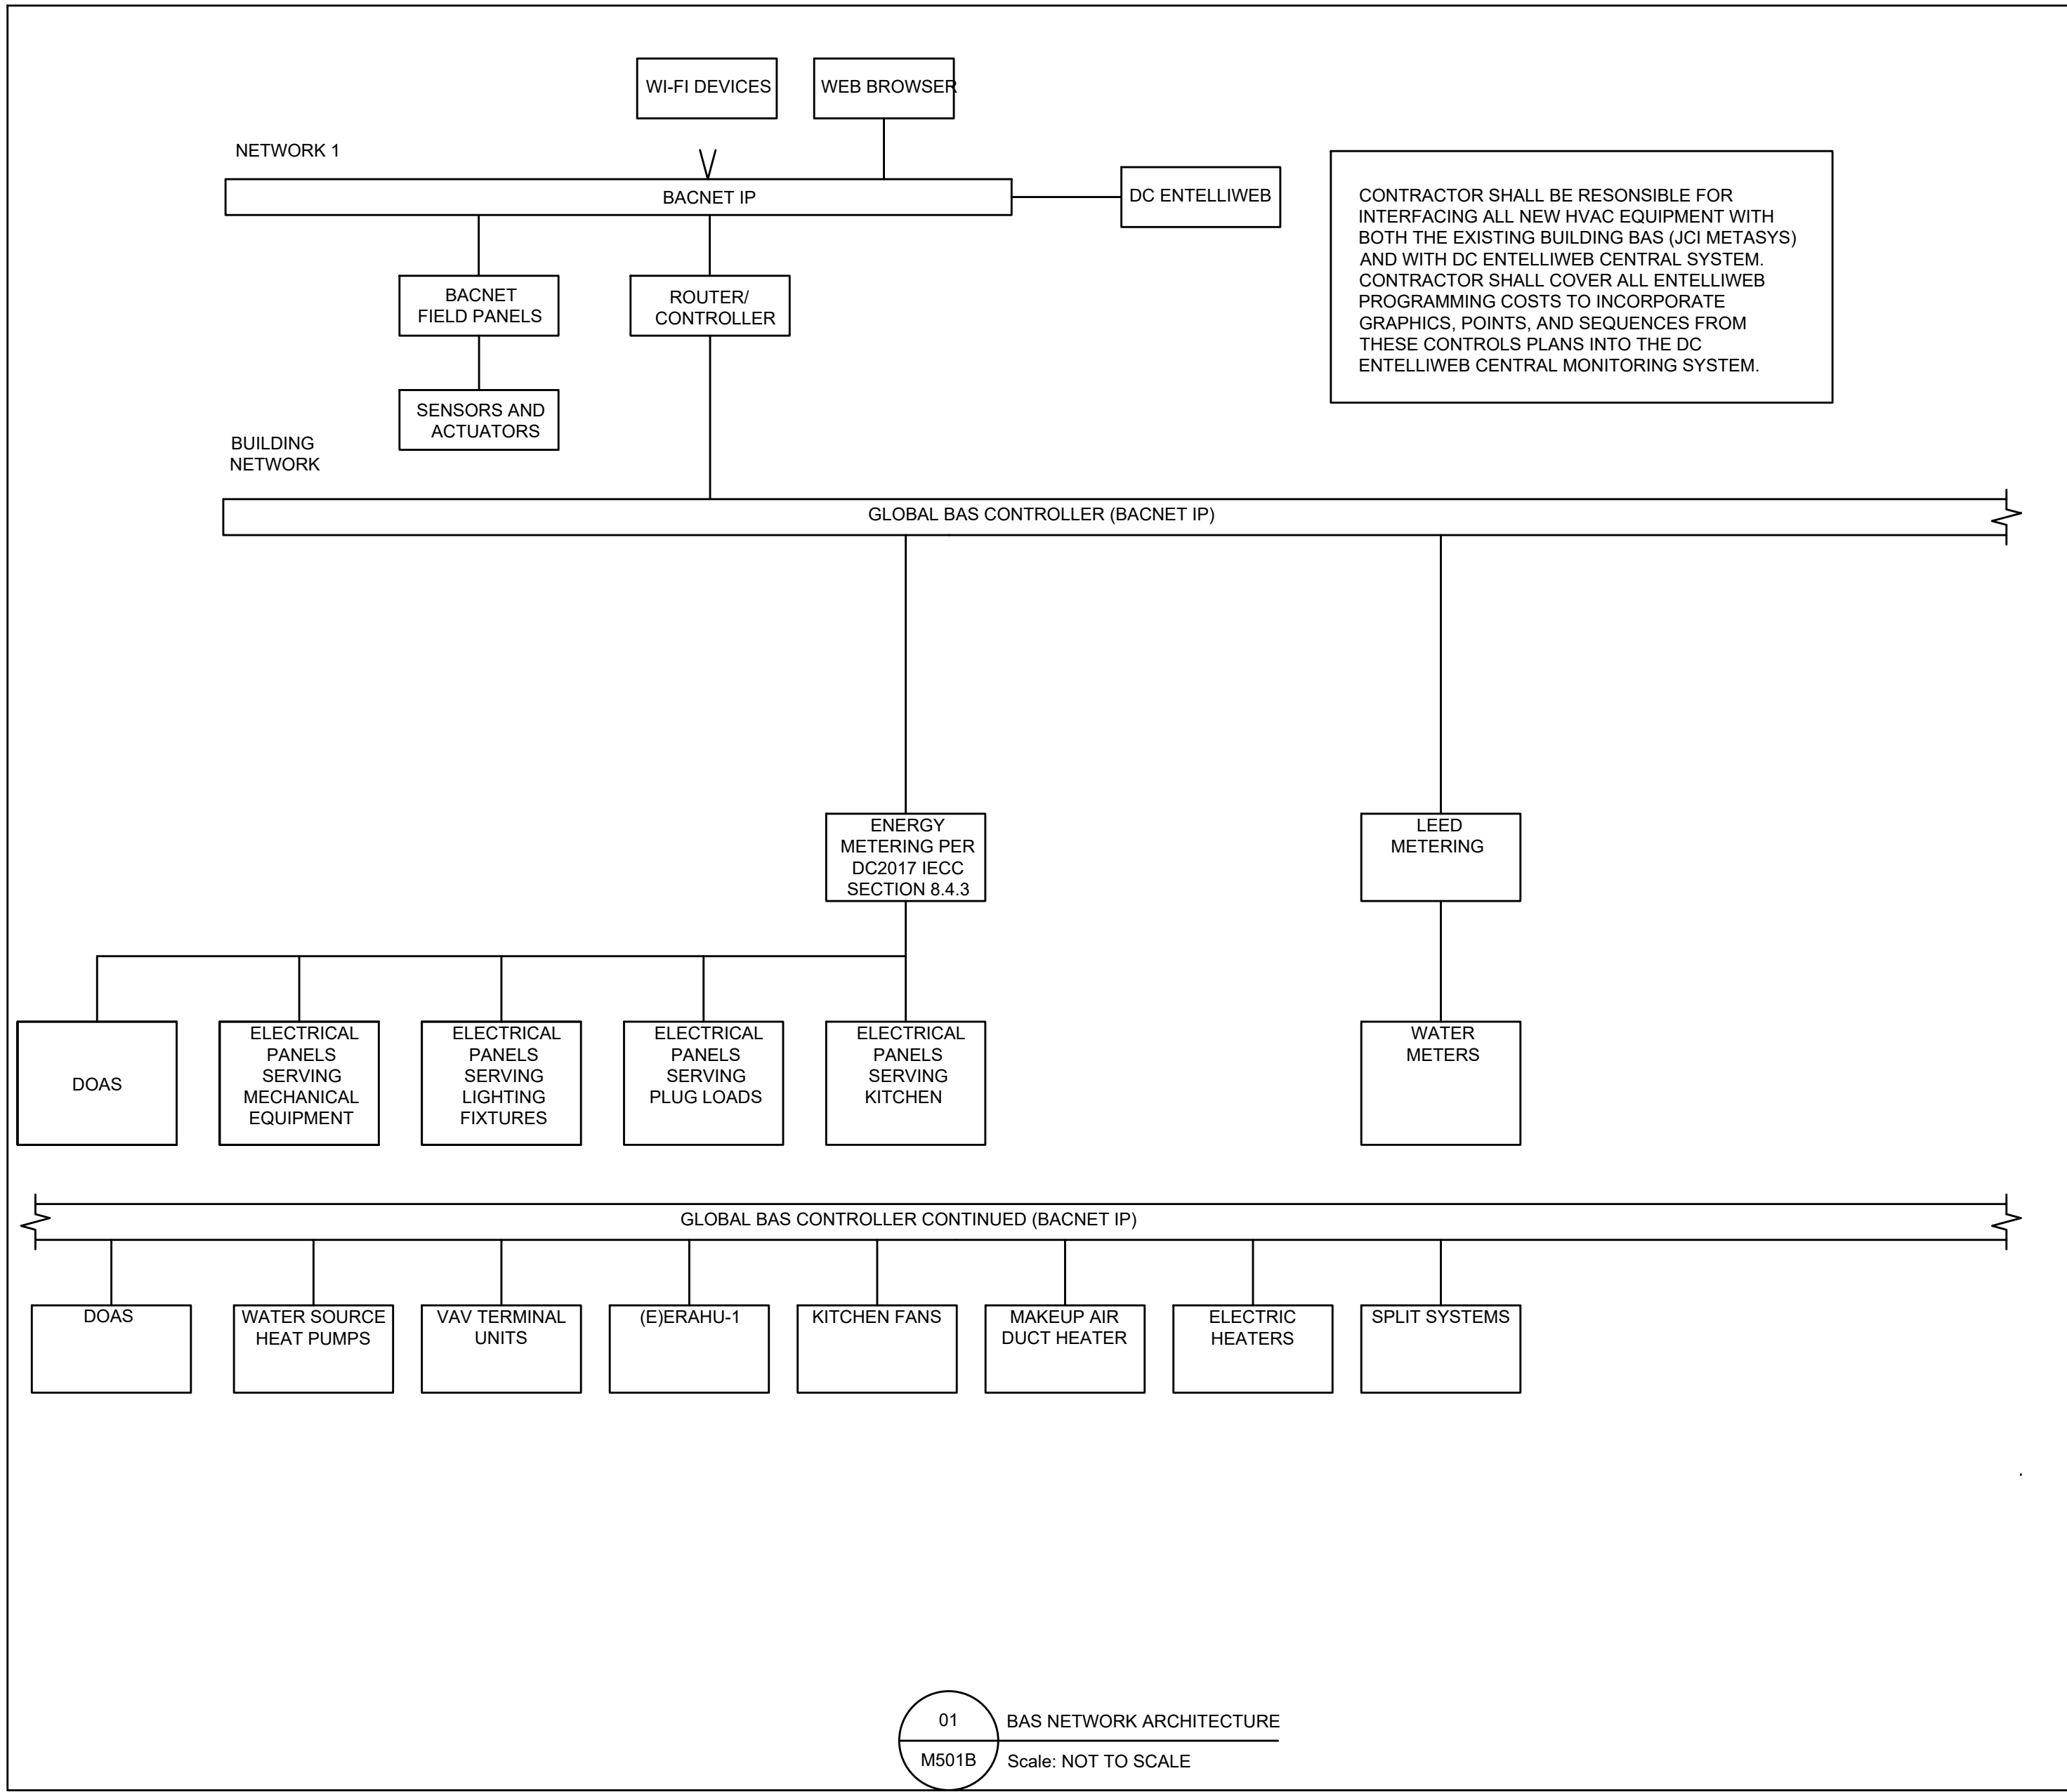

01 BAS NETWORK ARCHITECTURE  
M501B Scale: NOT TO SCALE

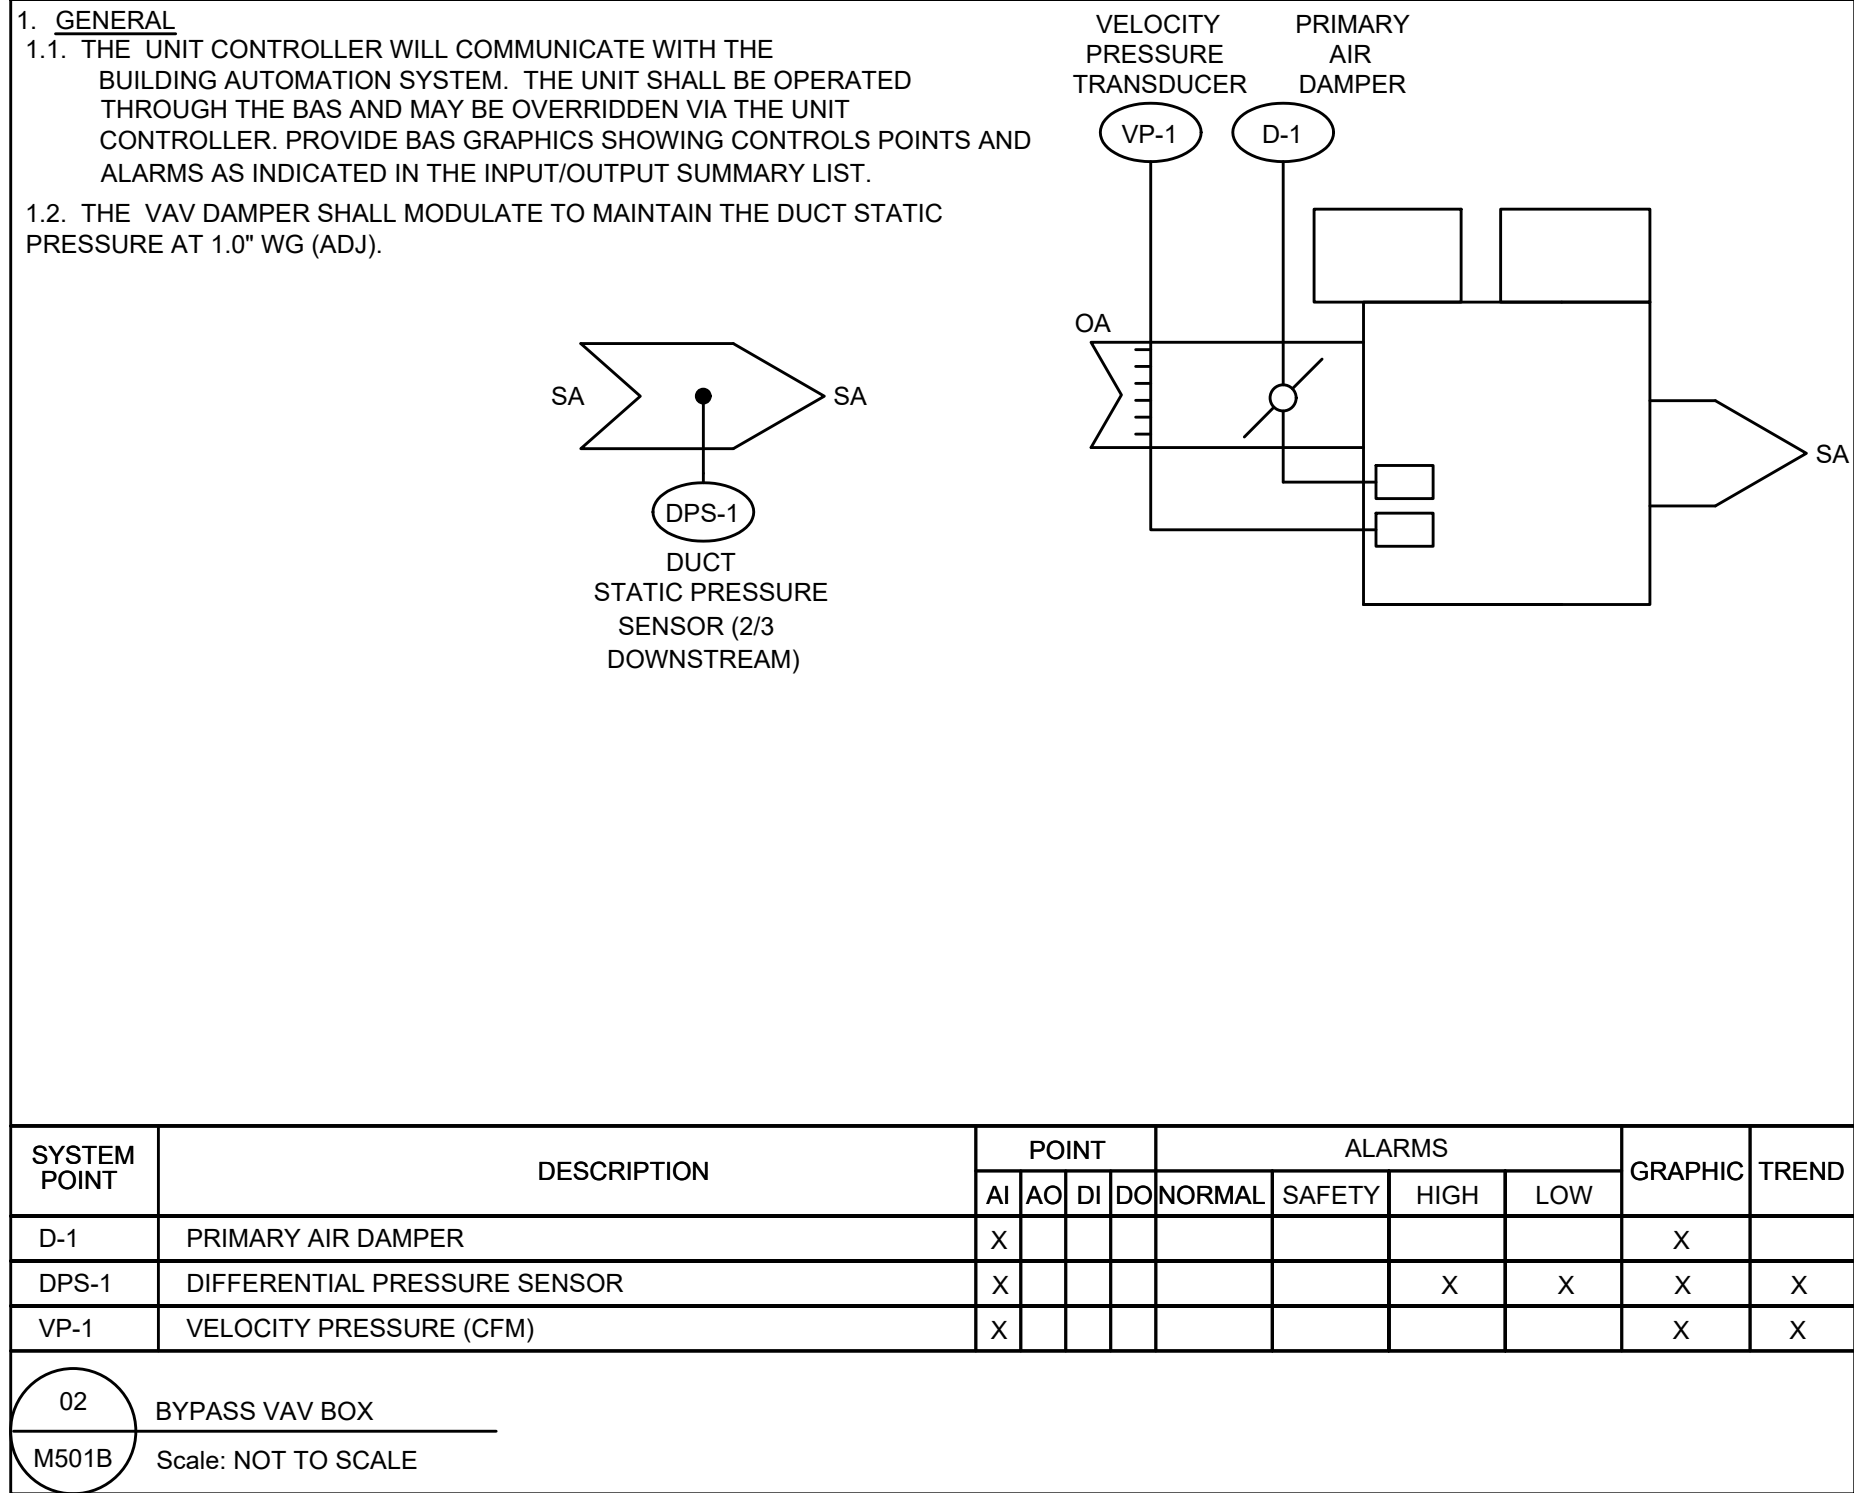

02 BYPASS VAV BOX  
M501B Scale: NOT TO SCALE

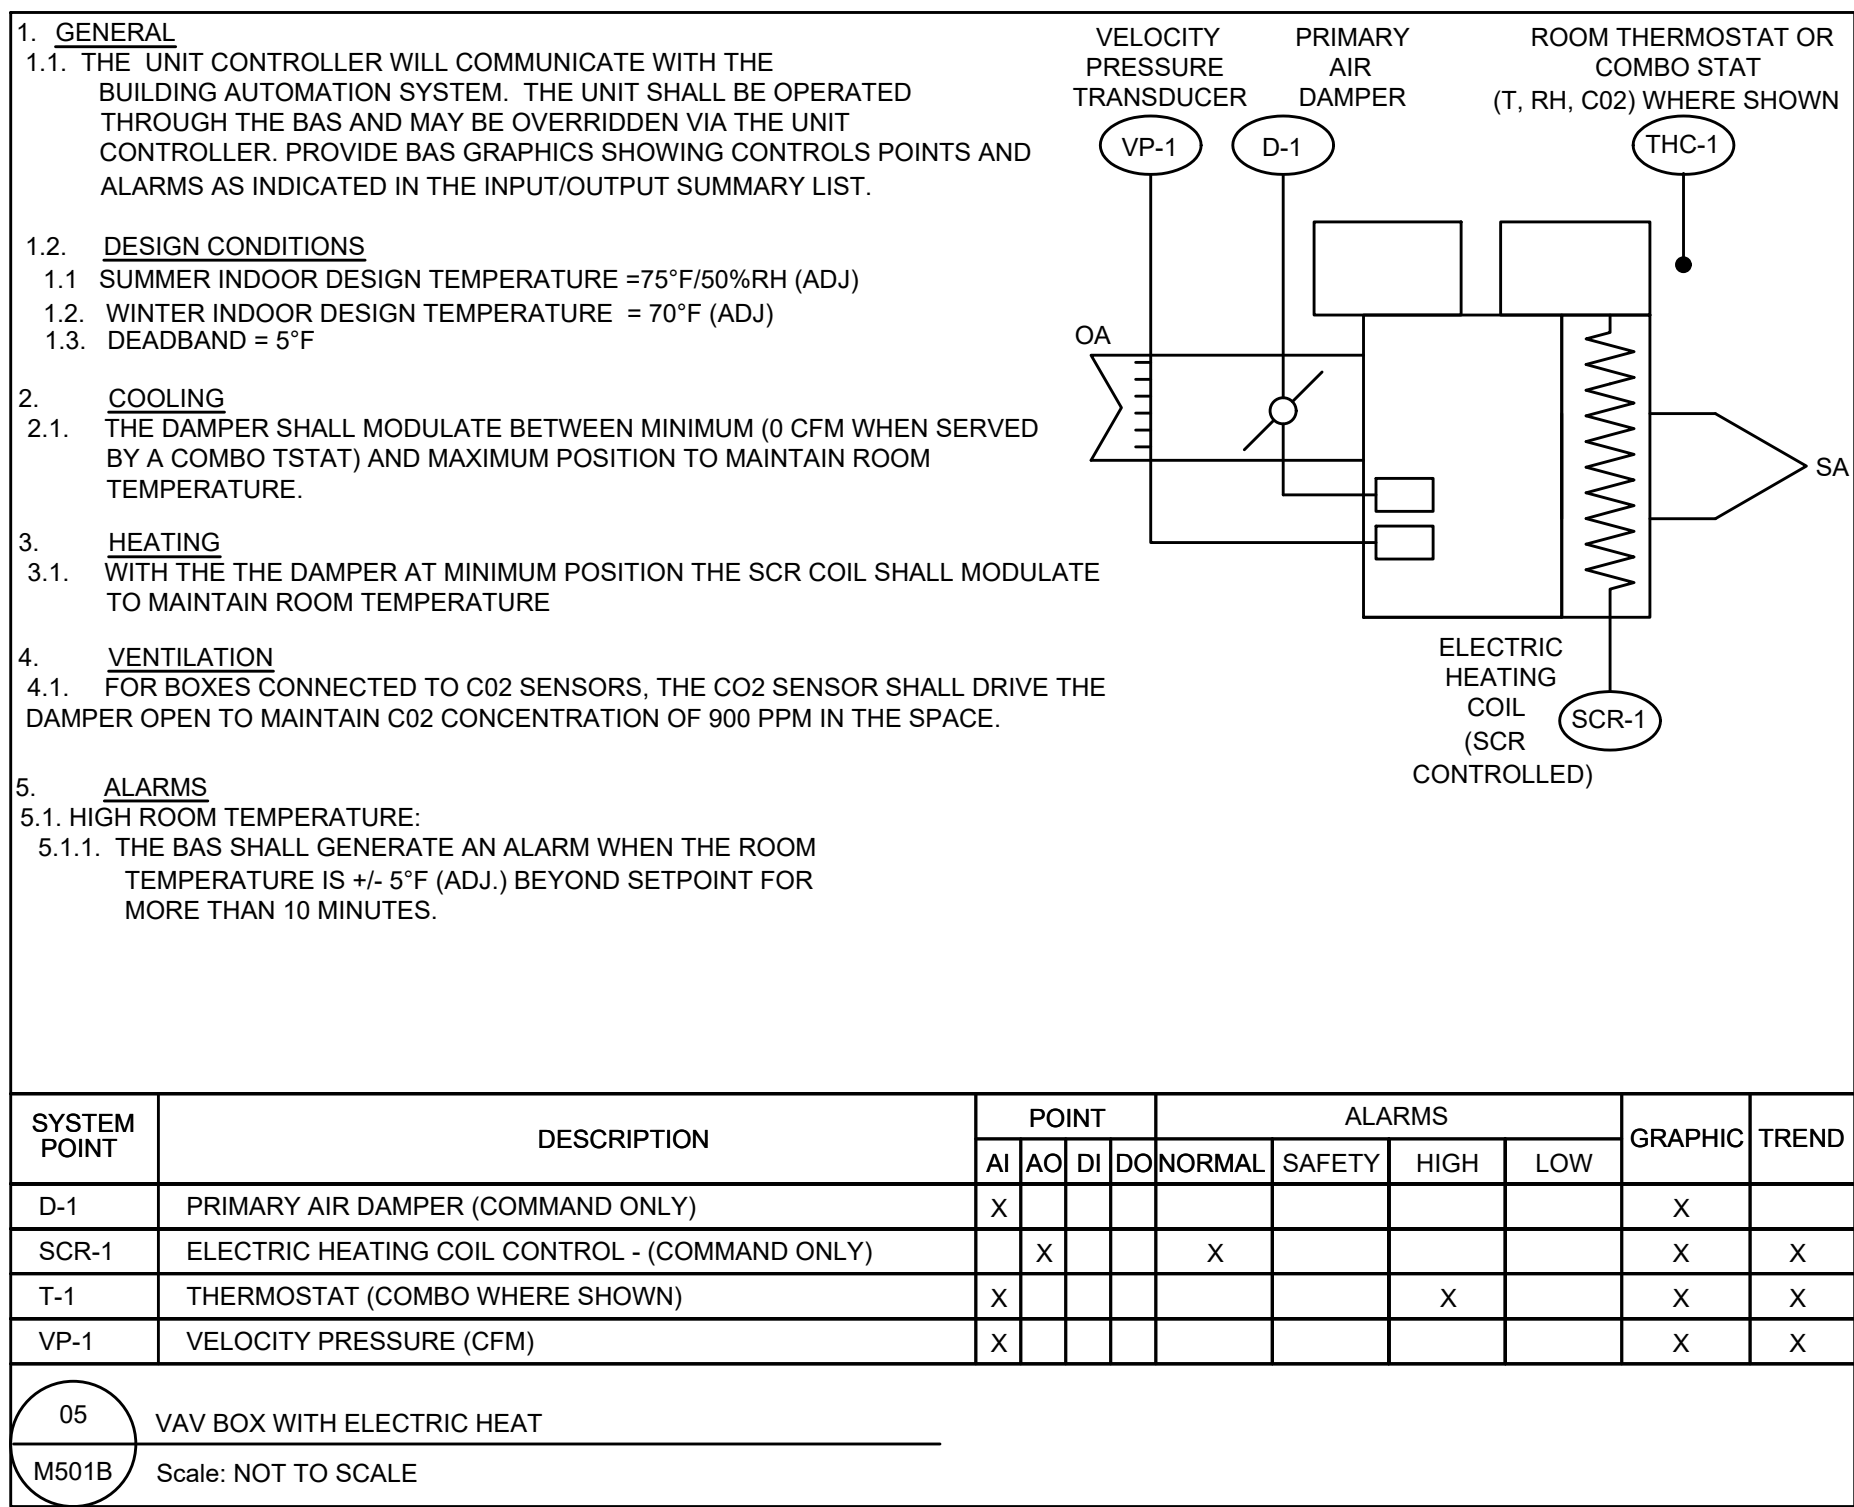

05 VAV BOX WITH ELECTRIC HEAT  
M501B Scale: NOT TO SCALE


| CONTROLS SYMBOLS |                                                               |
|------------------|---------------------------------------------------------------|
| SYMBOL           | DESCRIPTION                                                   |
|                  | AUTOMATIC CONTROL DAMPER (NORMALLY CLOSED OR NORMALLY OPENED) |
|                  | CURRENT SENSOR                                                |
|                  | DIFFERENTIAL PRESSURE SENSOR                                  |
|                  | WATER SOURCE HEAT PUMP                                        |
|                  | DX COOLING COIL                                               |
|                  | END SWITCH                                                    |
|                  | FAN                                                           |
|                  | FILTER                                                        |
|                  | ELECTRIC HEATING COIL                                         |
|                  | RELATIVE HUMIDITY                                             |
|                  | SMOKE DETECTOR                                                |
|                  | STATIC PRESSURE SENSOR (HIGH AND LOW)                         |
|                  | TEMPERATURE SENSOR                                            |
|                  | VARIABLE SPEED/FREQUENCY DRIVE                                |
|                  | AIR FLOW MEASURING SENSOR                                     |
|                  | PRIMARY AIR DAMPER                                            |
|                  | CARBON DIOXIDE SENSOR                                         |
|                  | HIGH STATIC PRESSURE SENSOR                                   |
|                  | LOW STATIC PRESSURE SENSOR                                    |

| CONTROL ABBREVIATIONS |                              |
|-----------------------|------------------------------|
| ABBREVIATION          | DESCRIPTION                  |
| ACD                   | AUTOMATIC CONTROL DAMPER     |
| ADJ                   | ADJUSTABLE                   |
| AI                    | ANALOG INPUT                 |
| AO                    | ANALOG OUTPUT                |
| AFMS                  | AIRFLOW MEASURING STATION    |
| BAS                   | BUILDING AUTOMATION SYSTEM   |
| BTU                   | BRITISH THERMAL UNITS        |
| CO2                   | CARBON DIOXIDE               |
| CS                    | CURRENT SENSOR               |
| CV                    | CONTROL VALVE                |
| DI                    | DIGITAL INPUT                |
| DO                    | DIGITAL OUTPUT               |
| DPS                   | DIFFERENTIAL PRESSURE SENSOR |
| EA                    | EXHAUST AIR                  |
| ES                    | END SWITCH                   |
| ERU                   | ENERGY RECOVERY UNIT         |
| *F                    | DEGREES FARENHEIT            |
| FM                    | FLOW METER                   |
| FZ                    | FREESTAT                     |
| HOA                   | HAND ON/OFF/AUTO             |
| ISO                   | ISOLATION                    |
| MTD                   | MOUNTED                      |
| OA                    | OUTSIDE AIR                  |
| PRESS                 | PRESSURE                     |
| RH                    | RELATIVE HUMIDITY            |
| RA                    | RETURN AIR                   |
| SA                    | SUPPLY AIR                   |
| SD                    | SMOKE DAMPER                 |
| SP                    | STATIC PRESSURE              |
| SPH                   | STATIC PRESSURE - HIGH       |
| SPL                   | STATIC PRESSURE - LOW        |
| TS                    | TEMPERATURE SENSOR           |
| VFD                   | VARIABLE FREQUENCY DRIVE     |
| WG                    | WATER GAUGE                  |

#### GENERAL NOTES


- 24V SOURCES AND LOW VOLTAGE TRANSFORMERS FOR BAS DEVICES ARE PROVIDED BY THE ATC CONTRACTOR. DEDICATED 120V SOURCES WILL BE PROVIDED TO THE ATC CONTRACTOR BY THE DVS20 ELECTRICAL CONTRACTOR.
- ALL EXPOSED CONTROLLERS AND ACTUATORS SHALL BE PROVIDED WITH ENCLOSURES.
- ALL EXPOSED CONTROLS/ELEC. WIRING SHALL BE INSTALLED IN FIELD PAINTED CONDUIT. COLOR BY ARCHITECT.
- ANY WIRING INSTALLED ABOVE OPEN PLENUM CEILINGS SHALL BE PLENUM RATED.
- REFERENCE ARCHITECTURAL DOCUMENTS FOR FINAL LOCATIONS OF ALL VISIBLE SWITCHES, OUTLET, DEVICES, PIPING, DUCTWORK, DIFFUSERS, CONDUIT, ETC.
- ALL SENSORS SHALL BE MOUNTED 48" ABOVE FINISHED FLOOR FOR ADA ACCESSIBILITY UNLESS OTHERWISE NOTED.

- GENERAL**
  - BAS TURBINE WATER METERS SHALL BE PROVIDED BY CONTROLS CONTRACTOR TO MONITOR WATER USAGE AND SHALL COMMUNICATE WITH THE BAS.
  - PROVIDE NEW BAS GRAPHICS SHOWING CONTROLS POINTS AS INDICATED IN THE INPUT/OUTPUT SUMMARY LIST.
  - LOCATE AT:
    - MAIN BUILDING DOMESTIC COLD WATER LINE
    - DOMESTIC COLD WATER LINE TO PLUMBING FIXTURES
  - WATER CONSUMPTION SHALL BE RECORDED, LOGGED AND REPORTED TO SUMMARIZE HOURLY, DAILY, MONTHLY AND ANNUAL USAGE.
  - DATA SHALL BE SENT TO BAS AND ALSO DISPLAYED AT A MONITOR LOCATED AT THE MAIN CIRCULATION AREA
- NATURAL GAS METER SHALL BE PROVIDED TO MONITOR GAS USAGE AND SHALL COMMUNICATE WITH THE BAS.
- PROVIDE NEW BAS GRAPHICS SHOWING CONTROLS POINTS AS INDICATED IN THE INPUT/OUTPUT SUMMARY LIST.
- LOCATE AT MAIN GAS LINE.
- CONSUMPTION SHALL BE RECORDED, LOGGED AND REPORTED TO SUMMARIZE HOURLY, DAILY, MONTHLY AND ANNUAL USAGE.
- DATA SHALL BE SENT TO BAS AND ALSO DISPLAYED AT A MONITOR LOCATED AT THE MAIN CIRCULATION AREA

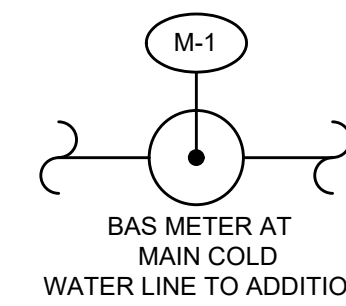


| SYSTEM POINT | DESCRIPTION                                     | POINT |    |    |     | ALARMS |        |      |     | GRAPHIC | TREND |
|--------------|-------------------------------------------------|-------|----|----|-----|--------|--------|------|-----|---------|-------|
|              |                                                 | AI    | AO | DI | DON | NORMAL | SAFETY | HIGH | LOW |         |       |
| M-1          | MAIN BUILDING WATER METER (WATER USAGE GALLONS) | X     |    |    |     |        |        |      |     | X       | X     |


04 GAS AND DOMESTIC WATER METERS  
M501B Scale: NOT TO SCALE

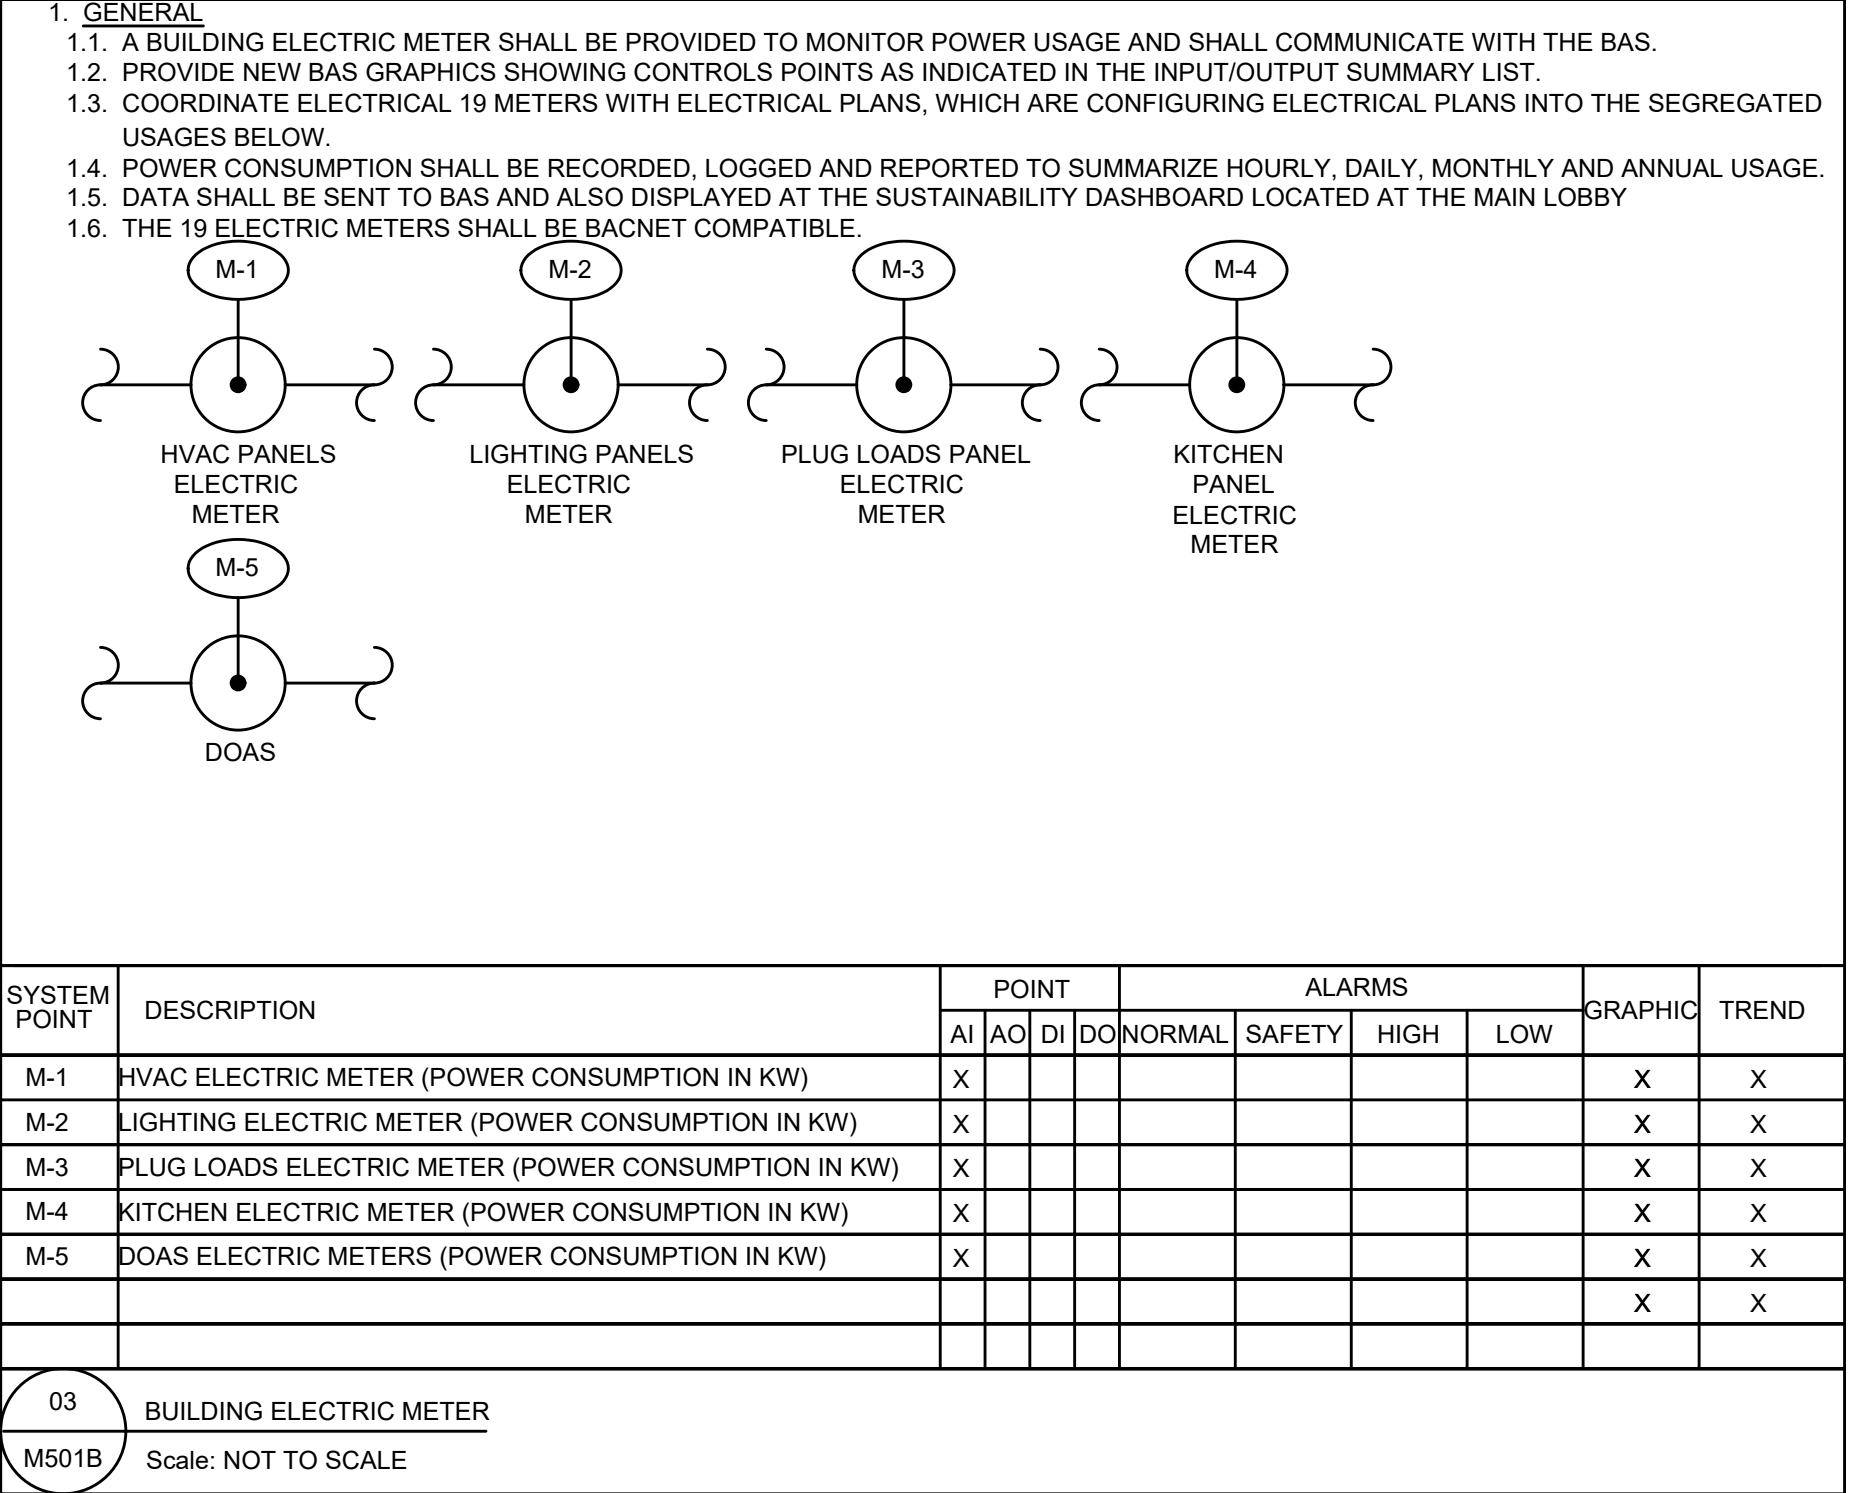

03 BUILDING ELECTRIC METER  
M501B Scale: NOT TO SCALE

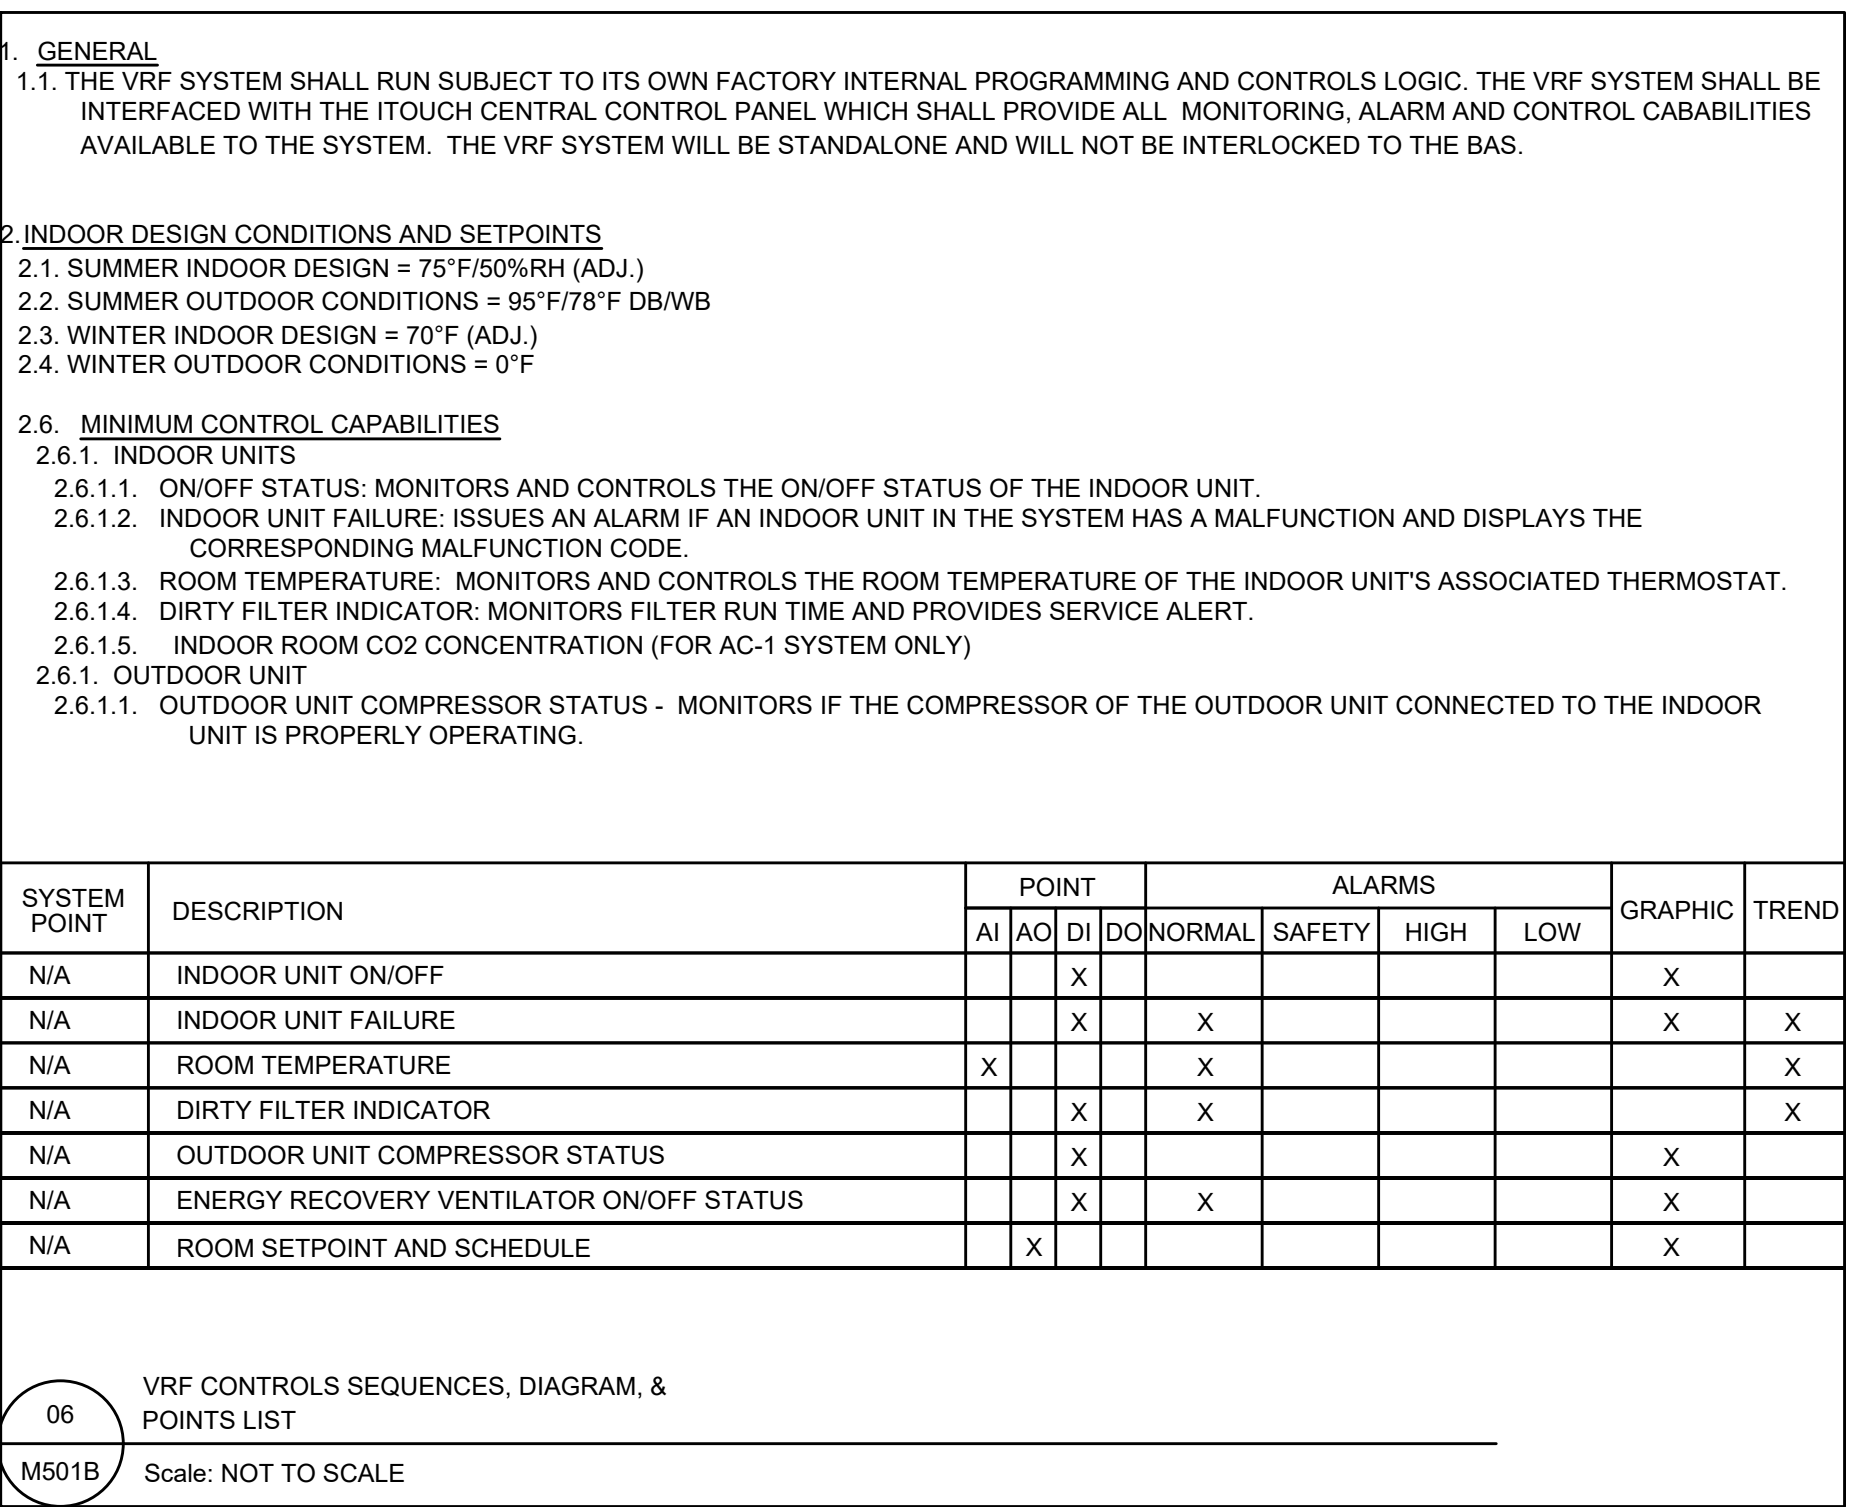

06 VRF CONTROLS SEQUENCES, DIAGRAM, & POINTS LIST  
M501B Scale: NOT TO SCALE

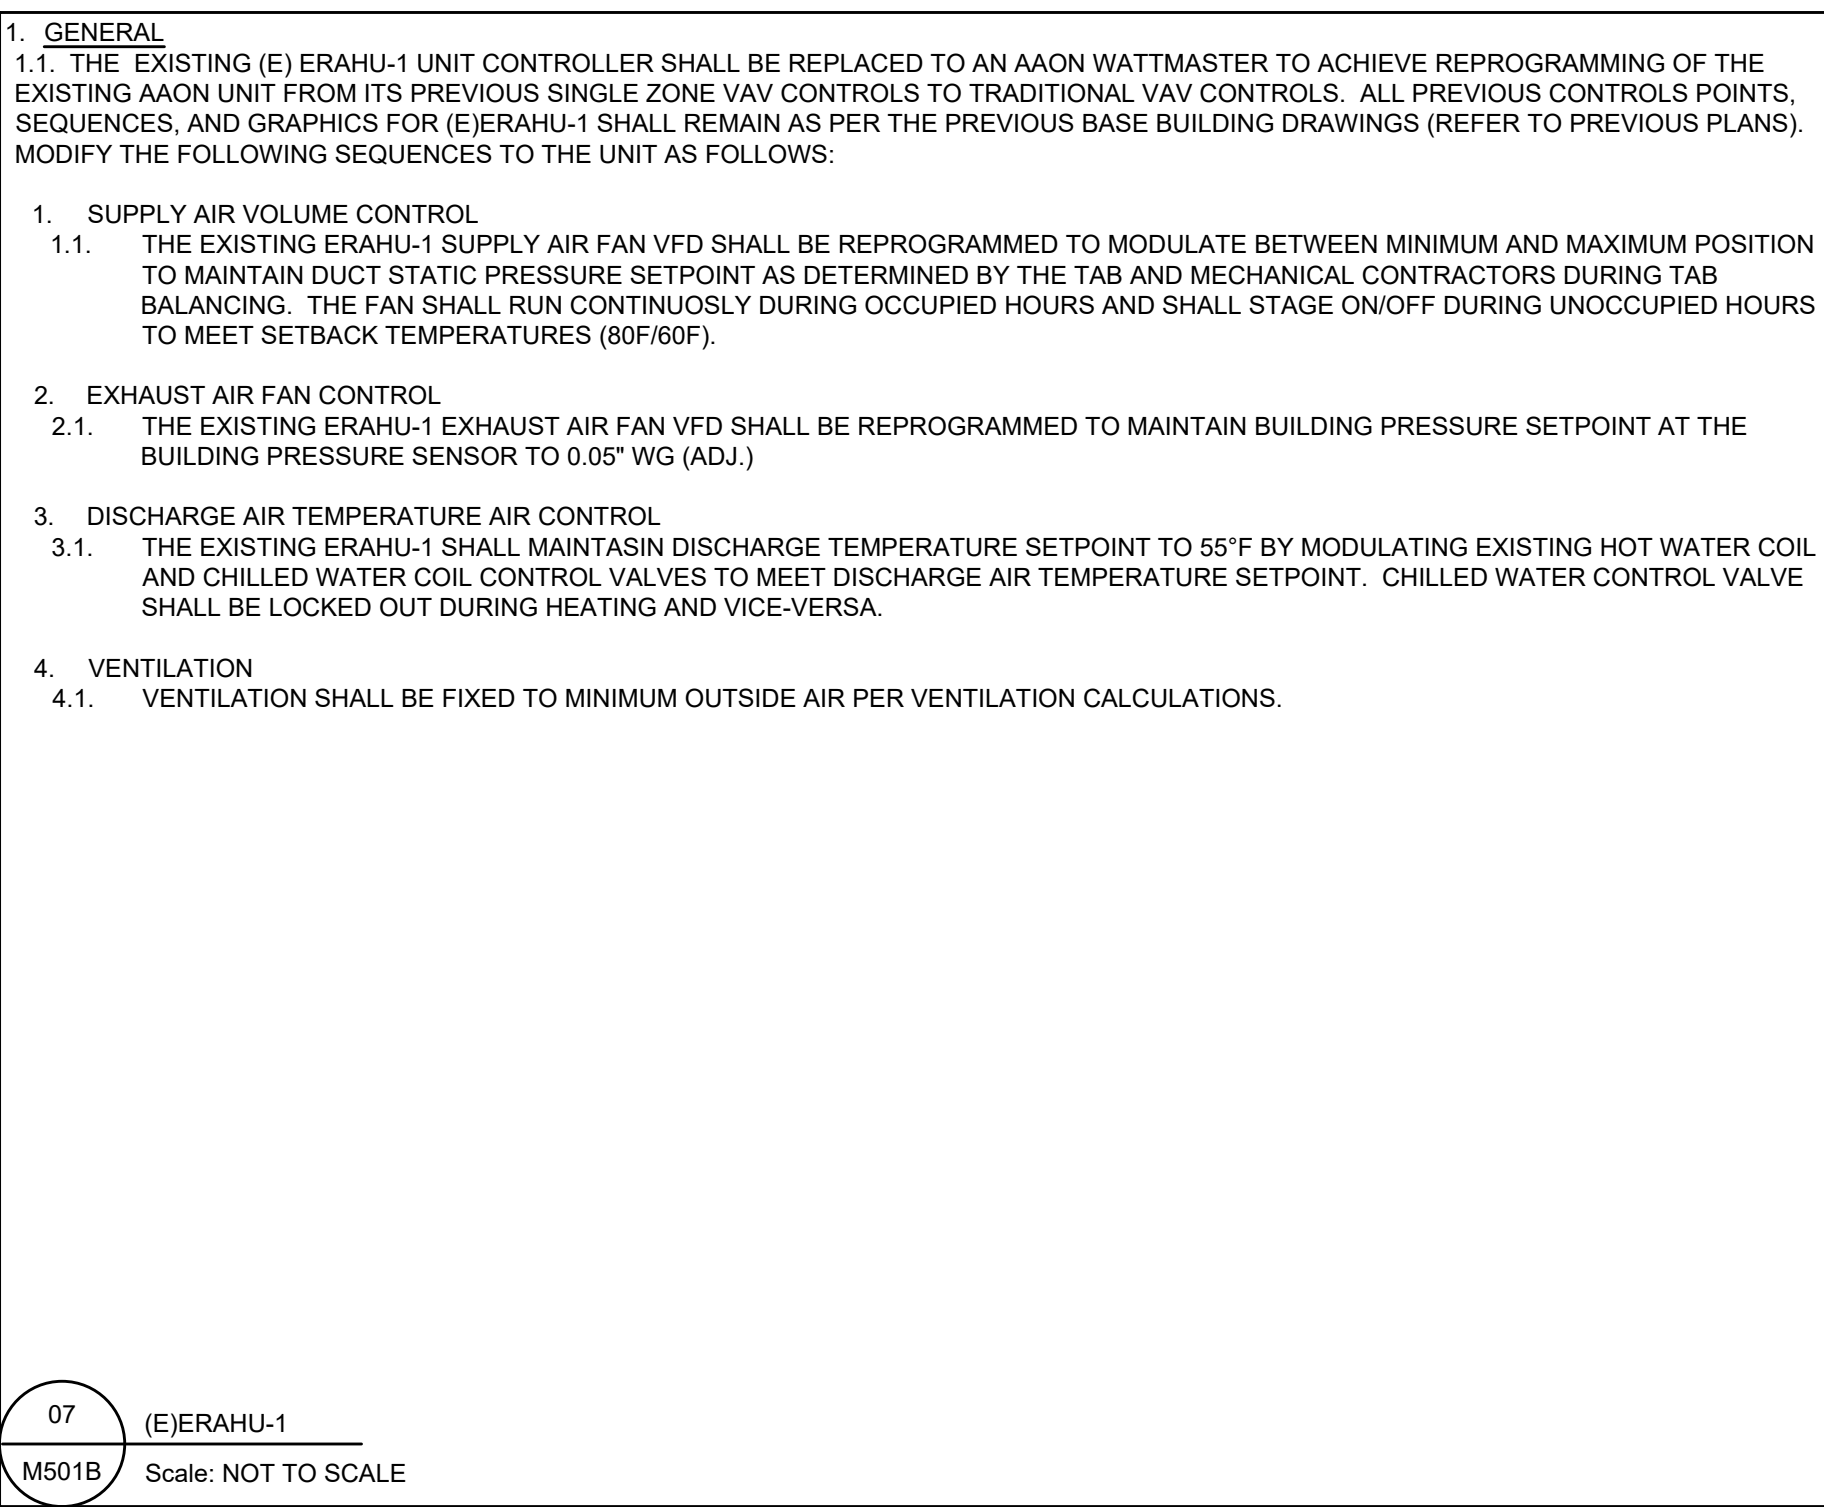

07 (E) ERAHU-1  
M501B Scale: NOT TO SCALE

THIS AREA RESERVED FOR USA STAMPS

**shinberg.levinas**

Shinberg Levinas Architectural Design Inc. 5101 Wisconsin Ave #310 T 202.244.5101  
1033 31ST ST SE  
WASHINGTON, DC 20016 F 202.244.5363

Designs and drawings are protected by copyright, and may not be re-used, copied or reproduced without the written consent of the owner.

© Copyright 2023 Shinberg Levinas Architectural Design Inc.  
All rights reserved worldwide.

**STODDERT ES WEST END CAFETERIA**

4001 CALVERT ST, NW  
WASHINGTON, DC 20007

**OWNER**  
DISTRICT OF COLUMBIA  
DC DEPARTMENT OF GENERAL SERVICES (DGS)  
DC PUBLIC SCHOOLS (DCPS)

**CIVIL ENGINEER**  
WILES MENSCH CORPORATION - DC  
510 8TH ST SE  
WASHINGTON, DC 20003  
(202) 638-4040

**LANDSCAPE ARCHITECT**  
BRADLEY SITE DESIGN  
1010 WISCONSIN AVE NW, #208  
WASHINGTON, DC 20007  
(202) 695-8056

**STRUCTURAL ENGINEER**  
SILMAN ASSOCIATES  
1033 31ST NW  
WASHINGTON, DC 20007  
(202) 333-6230

**MEP + FP ENGINEER**  
GLOBAL ENGINEERING SOLUTIONS OF WASHINGTON DC (GES)  
4400 JENIFER ST NW #240,  
WASHINGTON, DC 20015  
(202) 295-7746

**LIGHTING**  
GM KLING + ASSOCIATES  
1033 CAMERON ST  
ALEXANDRIA, VA 22314  
(703) 684-6270

**KITCHEN / FOOD SERVICE**  
NYKOS-GARCIA FOODSERVICE DESIGN  
18219-A FLOWER HILL WAY  
GATHERSBURG, MD 20879  
(240) 665-9530

**LEED CONSULTANT**  
DAN TRIMAN  
17 E 9TH ST  
FREDERICK, MD 21701  
(410) 300-036

**ISSUES**

| NO. | ISSUE                              | DATE       |
|-----|------------------------------------|------------|
| 1   | SCHEMATIC DESIGN - CAFETERIA       | 2023/12/01 |
| 2   | DESIGN DEVELOPMENT - CAFETERIA     | 2024/02/28 |
| 3   | SCHEMATIC DESIGN (2) - CAFETERIA   | 2024/06/14 |
| 4   | DESIGN DEVELOPMENT (2) - CAFETERIA | 2024/07/15 |
| 5   | PERMIT SET - CAFETERIA             | 2024/10/31 |
| 6   | 50% CD SET - CAFETERIA             | 2024/12/23 |
| 7   | 100% CD SET - CAFETERIA            | 2025/06/06 |
| 8   |                                    |            |
| 9   |                                    |            |
| 10  |                                    |            |
| 11  |                                    |            |
| 12  |                                    |            |
| 13  |                                    |            |
| 14  |                                    |            |
| 15  |                                    |            |
| 16  |                                    |            |
| 17  |                                    |            |
| 18  |                                    |            |
| 19  |                                    |            |
| 20  |                                    |            |

**SEAL**

DATE: 06/06/2025

SCALE: 1/8" = 1'-0"

**MECHANICAL - CONTROLS**

**M501B**