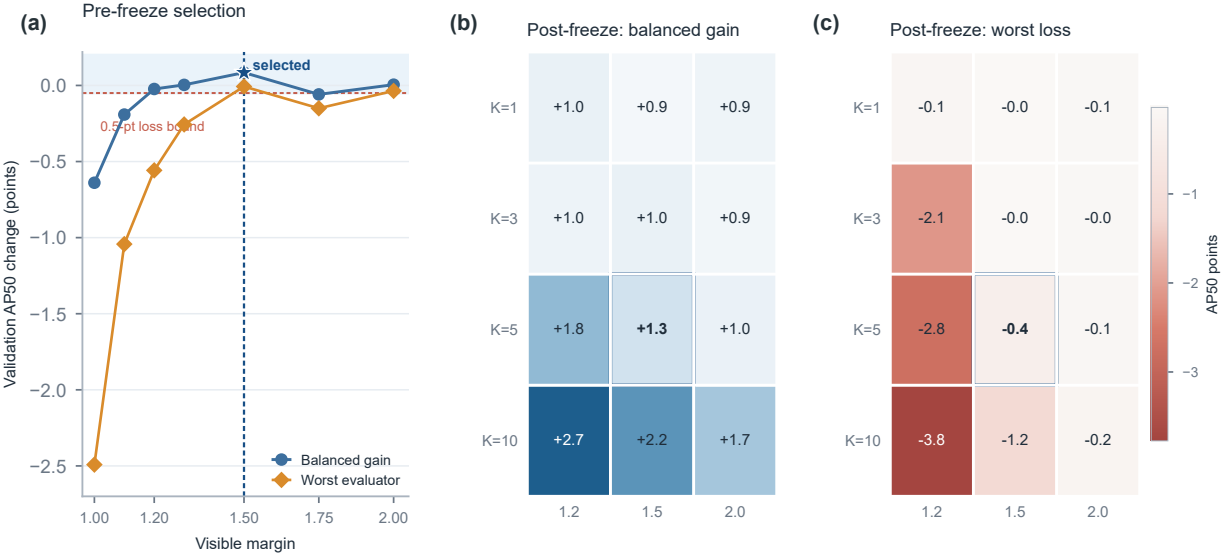


Margin 1.5 was selected before confirmation; all other test cells are descriptive.