

CASE-017 · Panel A

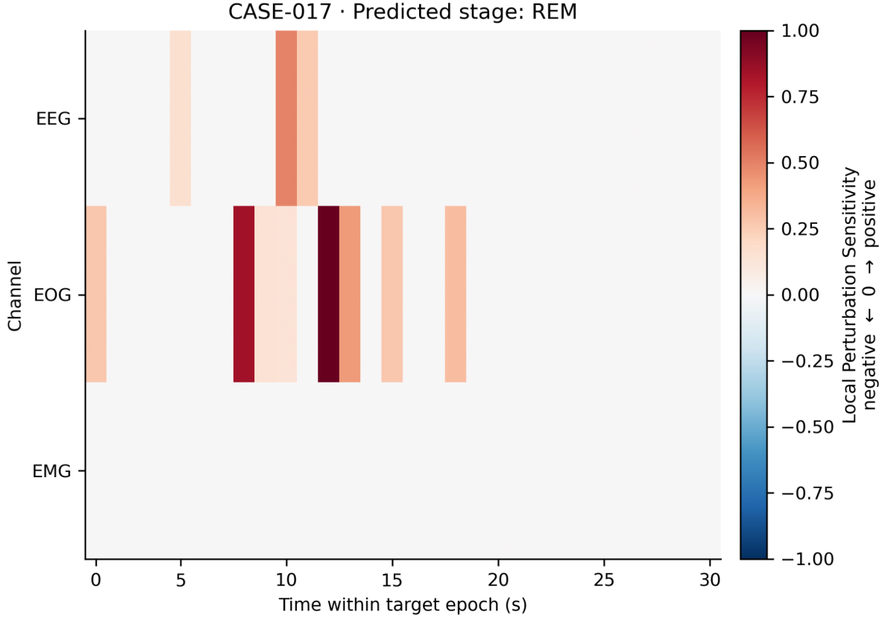

Frozen artifact contains no negative entries; the shared signed scale is retained.

CASE-017 · Panel B

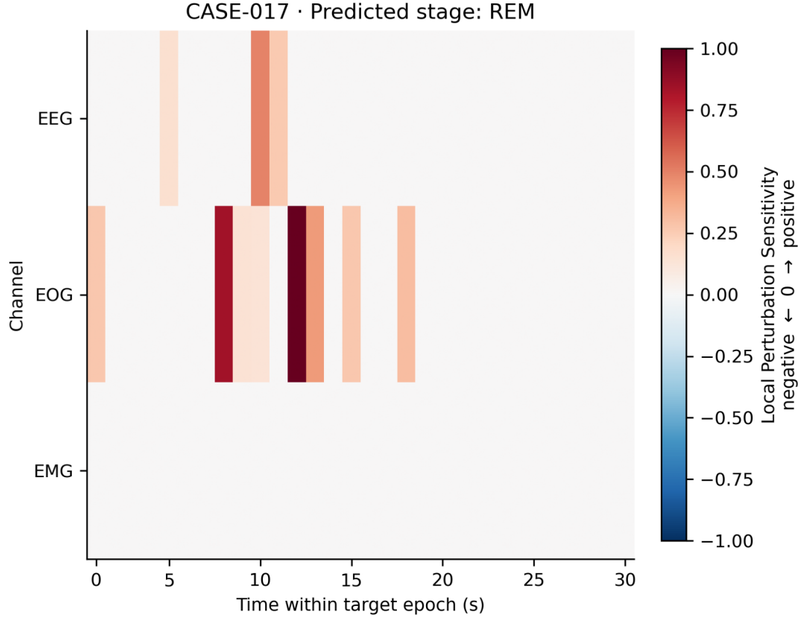

Derived physiological annotation
1. EOG Rapid Eye: 1.452
2. EOG Slow Eye: 0.666
3. EEG Delta: 0.664

Reliability audit
Status: RANDOMIZATION_UNRELIABLE
Surrogate fidelity: 0.777
Faithfulness: 0.042
Seed stability: 0.746
Randomization: UNRELIABLE

Target/context
Target: predicted class, T0
Context: preserved; not fused into heatmap

Evidence warning
Reliability gate not met; interpretation may mislead.

Derived annotation; expert validation pending.

Frozen artifact contains no negative entries; the shared signed scale is retained.