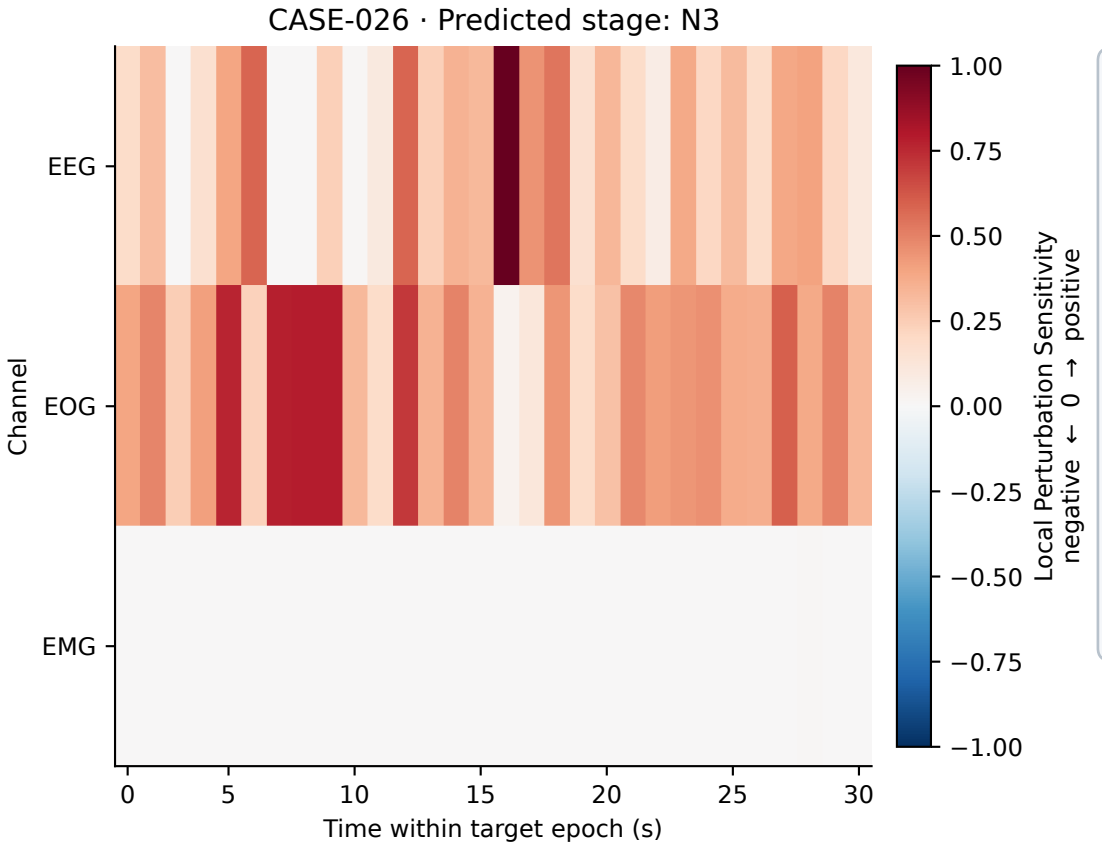

Derived physiological annotation
1. EOG Rapid Eye: 2.552
2. EEG Delta: 2.006
3. EOG Slow Eye: 1.623

Reliability audit
Status: RANDOMIZATION_UNRELIABLE
Surrogate fidelity: 0.746
Faithfulness: 4.411
Seed stability: 0.959
Randomization: UNRELIABLE

Target/context
Target: predicted class, T0
Context: preserved; not fused into heatmap

Evidence warning
Reliability gate not met; interpretation may mislead.

Derived annotation; expert validation pending.

Frozen artifact contains no negative entries; the shared signed scale is retained.