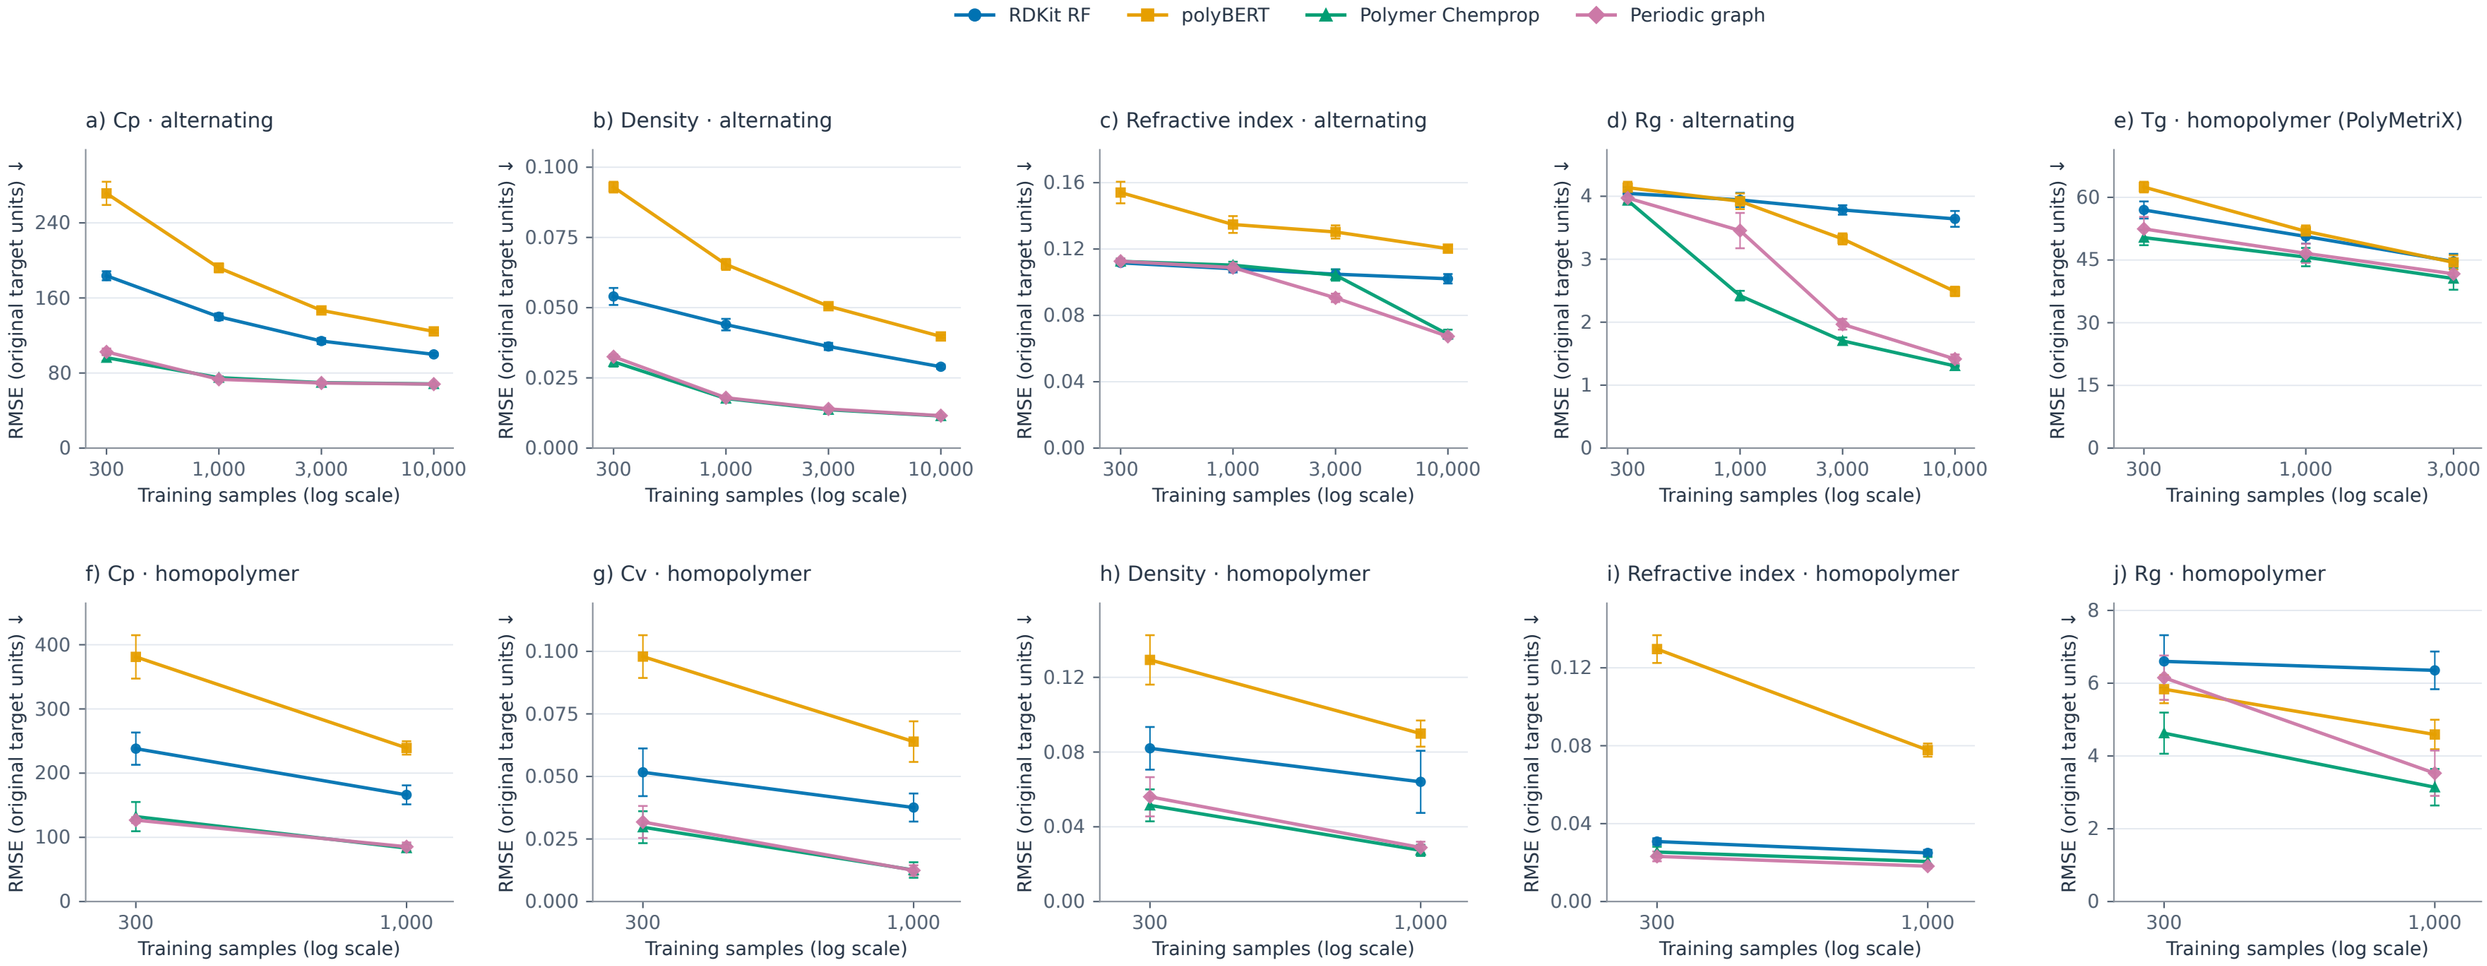
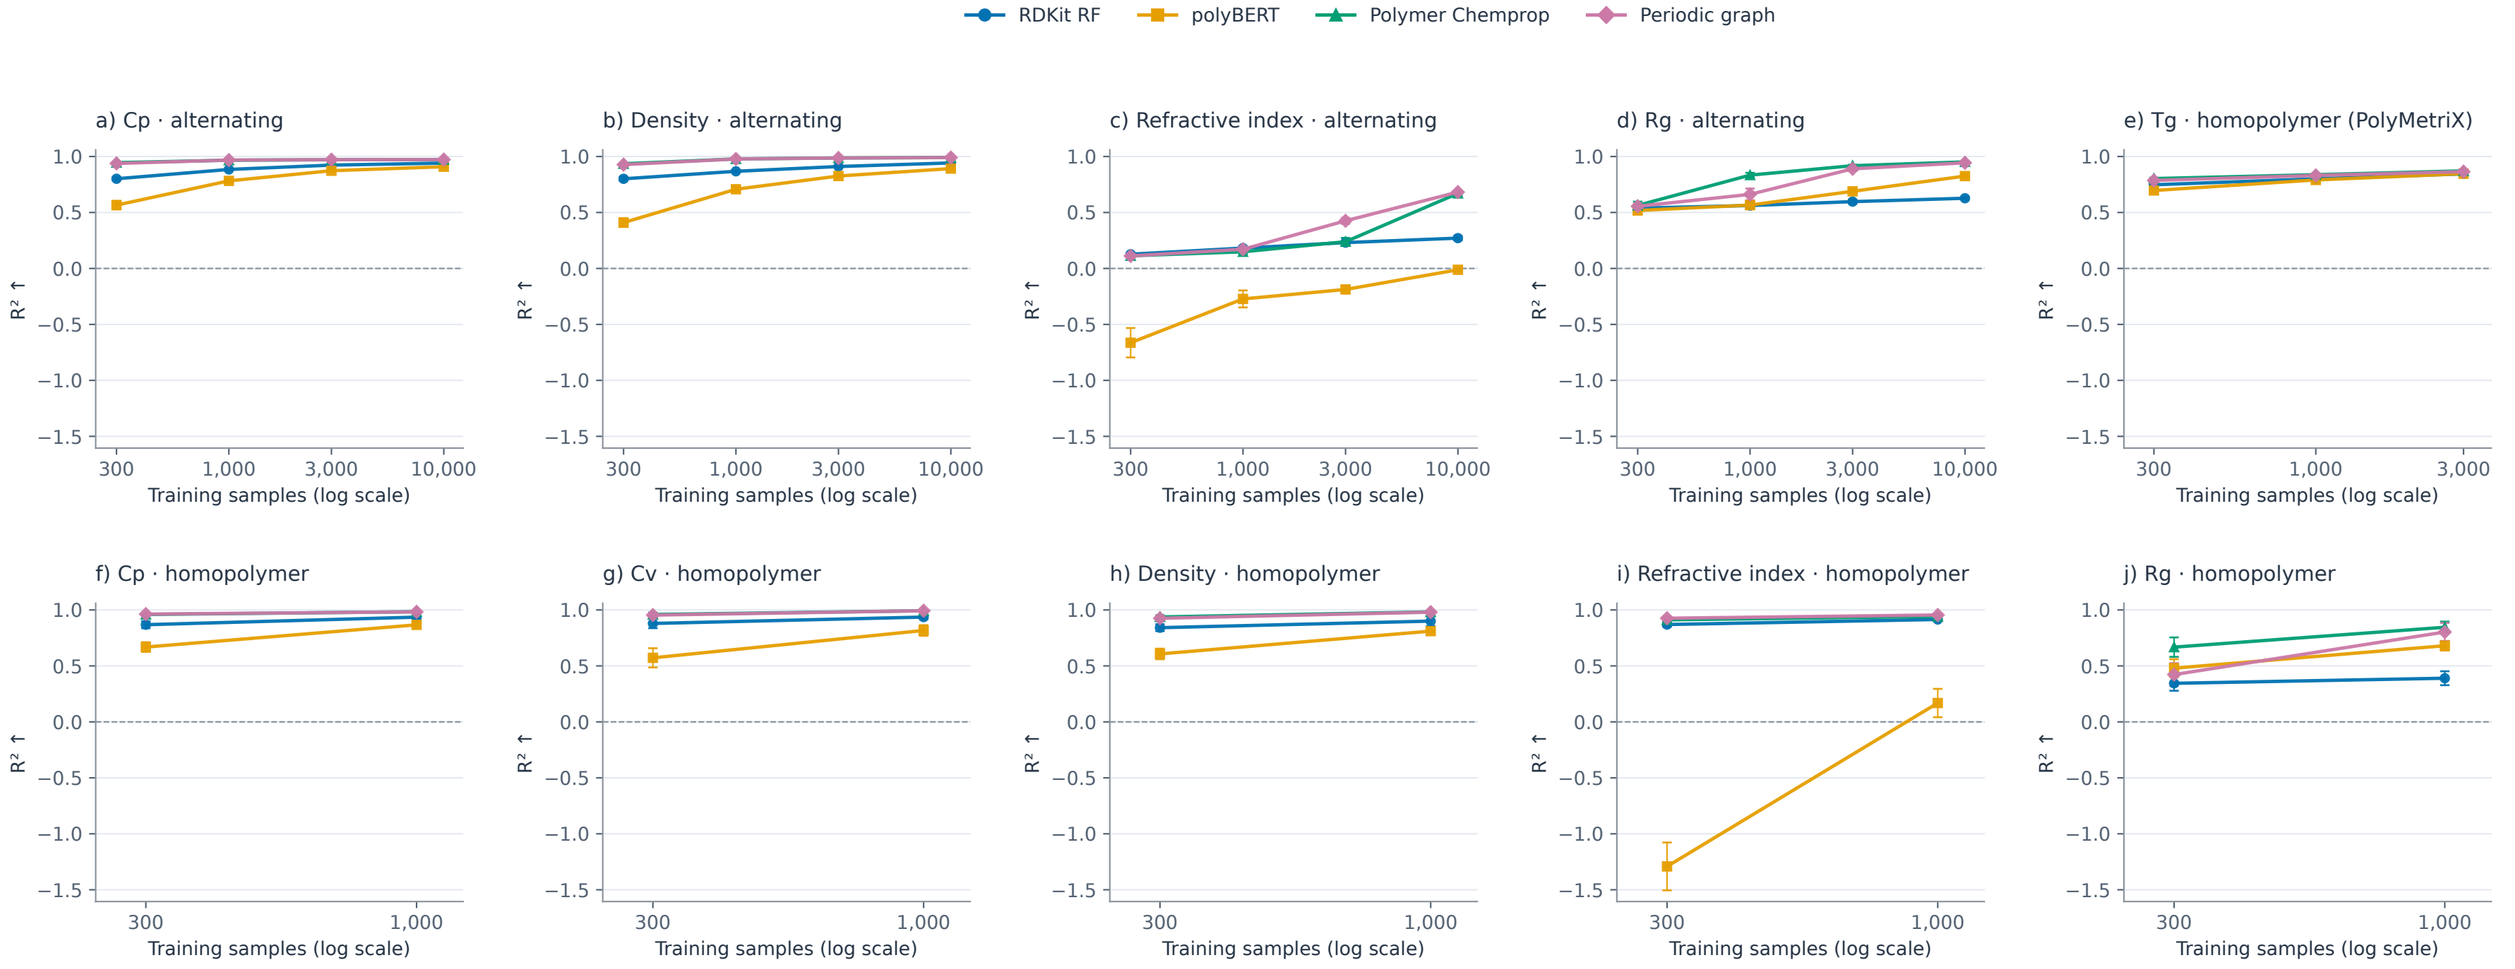
# Test RMSE — lower is better




Test only · 5 repeated splits · mean ± population SD (not confidence intervals). RMSE axes use condition-specific scales; do not compare magnitudes across properties.

$R^2$ is recovered from published fold errors and verified labels; these are not new training runs. All panels: MD_5000 unless labeled PolyMetriX.

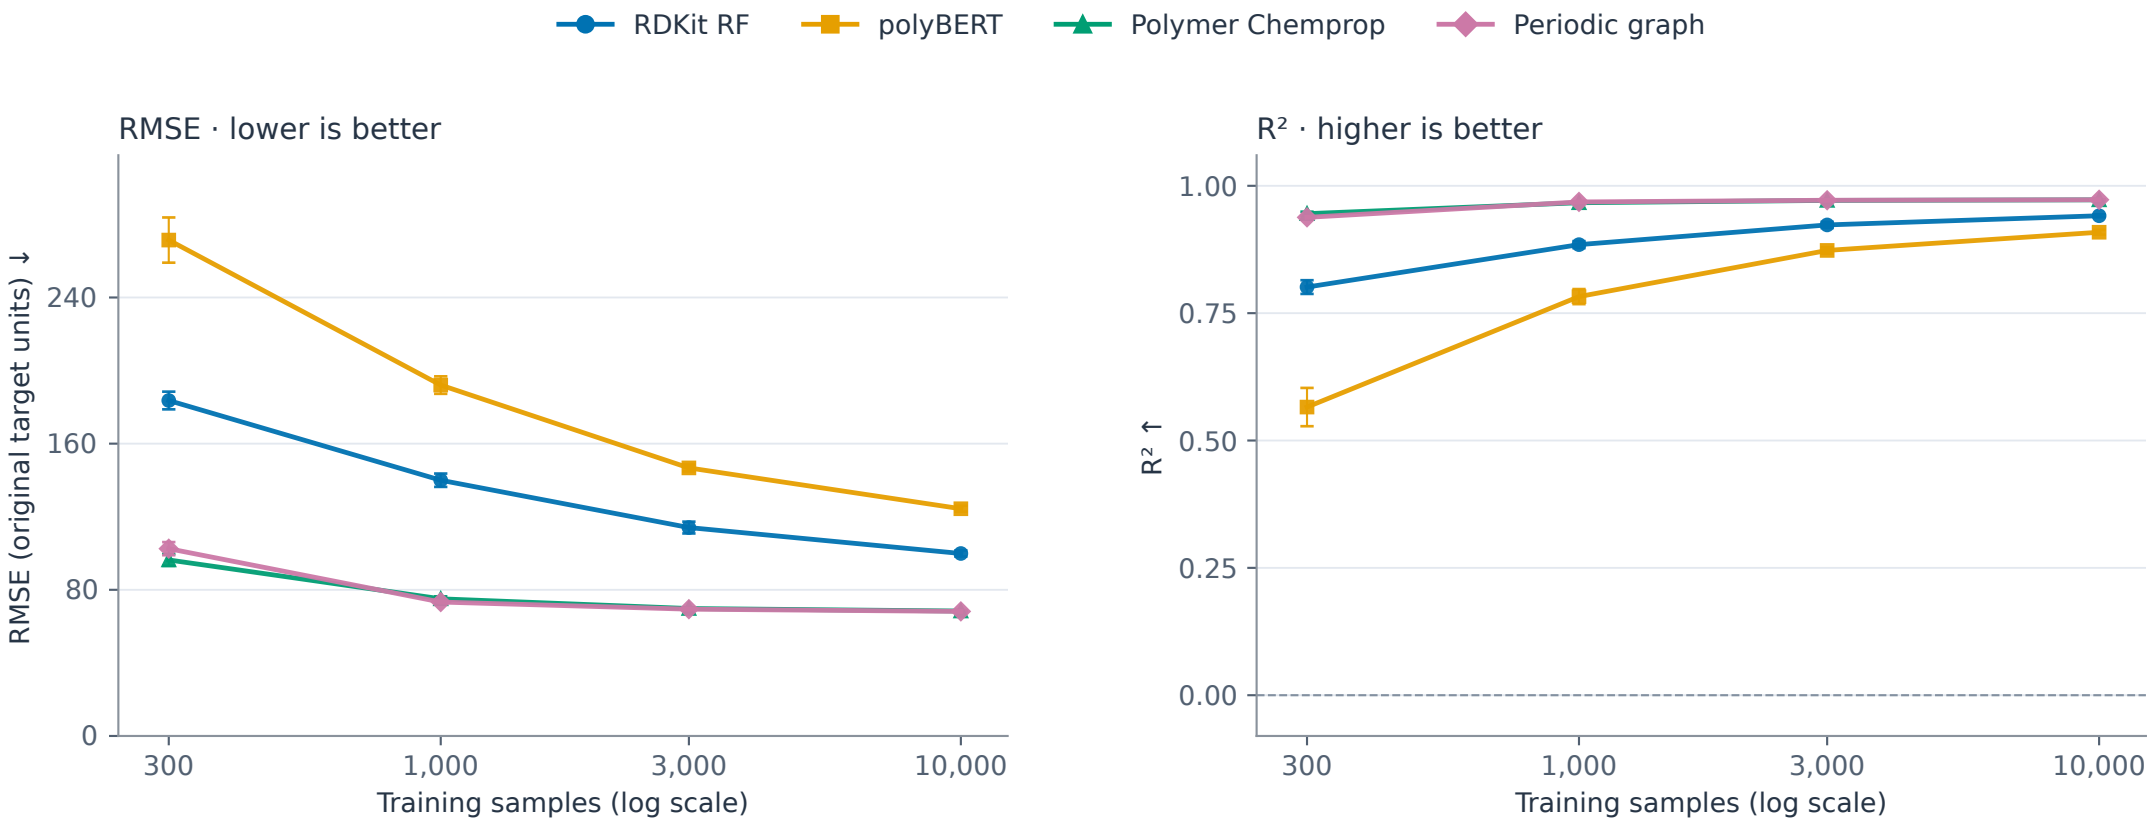
# Test R² — higher is better




Test only · 5 repeated splits · mean ± population SD (not confidence intervals). All overview panels share the same R² scale; negative values are retained.

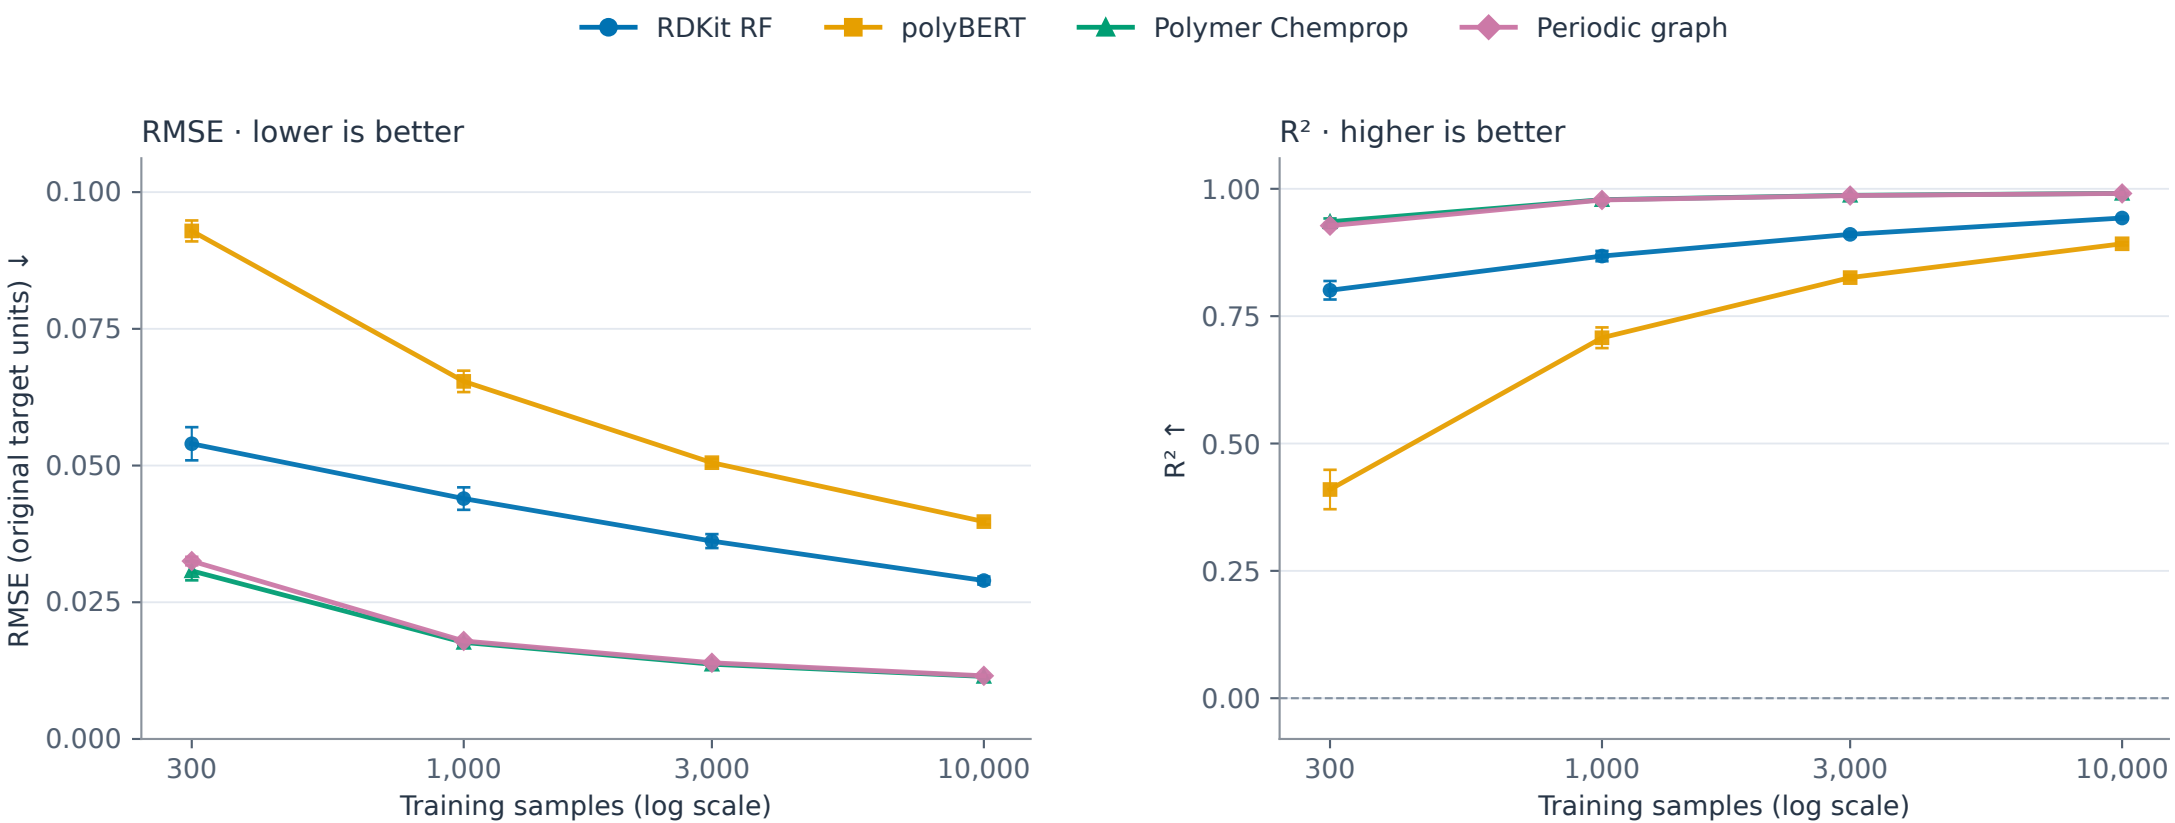
R² is recovered from published fold errors and verified labels; these are not new training runs. All panels: MD_5000 unless labeled PolyMetriX.

# Cp · alternating | MD_5000



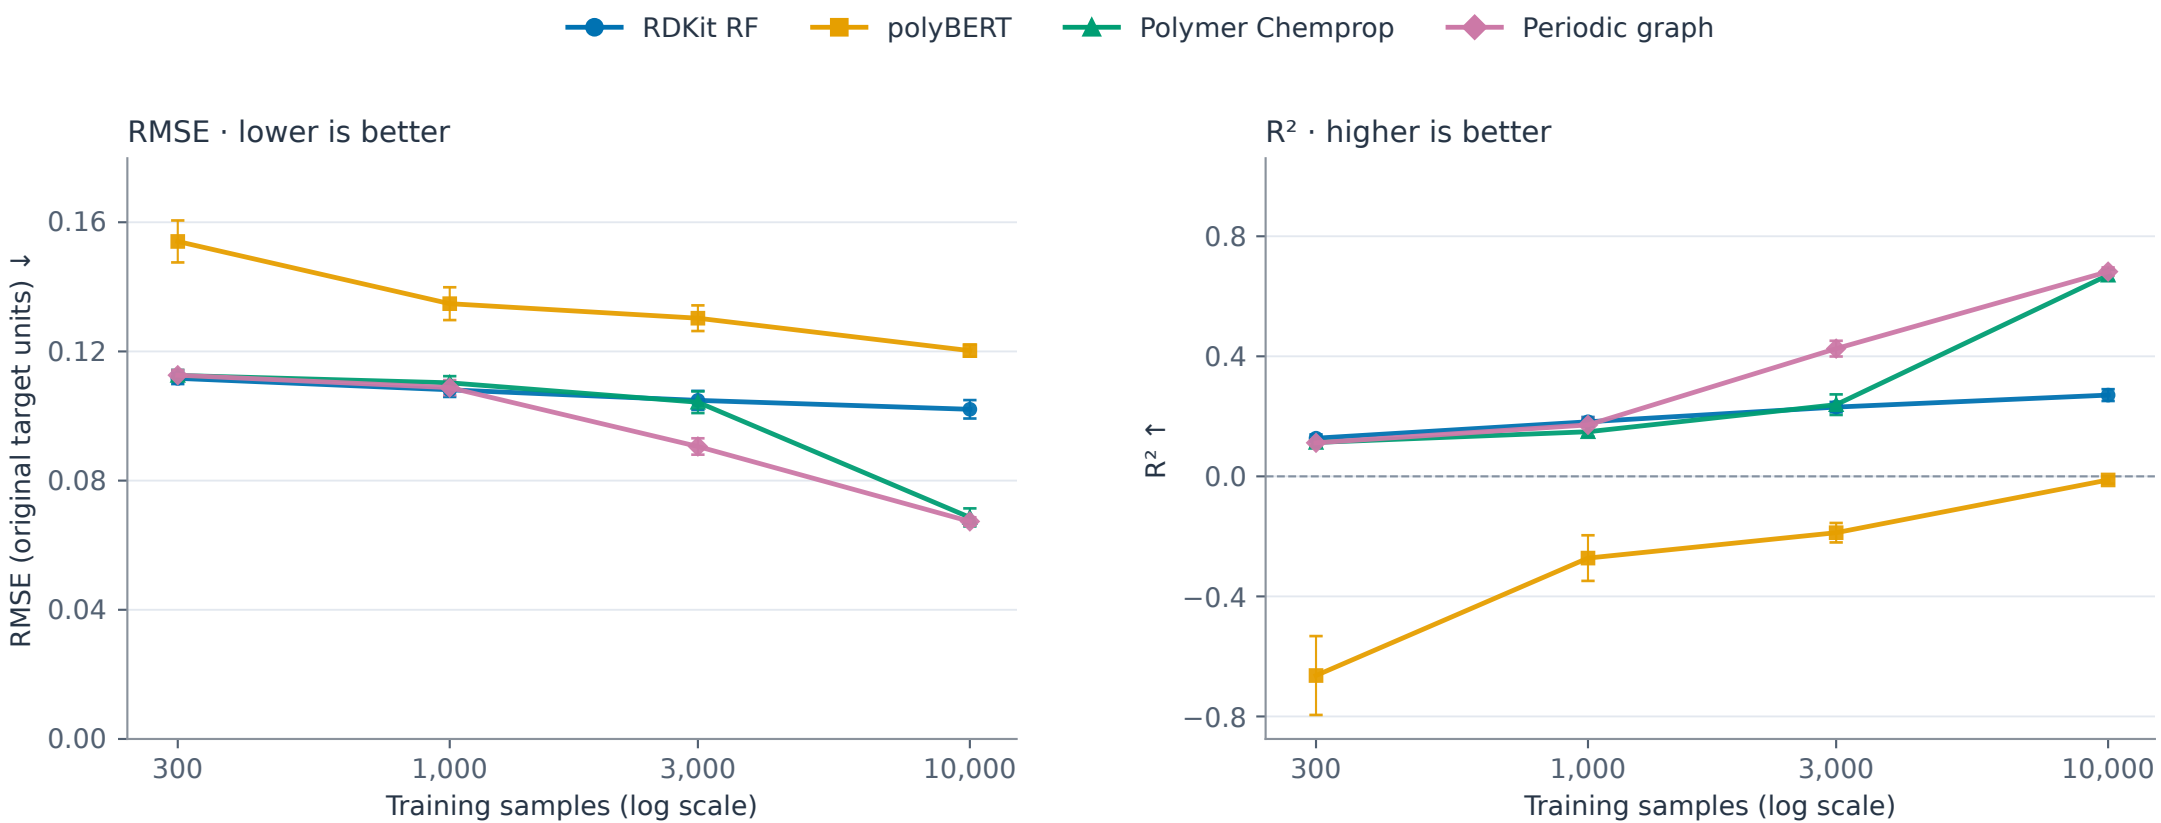

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Density · alternating | MD_5000



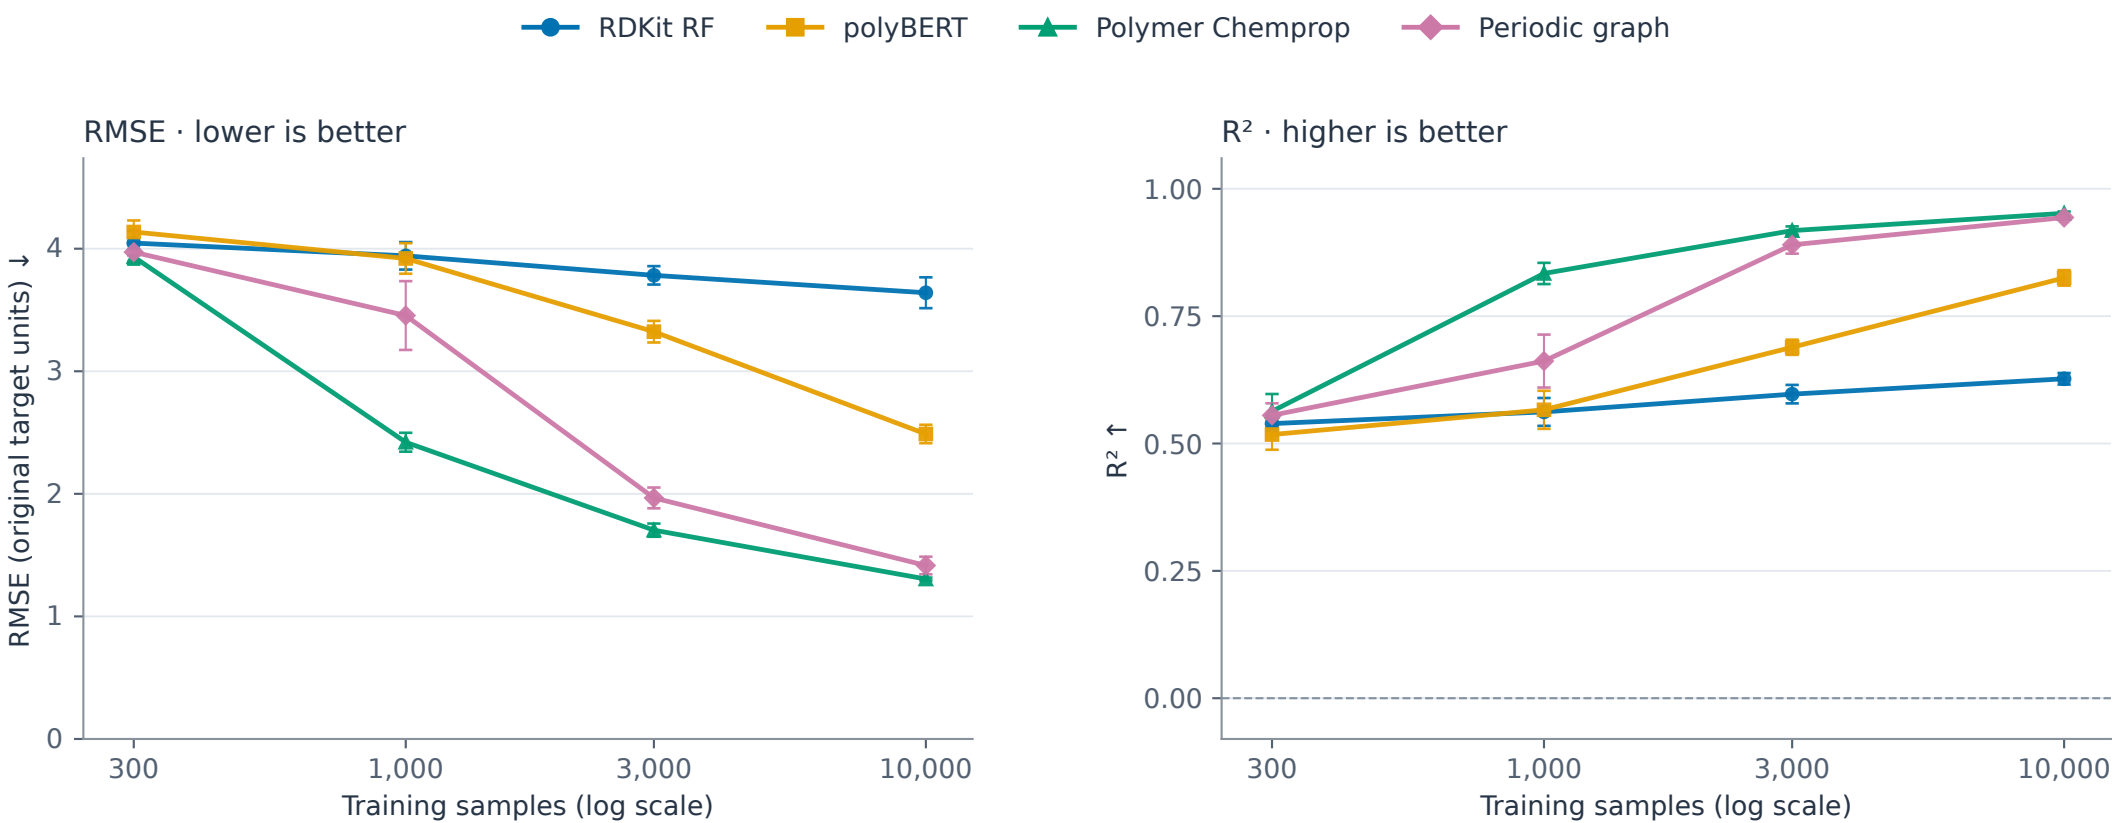

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Refractive index · alternating | MD_5000



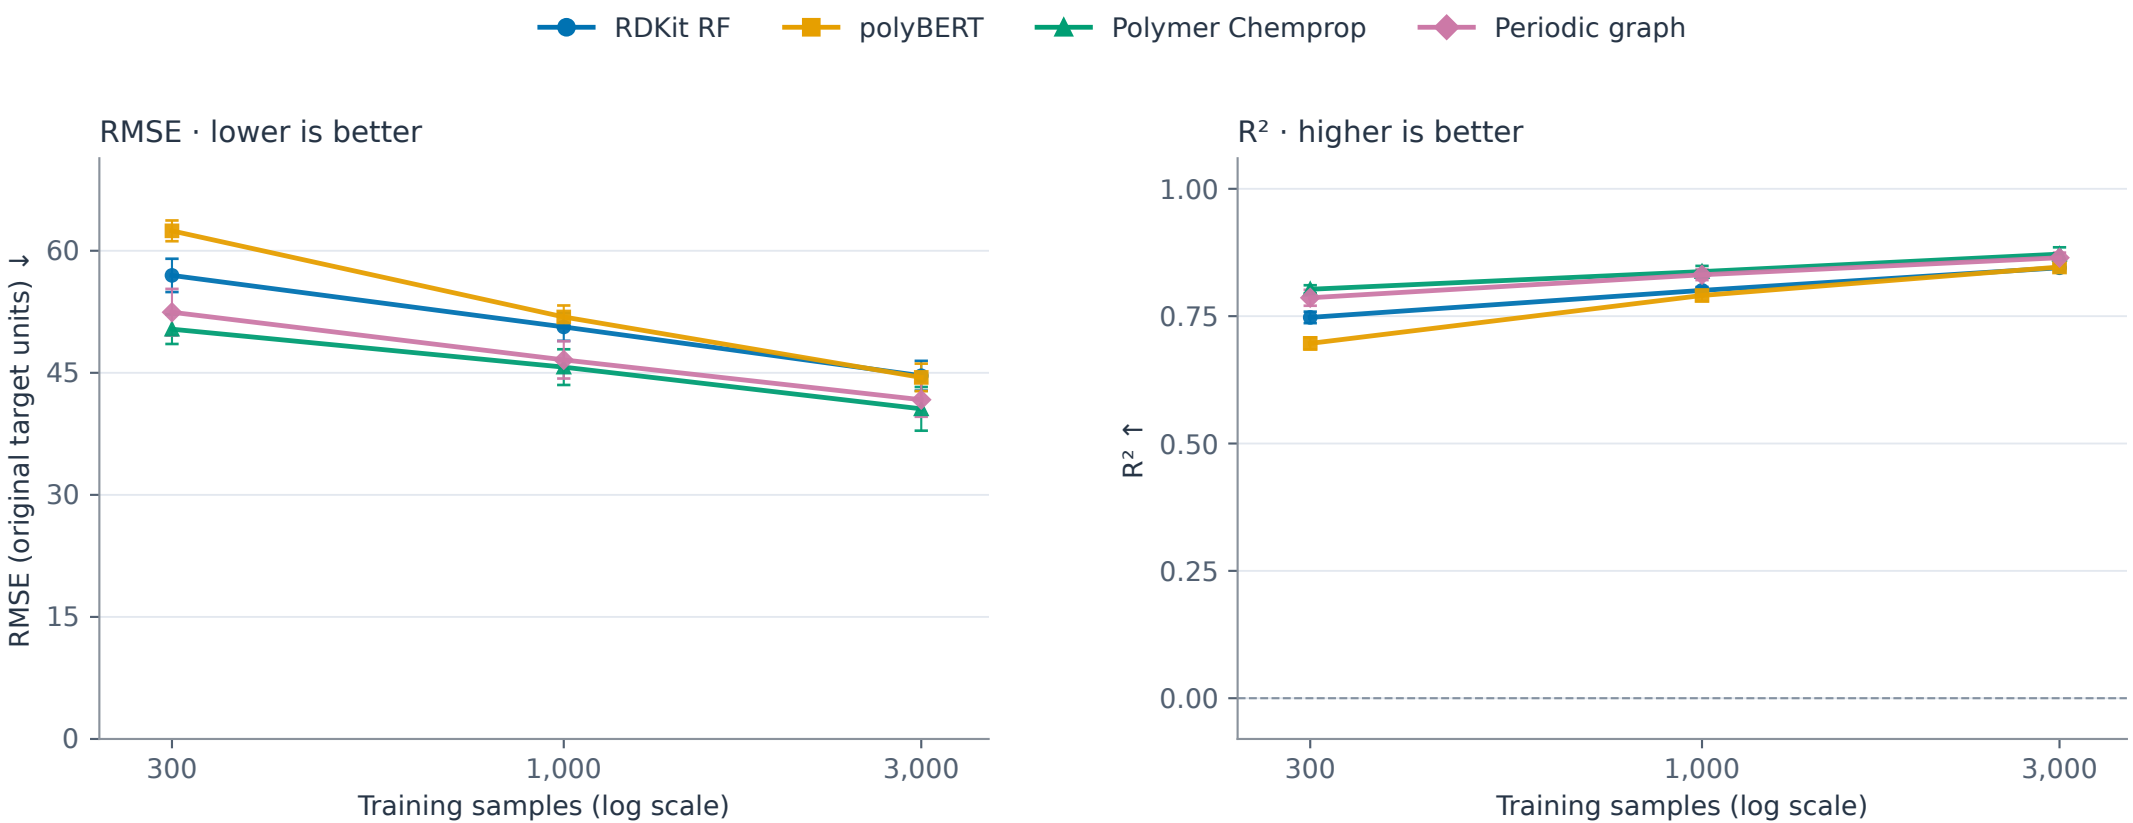

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Rg · alternating | MD_5000



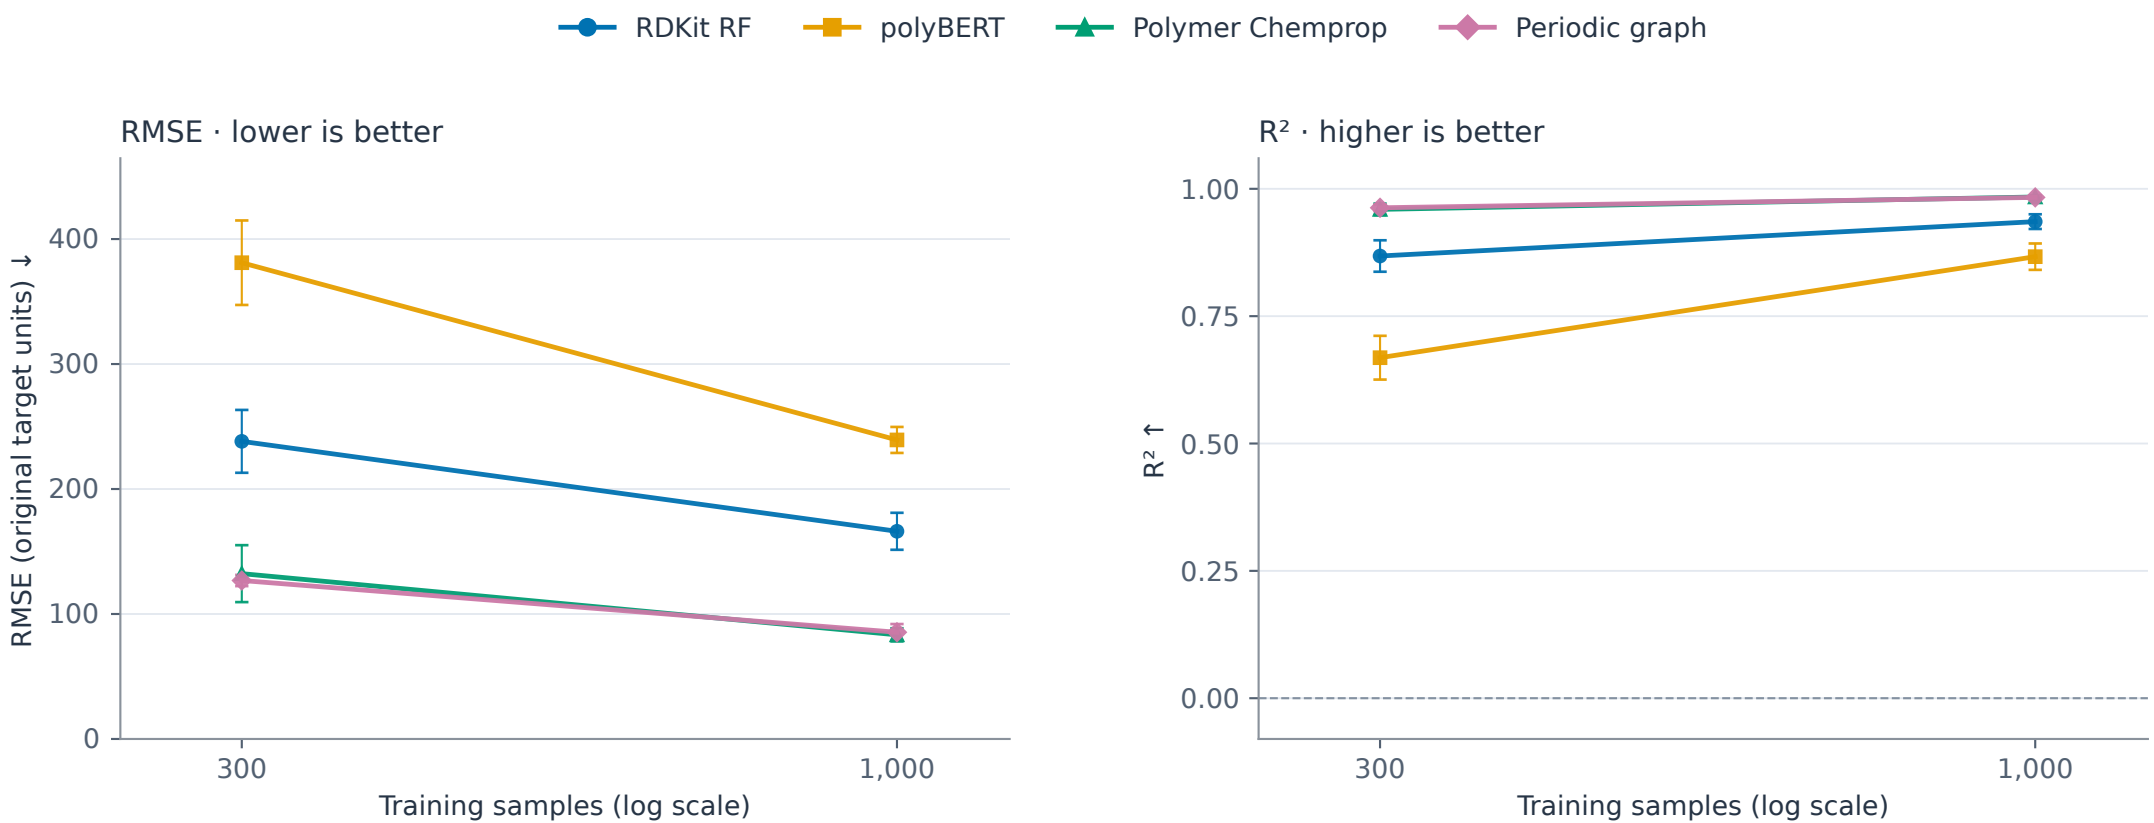

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Tg · homopolymer (PolyMetriX) | PolyMetriX



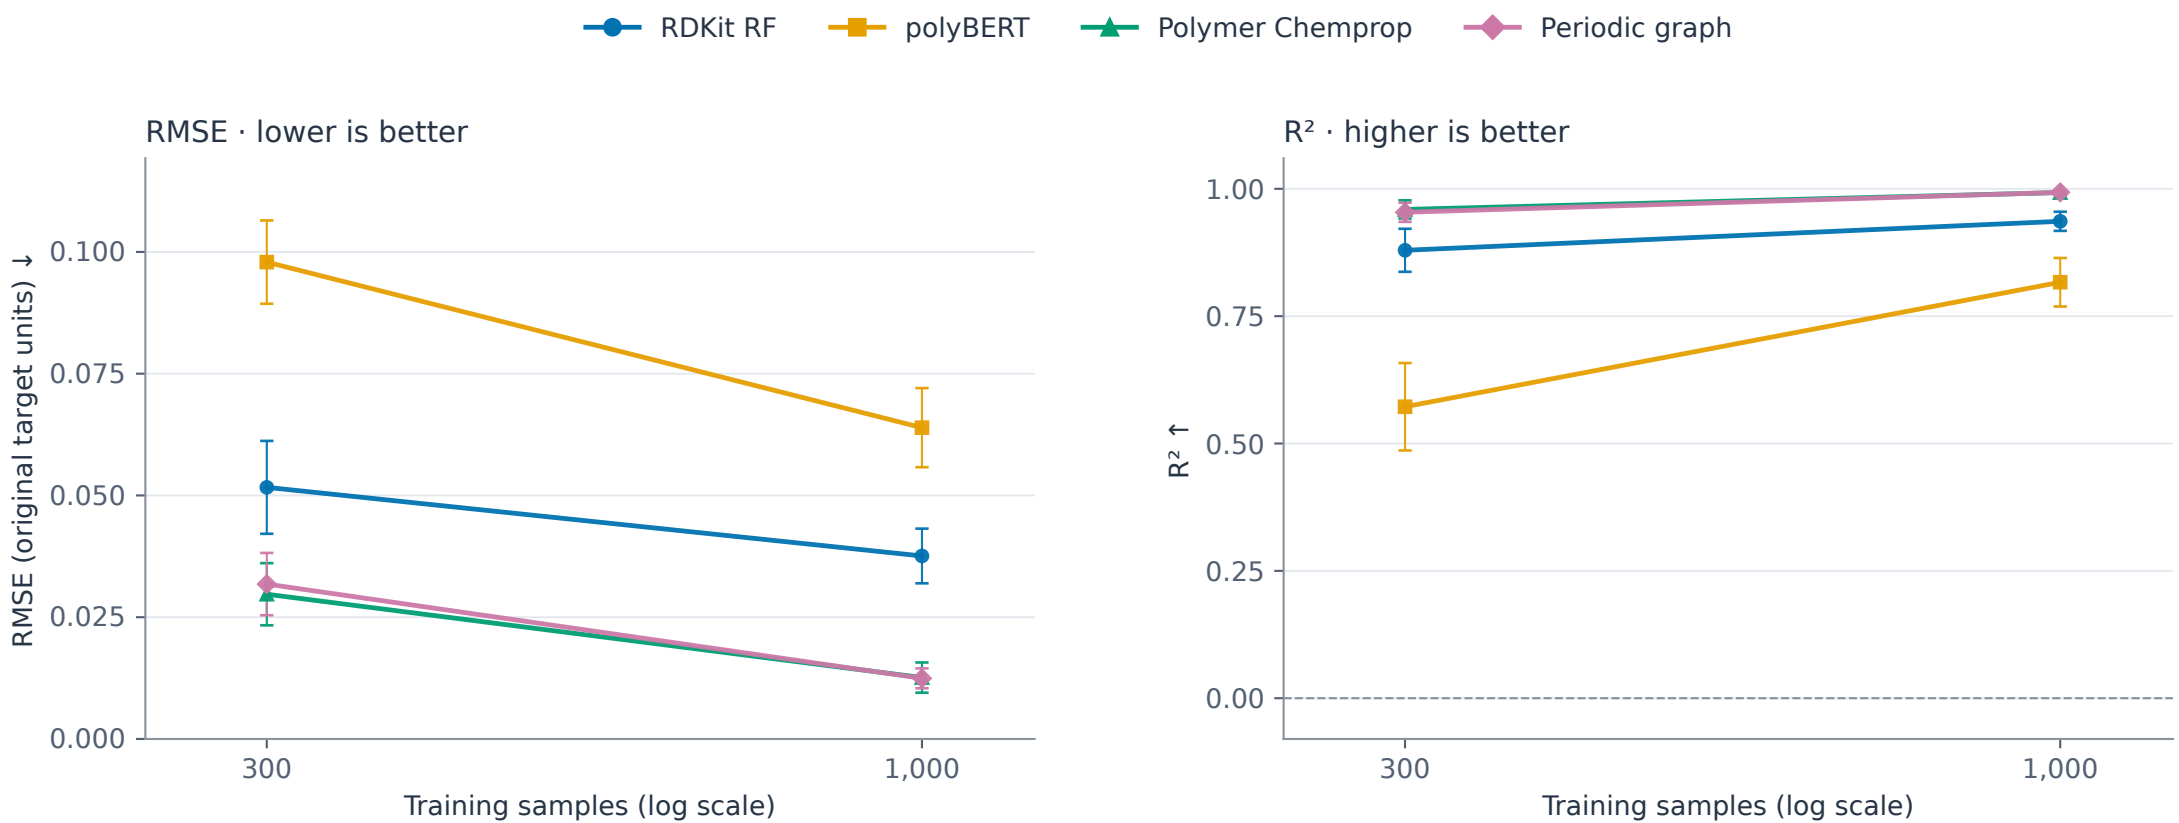

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Cp · homopolymer | MD_5000



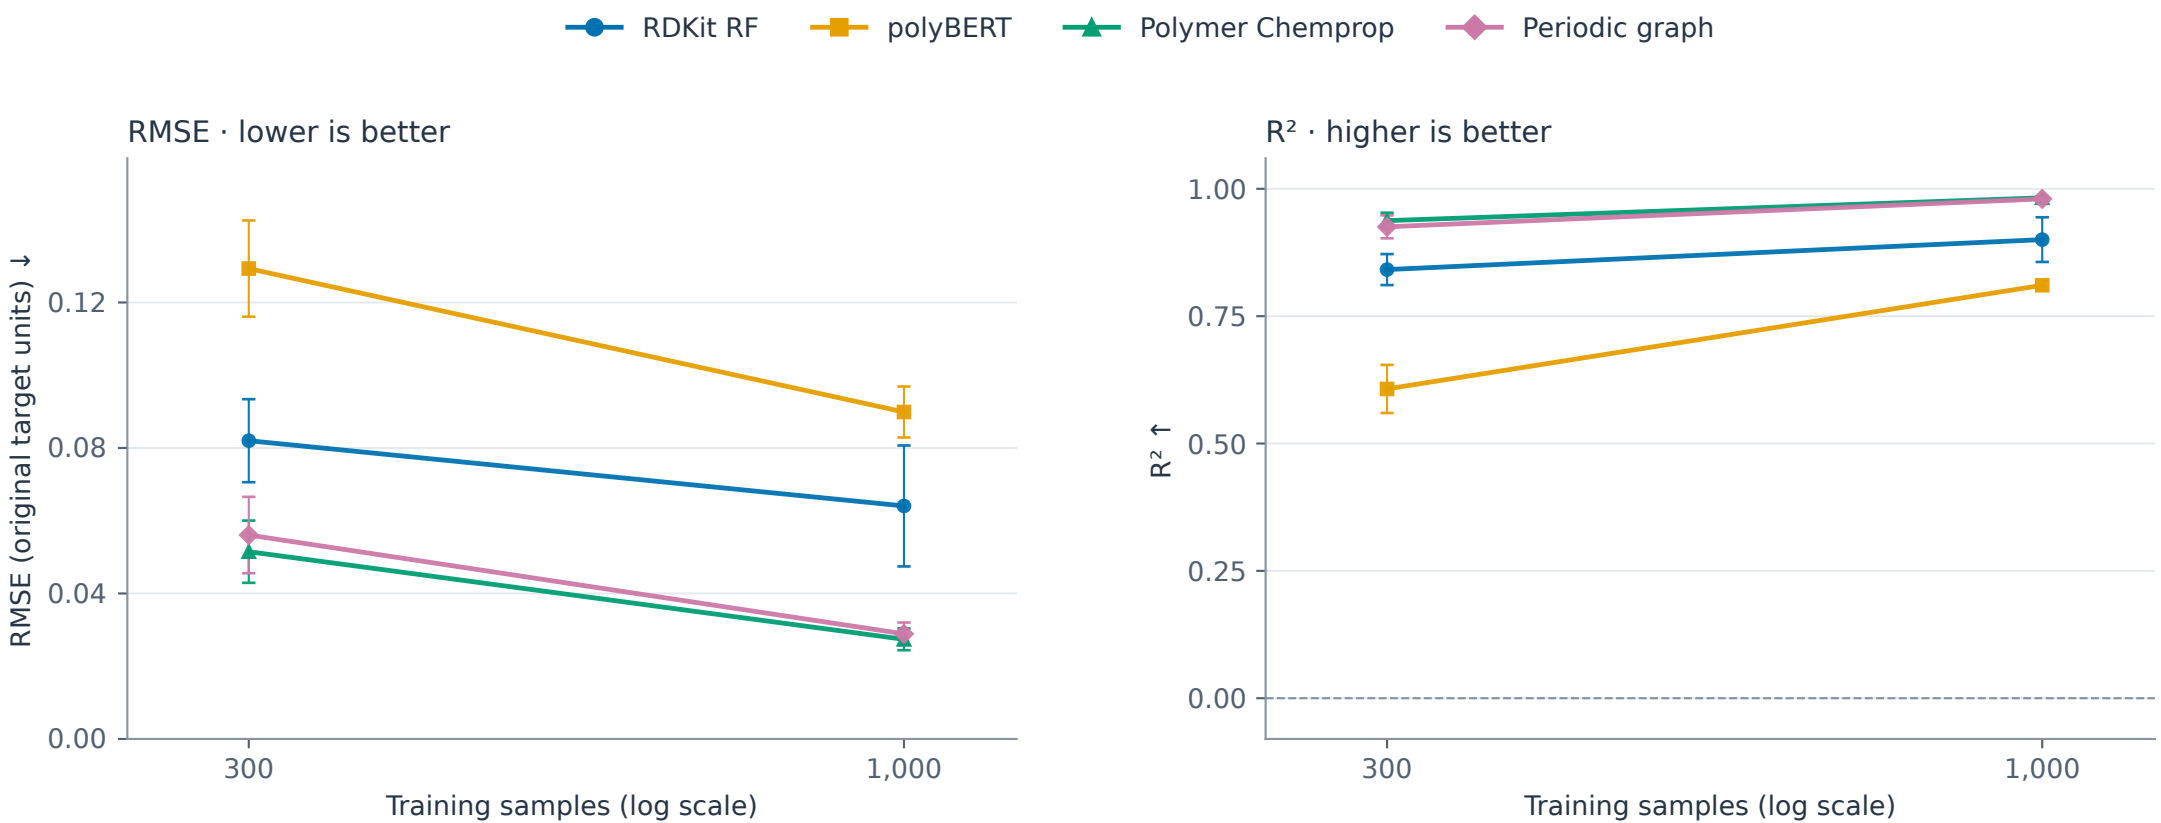

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Cv · homopolymer | MD_5000



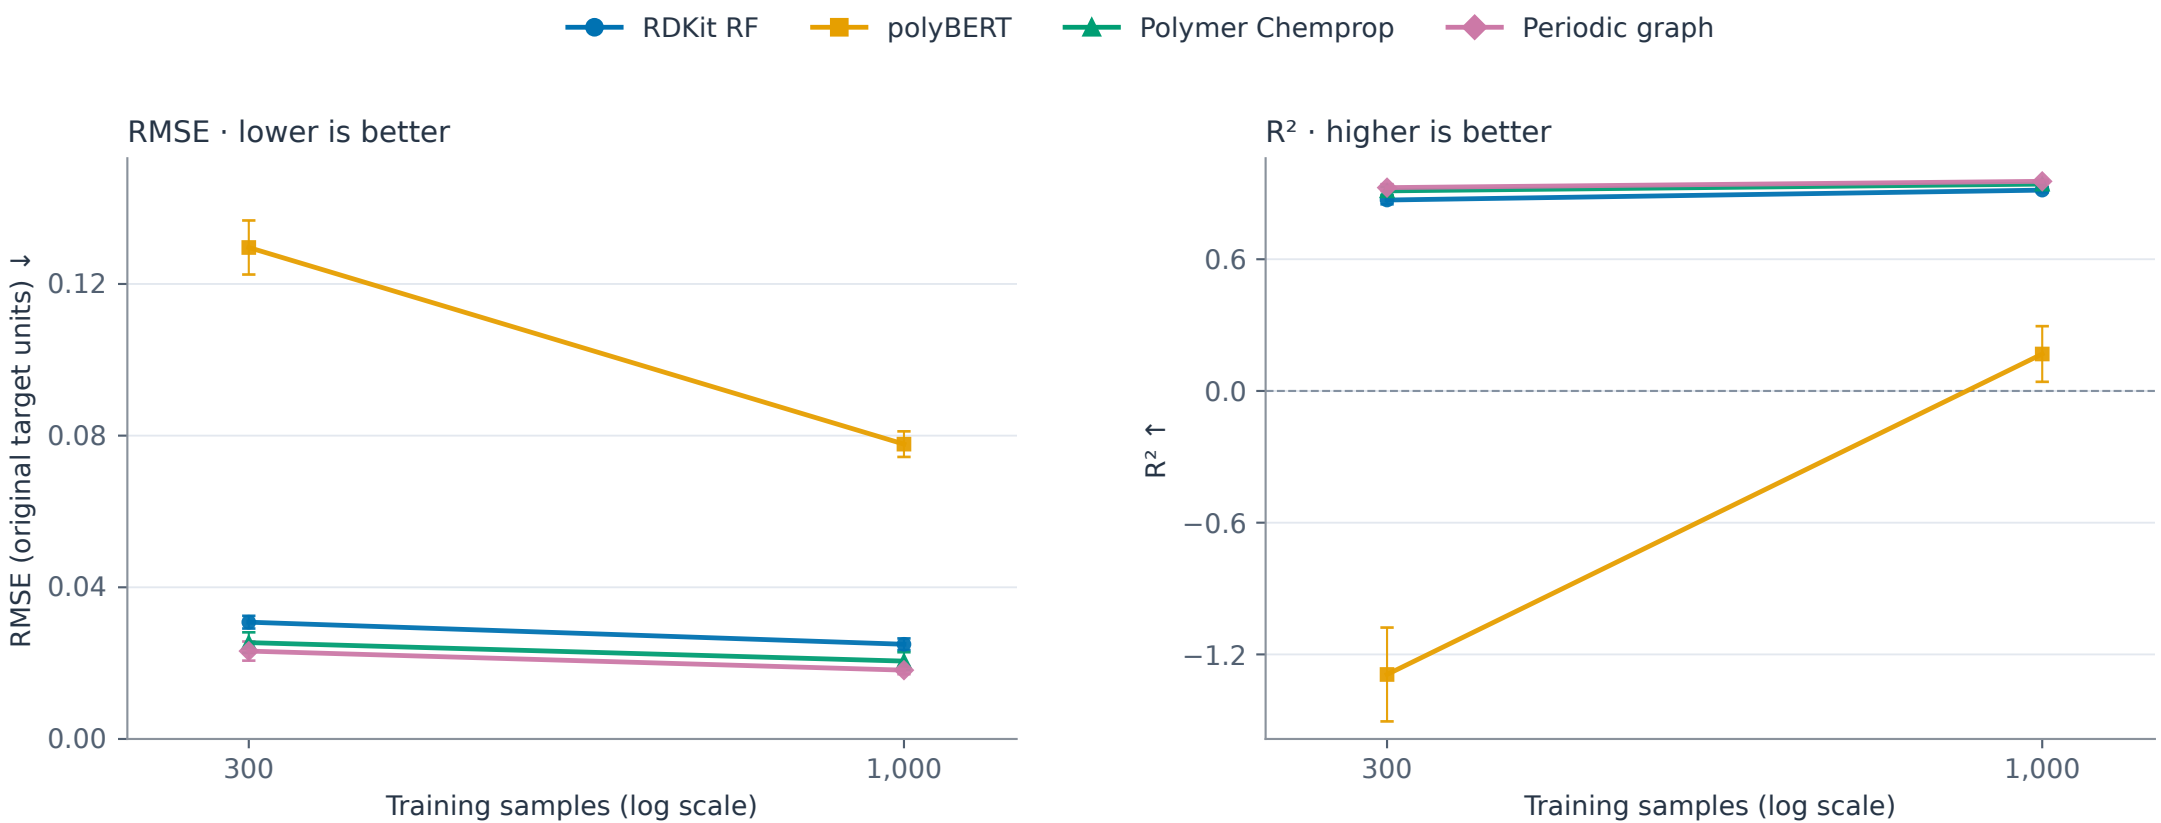

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Density · homopolymer | MD_5000



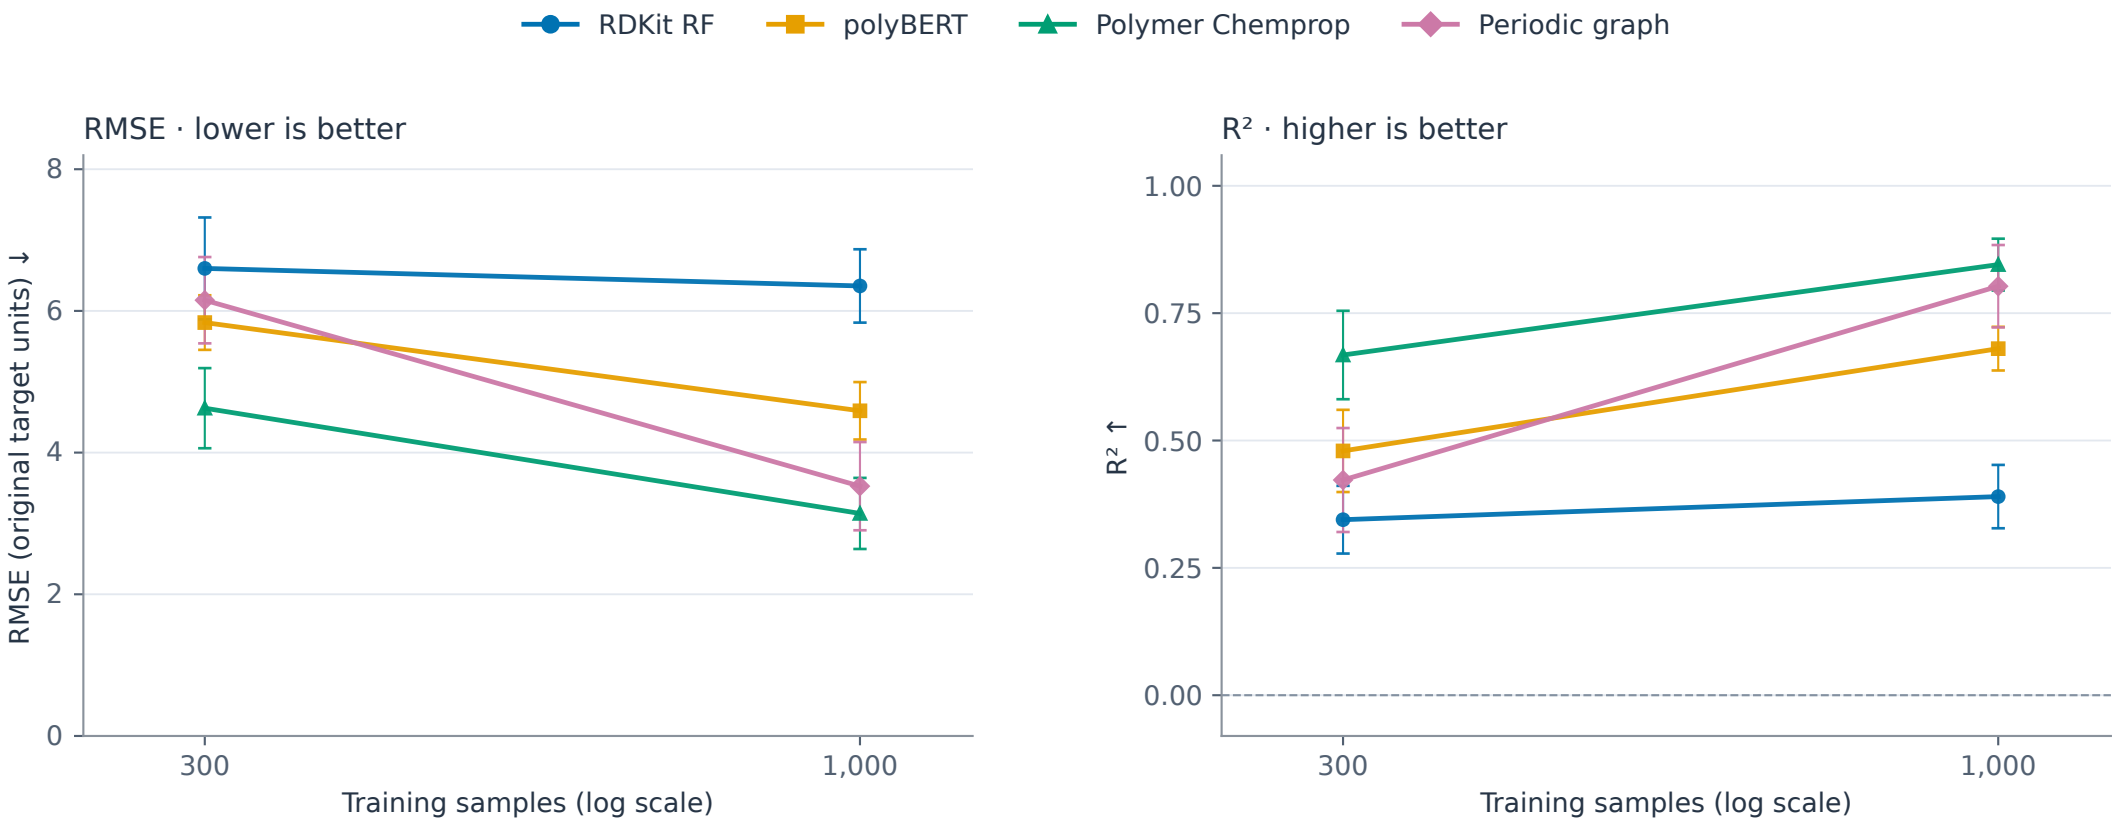

Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Refractive index · homopolymer | MD_5000




Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.

# Rg · homopolymer | MD_5000




Test only · 5 folds · mean ± population SD · $R^2$ recovered from published errors; no retraining.
$R^2$ detail panels use local scales and retain zero. RMSE is in the source target units.