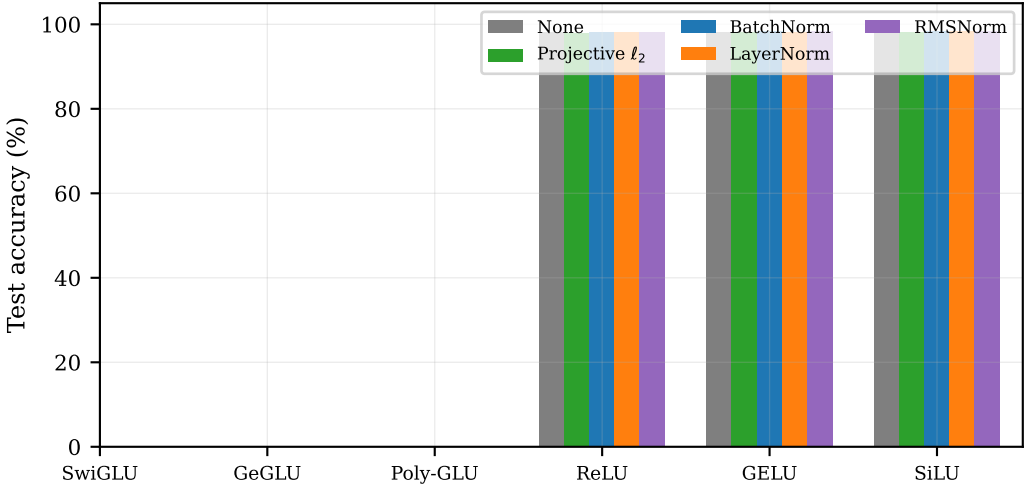
None
Projective ℓ_2
BatchNorm
LayerNorm
RMSNorm
Test accuracy (%)
0
20
40
60
80
100
SwiGLU
GeGLU
Poly-GLU
ReLU
GELU
SiLU