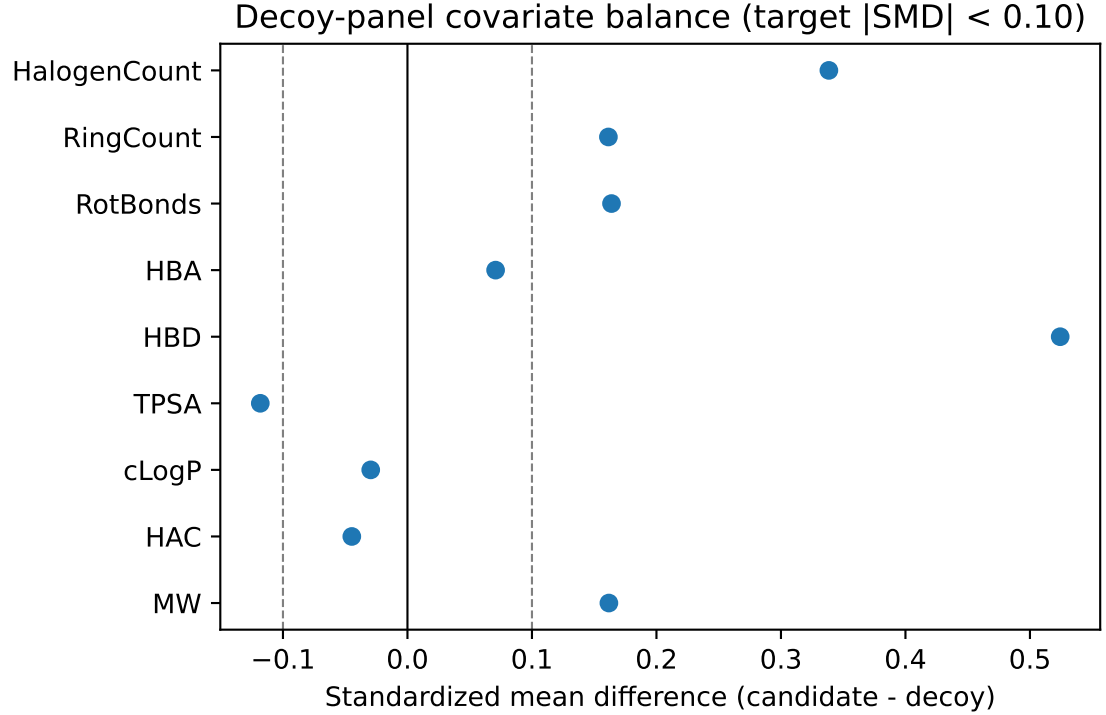
Decoy-panel covariate balance (target |SMD| < 0.10)
HalogenCount
RingCount
RotBonds
HBA
HBD
TPSA
cLogP
HAC
MW
−0.1
0.0
0.1
0.2
0.3
0.4
0.5
Standardized mean difference (candidate - decoy)