

+12.5% vs LW

TOTAL CONSUMPTION


2.4 MWh



Billing Cycle: Day 18

ESTIMATED REVENUE

KES 1.2M



3 CRITICAL

ACTIVE ALERTS

12



96% Occupancy

MANAGED UNITS


46/48

Aggregate Consumption Trend

Hourly building-wide usage data

Daily

Weekly

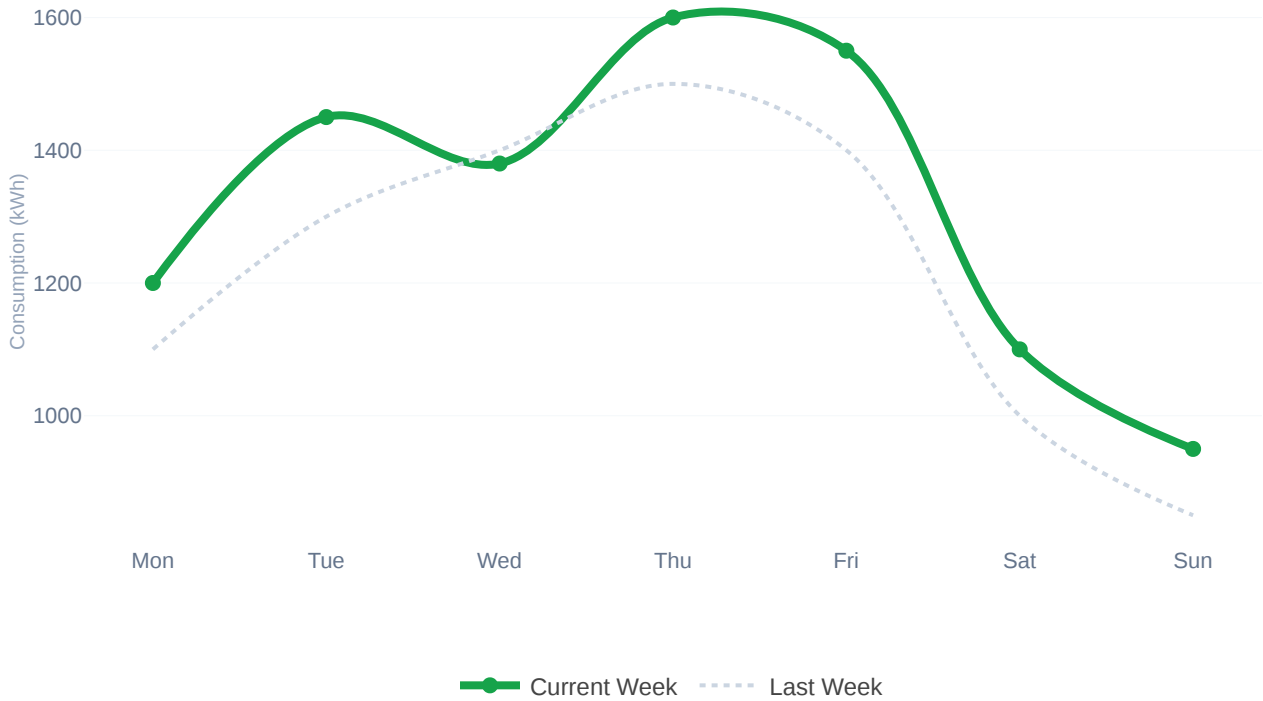

Critical Alerts



Unit 402: Abnormal Load

12.5kW surge detected in laundry area. Critical safety shed executed.

2 MINUTES AGO



Unit 108: Hub Offline

Connection lost with local hub. Smart caching enabled.

15 MINUTES AGO



Maintenance Required

Backup batteries in Wing B (Ground Floor) below 20%.

1 HOUR AGO

VIEW ALL ALERTS

Unit Performance

All Floors

Sort by Usage (High to Low)

UNIT	TENANT	STATUS	DAILY AVG	CURRENT LOAD	BALANCE	ACTION
Unit 401	Sarah Odhiambo	OCCUPIED	14.2 kWh	850W	KES 4,200	
Unit 402	David Kamau	OCCUPIED	28.5 kWh	12.4kW	KES 12,800	
Unit 403	Vacant	MAINTENANCE	0.2 kWh	15W	-	



Platform Health

Tenant Management

Billing & Subscriptions

Firmware / OTA

Compliance & Audit

System Configuration

API LATENCY (P95)

42ms

-5% since 1h ago

CLOUD SYNC QUEUE

108

Processing Normal

ACTIVE ALERTS

14

No P0 incidents

DATA INGRESS

1.8GB/s


Peak load expected in 4h

Global Traffic & Latency

NAIROBI (CENTRAL-1) • MOMBASA (EDGE-2)

24 Hours

7 Days

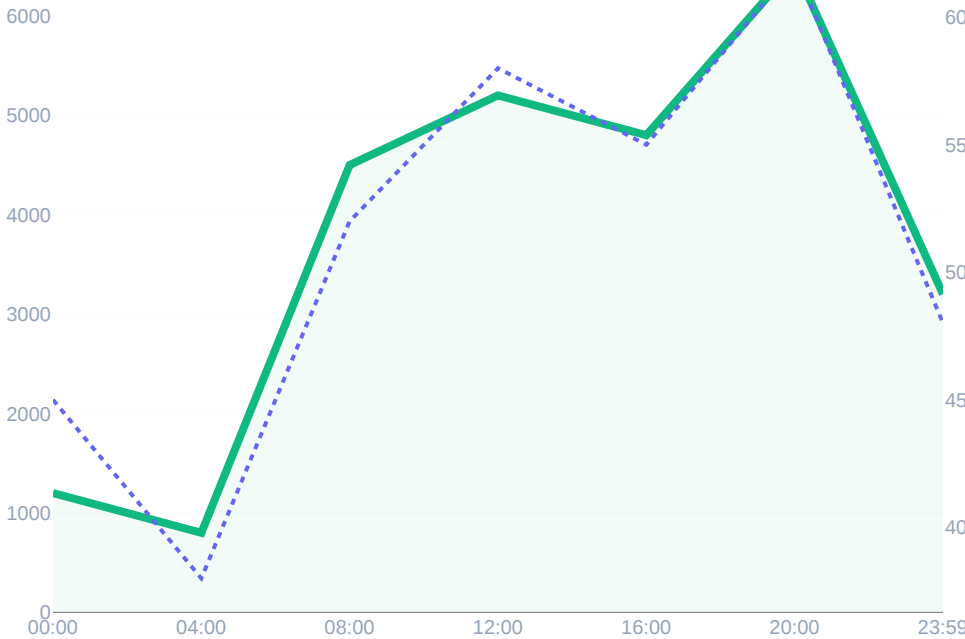

Device Reachability



LAN DIRECT

74%

CLOUD RELAY

26%

Audit Trail

EXPORT LOGS

v2.4.1 Firmware Rollout

Initiated by @sys_auto • 84% complete

Tariff Update: KPLC 2024-Q3

Scheduled for 01 Oct • Affecting all tenants

MFA Policy Enforcement

RBAC check complete • No anomalies

Service Mesh Health

CORE MICROSERVICES TELEMETRY

12 Services Online

SERVICE NAME	STATUS	CPU/RAM	ERROR RATE	LAST SYNC	CONTROL
Auth-Gateway-Service	ACTIVE	42%	0.02%	12S AGO	
Edge-Sync-Bridge	ACTIVE	68%	0.05%	5S AGO	
Billing-Pipeline-Worker	DEGRADED	92%	1.2%	JUST NOW	

SA

Super Admin

LEVEL 1 ACCESS

Shut Down Session



Verification

We've sent a 6-digit code to **+254 712 345 678** via SMS.

4

0

9

.

.

.

Verify & Secure Login

Didn't receive the code?

Resend Code (00:45)

1

ABC

2

DEF

3

GHI

4

JKL

5

MNO

6

PQR

7

STU

8

VWX

9

YZ

Overview

Statistics

Automation

Billing

Security

LIVE POWER CONSUMPTION

452 Watts

TODAY'S TOTAL

12.4 kWh

CURRENT COST

KES 324

ACTIVE MODE



ECO MODE

Optimized Savings



AWAY MODE

Security + Essential



NIGHT MODE

Low Light Silence



Smart Shed Suggestion

Reducing Living Room AC by 2°C could save you KES 45 today.

Apply Savings Now

CONNECTED DEVICES

Manage All



Main Fridge

120W • KITCHEN



Living AC

850W • LOUNGE



Water Geyser

1.2KW • BATHROOM



Smart TV

45W • LOUNGE




Add New Device

Energy Consumption

Historical data for active monitoring

Hourly (Today) ▼

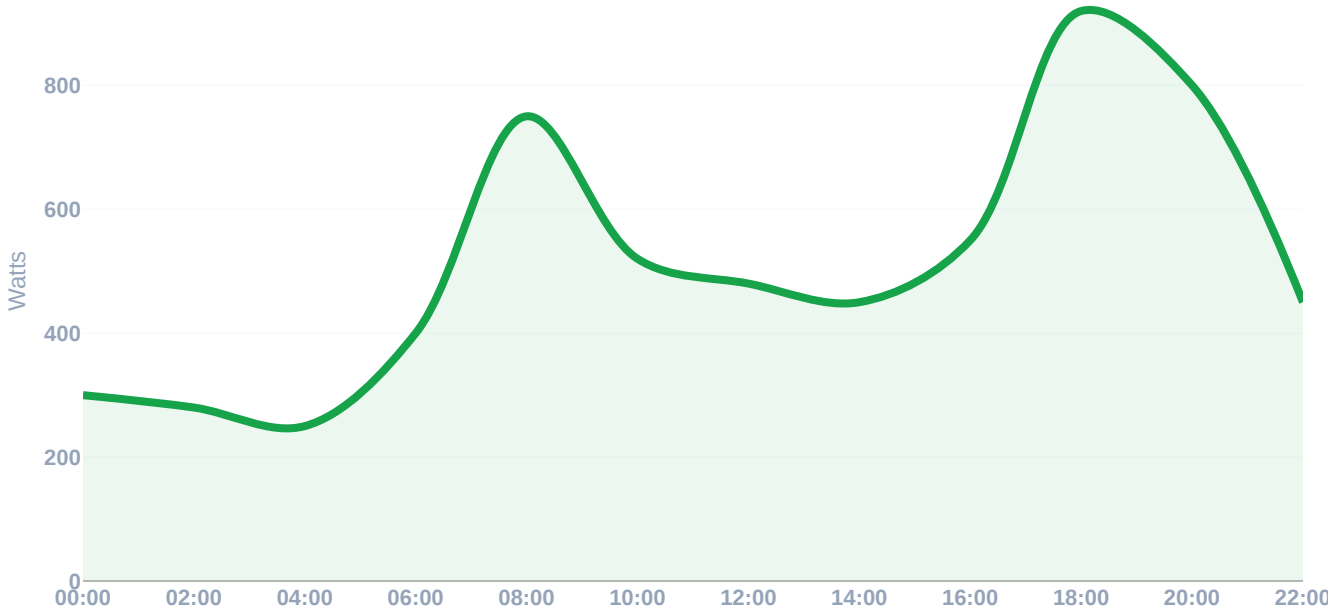

Samuel Mwangi

Tenant • Unit 4B



EcoTrack

Secure Energy Management

Welcome Back

Enter your phone number to access your dashboard.

PHONE NUMBER

☐☐ +254

712 345 678

Send OTP

Don't have an account?

[Contact Building Manager](#)

SECURE BANK-GRADE ENCRYPTION

LIVE POWER CONSUMPTION

452 Watts

Today's Usage

12.4 kWh

Estimated Cost

KES 324

⚡

ACTIVE MODE

🌿


ECO

✈️

AWAY

🌙

NIGHT

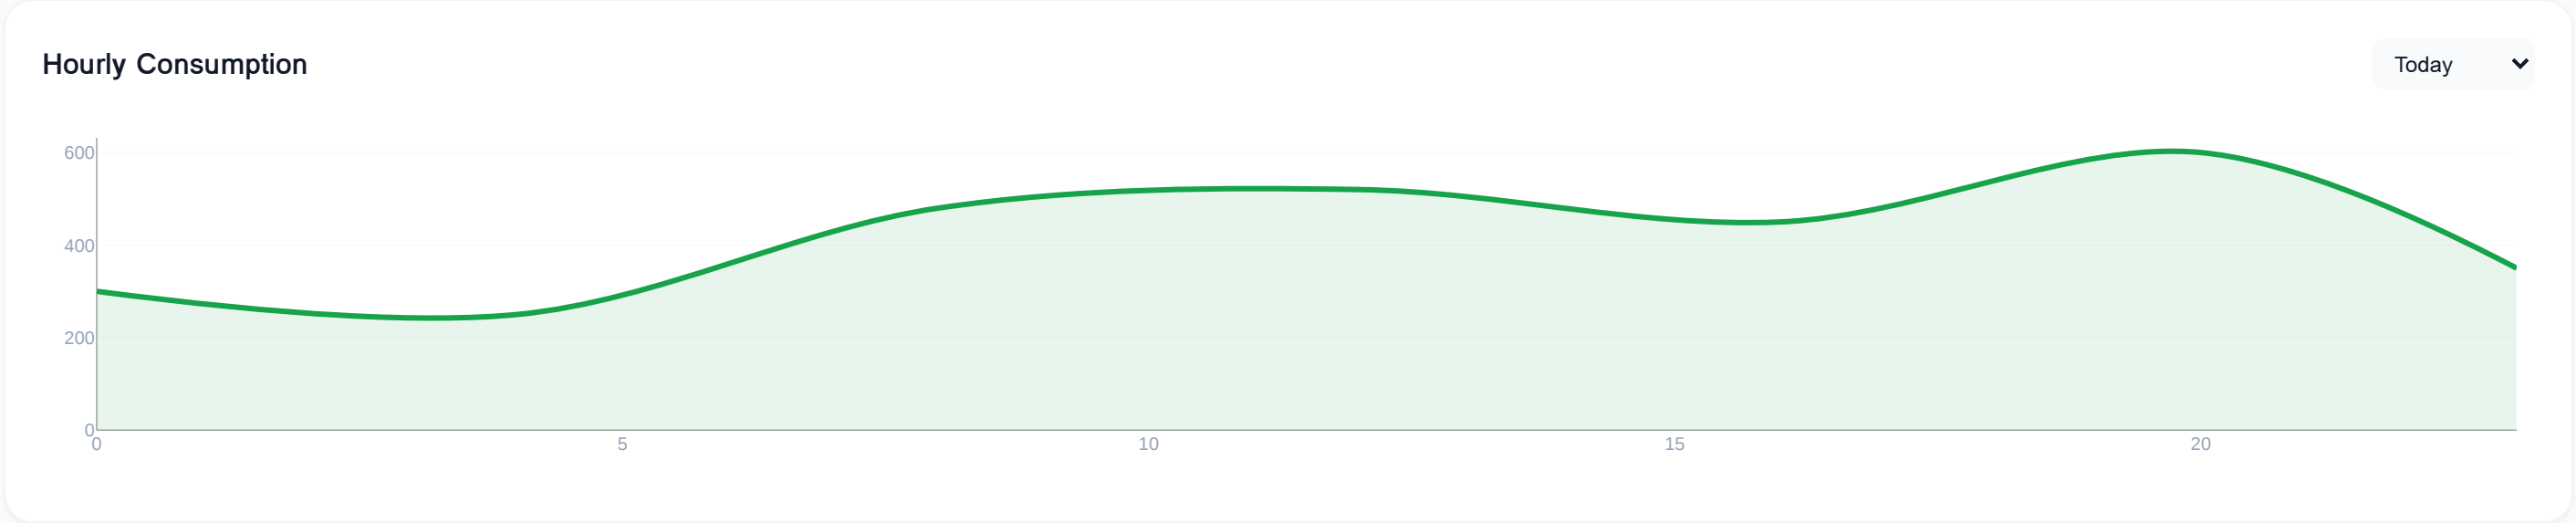

QUICK CONTROLS

VIEW ALL

🕒

Fridge
120W • Kitchen

🟢

🌀

Living AC
850W • Lounge

🔴

💧

Geyser
1.2kW • Bath

🟢

📺

Smart TV
45W • Lounge

🔴

💡

Smart Shed Suggestion

Reducing Living Room AC by 2°C could save you KES 45 today based on current tariffs.

Apply Now >