


Macro-F1 tIoU@0.5 Human Pass@2 FPR

(a) Utility metrics with uncertainty



(b) Real-normal false positives

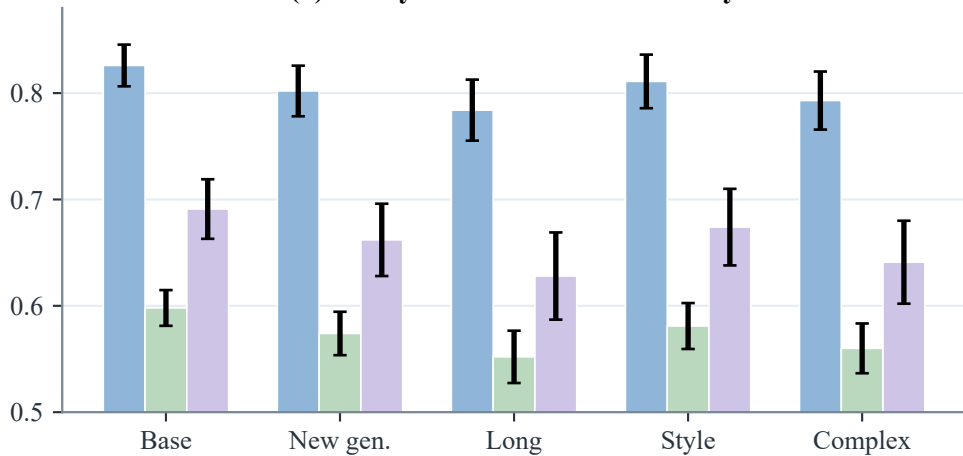